

THE UNITED REPUBLIC OF TANZANIA



MINISTRY OF WATER



Dar es Salaam Water supply & Sanitation Authority

DAWASA Building, Dunga/Malaga Street, Mwananyamala Area

P. O. Box 1573, Dar es Salaam. TANZANIA.

Tel. +25522276006/15; Fax: +255222762480; E-mail: dawasaceo@dawasa.co.tz

Comprehensive Project Brief for the Proposed Fecal Sludge Treatment Plant to be constructed at DAWASA Yard, Mkwajuni Mtaa, Vijibweni Ward, Kigamboni District, Dar es Salaam Region

Submitted to:

National Environment Management Council,

Head Office, Kambarage Tower, 6th Floor, P. O. Box 2724, Dodoma.

Phone: +255 262960098, 0713608930,

Email Address: dg@nemc.or.tz

Website: www.nemc.or.tz

Lead Consultant:

Prof. Rubhera RAM Mato (PhD), CEng. (T), Reg. EIA Expert

P. O BOX 35478, Dar es Salaam Tanzania

Mobile: +255754898592; E-Mail: rubheramato@gmail.com

December 2024

ACKNOWLEDGEMENT

The Proponent (DAWASA) wishes to convey a heartfelt thanks and appreciation to all stakeholders who in one way or another supported the completion of this work. Thanks very much all of you. Special thanks to the Kigamboni Municipal Council Officers for their prompt assistance during the fieldwork. Last but not least we thank the local community and wards leaderships in the project vicinity for their cooperation. A sincere appreciation for all experts and assistants who participated in data collection and preparation of this report.

TABLE OF CONTENTS

ACKNOWLEDGEMENT	I
ABBREVIATIONS	VII
THE STUDY TEAM	VIII
EXECUTIVE SUMMARY	IX
1.0 BACKGROUND AND JUSTIFICATION	1
1.1 NATURE OF THE PROJECT	3
2.0 PROJECT DESCRIPTION	3
2.1 PROJECT LOCATION	3
2.2 ACCESSIBILITY	5
2.3 SPECIFIC FEATURES	5
2.4 ADJACENT LAND USE	6
2.4.1 Land Ownership	6
2.5 PROJECT ACTIVITIES	7
2.5.1 MOBILIZATION OR PRE-CONSTRUCTION PHASE	7
2.5.2 CONSTRUCTION PHASE	7
2.5.3 DEMOBILIZATION PHASE	7
2.5.4 OPERATION PHASE	8
2.5.5 DECOMMISSIONING PHASE	8
2.6 PROJECT DESIGN	8
2.6.1 DESIGN CRITERIA	8
2.6.2 TECHNOLOGY DESCRIPTION	9
2.6.2.1 Garbage screen	9
2.6.2.2 Balancing tank	9
2.6.2.3 Biogas digester	9
2.6.2.4 Anaerobic Baffled Reactor (ABR)	9
2.6.2.5 Planted Gravel filter	10
2.6.2.6 Sludge Drying Bed (SDB)	10
2.7 SLUDGE LOADING INTENSITY	11
2.8 PROPOSED PROCESSING STEPS	11
3.0 POLICIES, LEGISLATION AND INSTITUTIONAL ASPECT	13
3.1 RELEVANT POLICIES	13
3.1.1 National Environment Policy 2021	13
3.1.2 National Environmental Policy (NEP, 2021)	14
3.1.3 National Land Policy of 1997	15
3.1.4 Construction Industry Policy (2003)	15
3.1.5 National Health Policy (2003)	15
3.1.6 National Gender Policy of 2000	16
3.1.7 National Human Settlements Development Policy (2018)	16
3.2 PRINCIPAL LEGISLATIONS AND REGULATIONS	17
3.2.1 Environmental Management Act (2004)	17
3.2.2 The Environmental Management (Fees and Charges) Regulations, 2021	18
3.2.3 The Environmental Management (Control of hazardous Waste) regulations, 2021	18
3.2.4 The Environmental Management (Control of Noise and vibration) regulations, 2015	19
3.2.5 The Environmental Management (Prohibition of Plastic Carrier bags) regulations, 2019	19
3.2.6 The Environmental Management (Solid Waste Management) regulations, 2007	20

3.2.7	<i>The Environmental Management (Water Quality) regulations, 2009</i>	20
3.2.8	<i>The Environmental Management (Air Quality) regulations, 2009</i>	21
3.2.9	<i>The Environmental Management (Soil Quality) regulations, 2009</i>	21
3.2.10	<i>Occupational Health and Safety Act 2003</i>	22
3.2.11	<i>The Water Supply and Sanitation Act No. 12 of 2009</i>	22
3.12	<i>Engineers Registration Act and its Amendments 1997 and 2007</i>	23
3.2.13	<i>The Contractors Registration (Amendment) Act, 2008</i>	23
3.2.14	<i>The Architects and Quantity Surveyors Act (1997)</i>	23
3.2.15	<i>The Urban Planning Act (2007)</i>	23
3.2.16	<i>Public Health Act (2009)</i>	24
4.1	INTRODUCTION	26
4.2	CLIMATIC CONDITION	26
4.2.1	<i>Lowland</i>	27
4.2.2	<i>Topography</i>	27
4.2.3	<i>Geology and Soil</i>	27
4.3	POPULATION CHARACTERISTICS	28
4.3.1	<i>Population Composition and Distribution</i>	28
4.4	SOCIAL ECONOMIC SERVICES	28
4.4.1	<i>Energy</i>	28
4.4.2	<i>Health Sector</i>	29
4.4.4	<i>Education Sector</i>	30
4.4.5	<i>Water Supply and Sanitation</i>	30
4.4.6	<i>Sanitation and Hygiene Services</i>	31
4.4.7	<i>Waste Water Management</i>	32
4.4.8	WATER TABLE AND WATER QUALITY ANALYSIS	33
4.4.9	AIR QUALITY	36
4.4.10	NOISE LEVELS	37
5.0	STAKEHOLDER VIEW ON THE PROPOSED PROJECT	38
6.0	PROJECT REQUIREMENTS AND WASTE GENERATION	40
6.1	PROJECT REQUIREMENTS	40
6.1.1	<i>Construction materials and labour force</i>	40
6.1.2	<i>Labour force</i>	40
6.1.3	<i>Machinery and Equipment</i>	40
6.2	WASTES GENERATION	40
6.2.1	<i>Liquid waste management</i>	41
6.2.2	<i>Solid waste management</i>	41
7.0	POTENTIAL IMPACTS	42
7.1	POSITIVE IMPACTS	42
7.1.1	<i>Improved living conditions and economic growth</i>	42
7.1.2	<i>Employment opportunities</i>	43
7.1.3	<i>Improved urban agriculture</i>	43
7.1.4	<i>Increased socio-cultural interaction</i>	43
7.1.5	<i>Increased Revenue to the nation through taxes, both direct and indirect</i>	43
7.1.6	<i>Biogas production potential</i>	44
7.1.7	<i>Minimized Forest products harvesting</i>	44
7.1.8	<i>Cost reduction for sewage management</i>	44
7.2	NEGATIVE IMPACTS	44
7.2.1	<i>Increased HIV/AIDS and other sexual related diseases:</i>	44
7.2.2	<i>Loss of biodiversity</i>	45
7.2.3	<i>Land degradation and increased erosion</i>	45

7.2.4	Noise pollution	45
7.2.5	Air Pollution from dust emission	46
7.2.6	High Risk of Health associated with construction work.....	46
7.2.7	Waste generation during construction	47
7.2.8	High Risk of Health associated during operation.....	47
8.0	ACTION PLAN FOR PREVENTION AND MANAGEMENT OF ACCIDENTS DURING IMPLEMENTATION	
STAGE	47
8.1	HEALTH AND SAFETY	48
8.2	SECURITY	48
8.3	MONITORING, MAINTENANCE AND REPAIR	48
8.4	PROJECT ALTERNATIVES	48
9.0	ENVIRONMENTAL AND SOCIAL MANAGEMENT PLAN	49
9.1	ENVIRONMENTAL AND SOCIAL MANAGEMENT PLAN	49
10.0	MONITORING PLAN	55
10.1	ENVIRONMENTAL MONITORING	55
11.0	PROJECT BUDGET	59
12.0	CONCLUSION	59
	REFERENCES	60
	APPENDIX I: LIST OF STAKEHOLDERS CONSULTED	61
	APPENDIX II: LAND OWNERSHIP DOCUMENT	64
	APPENDIX III: ARCHITECTURAL DRAWINGS	65
	APPENDIX IV: MINUTES OF MEETINGS WITH STAKEHOLDERS	66
	APPENDIX V: SCREENING LETTER FROM NEMC	67
	APPENDIX VI: MEMORANDUM OF UNDERSTANDING BETWEEN DAWASA AND	70
	DAR ES SALAAM MUNICIPAL COUNCILS	70
	APPENDIX VII: SOURCE OF CONSTRUCTION MATERIALS	71
	APPENDIX VIII: NON-TECHNICAL SUMMARY	72
	ANNEX I: GENERIC ENVIRONMENTAL MANAGEMENT FOR CONSTRUCTION ACTIVITIES	90

LIST OF FIGURES

Figure 1: A Map of Dar es salaam region showing the project Municipal4
Figure 2: An Extract Google view to show the location of the project area.....5
Figure 3: Some of the natural vegetation at the site, borehole, and Lake oil fence.6
Figure 4: The Residential and institutional buildings around the project site.6
Figure 5: The Fecal Sludge Treatment Facility cross-section diagram..... 12
Figure 6: Stakeholder’s consultation meeting at Kigamboni Municipal Council office38

LIST OF TABLES

Table 1: The coordinates of the project area.....3

Table 2: Stakeholders issues and concerns.....39

Table 3: Management of construction and operation wastes.....41





Table 4: Environmental and Social Management Plan for the Proposed
Construction of Feacal Sludge Treatment Plant at DAWASA Yard, Mkwajuni
Mtaa, Vijibweni ward, Kigamboni Municipal51

Table 5: Monitoring Plan for the Proposed Construction of Feacal Sludge
Treatment Plant at DAWASA Yard, Mkwajuni Mtaa, Vijibweni ward, Kigamboni
Municipal.....56

ABBREVIATIONS

AAQ	Ambient Air Quality
AIDS	Acquired Immuno-Deficiency Syndrome
DAWASA	Dar es Salaam Water and Sanitation Authority
EIA	Environmental Impact Assessment
EMP	Environmental Management Plan
ESIA	Environmental and Social Impact Assessment
ESMP	Environmental and Social Monitoring Plan
FSTP	Faecal Sludge Treatment Plant
GoT	Government of Tanzania
HIV	Human Infection Virus
IDA	International Development Association
LGA	Local Government Authority
NEMC	National Environment Management Council
NEP	National Environment Policy
OGSP	Off-Grid Sanitation Project
PPE	Personal Protective Equipment
PVC	Polyvinyl Chloride
RAP	Resettlement Action Plan
SSS	Simplified Sewerage System
STDS	Sexual Transmitted Diseases
TANESCO	Tanzania National Electric Supply Company
WSP	Wastewater Stabilization Ponds

THE STUDY TEAM

NAME	POSITION	NEMC Reg. No.	SIGNATURE
Prof. Rubhera RAM Mato	Environmental and ESIA Team Leader	Registered NEMC/EIA/0092	
Mr. Robert Kishiki	Sociologist	Not Registered	
Mr. Emmanuel Rajab	Environmental Engineer	Registered EC/EE- EIA/2021/0015	
Mr. Melkizedeck Stephano	Environmentalist	Not Registered	

EXECUTIVE SUMMARY

Comprehensive Project Brief for the Proposed Fecal Sludge Treatment Plant to be constructed at DAWASA Yard, Mkwajuni mtaa, Vijibweni ward, Dar es Salaam City Council, Dar es Salaam Region

Proponent: DAWASA

Proponent's Contact: DAWASA House, **Dunga/Malanga**

Street/Mwananyamala

P.O Box 1573 DSM

Tel: +255222760006/15

Fax: +255222762480

Email Address: info@dawasa.go.tz

EIA Expert: Prof. Rubhera RAM Mato

(PhD), CEng. (T), Reg. EIA Expert

Mobile: +255754898592

E-Mail: rubheramato@gmail.com

INTRODUCTION

The Government of the United Republic of Tanzania (GoT) through the Dar es Salaam Water and Sewerage Authority (DAWASA) under the Ministry of Water intends to implement an Off-Grid Sanitation Project (OGSP) in Dar es Salaam City to serve peri-urban areas not connected to the central sewerage system. DAWASA has received financing from the International Development Association (IDA) in the form of a credit to implement the project. Prior to implementing the project, the law in Tanzania requires an Environmental Impact Assessment to be conducted and approved by relevant authority. In order to comply with the law in Tanzania, the DAWASA intends to apply a portion of the proceeds of the credit to eligible payments for consulting services for Preparation of Environmental and Social Impact Assessment (ESIA) and Resettlement Action Plan (RAP) Report for construction of off grid sanitation projects.

Dar es Salaam is the largest and most important commercial and industrial centre in Tanzania. The city has an estimated population of about 5.0 million and is projected to double at the end of the project horizon of 25 years (*National Census 2022*). About 10% of the population is served by sewers and the rest almost depend on on-site sanitation systems. The sewer coverage is only limited to the area within city centre with a total length of 67.8km and the system is based on a separate system and discharge their effluent into oxidation ponds, and into the sea through sea outfall of about 1.03km long. The onsite sanitation systems result into Faecal sludge of which handling and management throughout the sanitation chain (from domestic containment, transportation as well as disposal and treatment) is currently hygienically inadequate thus posing environmental and public health risks. The Off-Grid project is intended to address these challenges. The Off-Grid project is divided into several subprojects which will be implemented in the five municipalities of Dar es Salaam City. One of these is the Construction of Faecal sludge treatment plant at DAWASA Yard, Mkwajuni Mtaa in Vijibweni ward, Kigamboni Municipality.

The ESIA study was conducted in accordance with the Environmental Management (Environmental Impact Assessment and Audit) (Amendment) Regulations, 2018 along with the Environmental Impact Assessment and Audit Regulations of 2005. These Regulations provide legal procedures for implementing the requirements of the Environmental Management Act Cap.191 of 2004. The Regulations give mandate to NEMC to oversee the EIA process, which culminates with an award of the EIA Certificate by the Ministry responsible for Environment.

In accordance with the EIA Regulations, NEMC is mandated to screen projects and make decisions of level of EIA required as well as evaluating the adequacy of respective environmental statements. Considering the nature and size of the proposed “Faecal Sludge Project in Kigamboni Municipality”, the project falls under Category “B2” (Non-Mandatory) in accordance with Reg.4 (1)(c) and First

Schedule of the amended 2018 Regulations. The regulations require developers to prepare and submit to the National Management Council (NEMC) filled EIA registration forms and “Project Briefs” for all B2 projects. The preparation and content of the “Project Briefs” is provided under Regulation 6(1) of Environmental Impact Assessment and Audit Regulations, 2005. The same has been followed in preparing this “Project Brief”. The project brief was conducted in July-August 2020.

This project brief for the Proposed Construction of Faecal Sludge Treatment Plant in Kigamboni Municipality is being submitted to NEMC together with EIA Registration Forms for EIA Certificate decision.

PROJECT DESCRIPTION

The project site is located at Vijibweni ward, Kigamboni Municipal within Dar es Salaam Region. The project site is geographically located at 37S UTM zone with coordinates in Table 1. The site is 23 Kilometers from Dar Es Salaam city center and 16 Kilometers from the Nyerere Bridge

The project area is accessible through Kigamboni-Kongowe/Somangira road, about 15 km from Kigamboni Ferry and approximately 1.35 km from the road. It is in the right-left side location for Kigamboni to Somangira direction.

The proposed project site is characterized by both natural and artificial vegetation. There are tall grasses, shrubs with climbers, and some artificial trees (Palm trees) around the site area. The project site is located adjacent to the marches within which a river drains to the Indian Ocean. Generally, the project site is rich in nutrients because some farming activities were observed to be conducted.

POLICIES, LEGISLATION AND INSTITUTIONAL ARRANGEMENTS

Sector policies that were reviewed when executing the proposed development are;

- National Environment Policy 2021
- National Land Policy of 1997
- Construction Industry Policy (2003)
- National Health Policy (2003)
- National Gender Policy of 2000
- National Human Settlements Development Policy (2000)

Principal Acts, regulations and guidance that support and provide guidelines to implement the intended project are;

- Environmental Management Act (2004)
- The Environmental Management (Fees and Charges) Regulations, 2021
- The Environmental Management (Control of hazardous Waste) regulations, 2021
- The Environmental Management (Control of Noise and vibration) regulations, 2015
- The Environmental Management (Prohibition of Plastic Carrier bags) regulations, 2019
- The Environmental Management (Solid Waste Management) regulations, 2007
- The Environmental Management (Water Quality) regulations, 2009
- The Environmental Management (Air Quality) regulations, 2009
- The Environmental Management (Soil Quality) regulations, 2009
- Occupational Health and Safety Act 2003
- The Water Supply and Sanitation Act No. 12 of 2009
- Engineers Registration Act and its Amendments 1997 and 2007

- The Contractors Registration (Amendment) Act, 2008
- The Architects and Quantity Surveyors Act (1997)
- The World Bank guidelines for Environmental Management and Planning Act (2007)
- Public Health Act (2009)

STAKEHOLDERS ISSUES AND CONCERNS

Different stakeholders were consulted. Among of the issues that arise during consultation at the Kigamboni Municipal Council and community at DAWASA Yard, Mkwajuni mtaa are:

Facilities to be developed

- Proper awareness to people on best ways to dispose pads and other waste in order to avoid system blockage
- The proposed facilities should be well protected

Awareness to the community

- Awareness to the people on the system operation, since it is a new technology
- Awareness to the community to avoid riots in the future
- Educate the community to avoid the use of detrimental disinfectants to the system so as to avoid system failure and contaminated manures.

PROJECT REQUIREMENTS AND WASTE GENERATION

Project requirements

The main materials for Faecal Sludge Treatment Plant include cement, aggregates (stones), water, steel, sand, timbers, blocks, uPVC pipes, IPS Pipes and gravels. All materials are available in the local sources in Tanzania. The estimated quantities of the materials to be included in the BoQ.

The proposed project development will employ various standard construction equipment and machinery. Equipment expected to be used during the construction

works are Excavators, Tippers, Concrete Mixers, poker vibrators, Wheel barrow, Compactor, etc. All equipment and machineries for construction works needed by the proposed project will be determined when the bill of quantities (BoQ) and selection of Contractor is finalized. These equipments shall be temporary and shall be demobilized once project is completed.

Wastes generation

The major wastes generation associated with the project are spoil soils resulting from earthworks during the foundation excavations, solid wastes and liquid waste. The spoil soil shall be stock piled around the public toilet for further use in landscaping the site at the end of the project.

A total of 120m³ per day of liquid waste is estimated to be received at the receiving chamber of the proposed facility during the maximum operation phase. On the other hand, about 0.5-1 tons per month of domestic refuse and other solid wastes is estimated to be generated and trapped at the garbage screen during the project construction and operation phase respectively. A well-established solid waste collection system will be instituted. The system will involve among other things wastes segregation at source, recycling or reuse of some wastes and final disposal to the approved dumpsite / landfill.

POTENTIAL IMPACTS

The following impacts were identified to be likely to occur during mobilization phase:

- Employment opportunities
- Improved urban agriculture
- Increased socio-cultural interaction

The following impacts were identified to be likely to occur during the construction phase;

- Increased HIV/AIDS and other sexual related diseases

- Loss of biodiversity
- Land degradation and increased pollution
- Noise pollution
- Air pollution from dust emission
- High risk of Health associated with construction work
- Waste generation during construction

The following impacts were identified to be likely to occur during the operational phase;

- Improved social-economic livelihood and dignity within the beneficiary society
- Increased Revenue to the nation through taxes, both direct and indirect
- Cost reduction for sewage management
- Biogas production potential
- Minimized forest harvesting
- Sewer leakage/overflow
- Improved urban agriculture

MITIGATION MEASURES AND ENVIRONMENTAL AND SOCIAL MANAGEMENT PLAN (ESMP)

The options to minimize or prevent the identified adverse social and environmental impacts as well as a monitoring plan have been suggested in this report and are contained in the ESMP. Many of them are based on good engineering practices and the timely responsiveness of the responsible institution. The ESMP describes the implementation schedule of the proposed mitigation measures as well as planning for long-term monitoring activities. It defines the roles and responsibilities of different actors of the plan. The Approach environmental and social costs amount to Tshs 38,000,000.00. The estimated annual costs for carrying out the proposed environmental and social monitoring program amounts to TSH 28,000,000.00.

DECOMMISSIONING PLAN

The decommissioning is not anticipated in the foreseeable future. However, if this will happen, may entail change of use (functional changes) or demolition triggered by change of land use. In view of this, specific mitigation measures pertaining to environmental impacts of decommissioning works cannot be proposed at the moment with a reasonable degree of certainty.

CONCLUSION

The proposed project is of greater profit to the community and the country at large as it promotes and improve sanitation in the streets. When there is good and improved sanitation, then the outbreak of diseases like diarrhoea and associated stomach and waterborne diseases are also reduced and prevented hence improved public health.

The impacts identified are preventable and of less negativity to the community, therefore the developer can be provided with the environmental clearance certificate in order to commence the implementation of the project.

It is, therefore, concluded that implementation of the proposed construction of the Faecal sludge treatment plant at DAWASA Yard, Mkwajuni mtaa will entail no detrimental impacts provided that the recommended mitigation measures are adequately and timely put in place. The identified adverse impacts shall be managed through the proposed mitigation measures and implementation regime laid down in this EIS. DAWASA is committed to implementing all the recommendations given in the EIS and further carrying out the environmental auditing and monitoring schedules.

Comprehensive Project Brief for the Proposed Fecal Sludge Treatment Plant to be constructed at DAWASA Yard, Mkwajuni mtaa, Vijibweni ward, Dar es Salaam City Council, Dar es Salaam Region

1.0 BACKGROUND AND JUSTIFICATION

The Government of the United Republic of Tanzania (GoT) through the Dar es Salaam Water and Sewerage Authority (DAWASA) under the Ministry of Water intends to implement an Off-Grid Sanitation Project (OGSP) in Dar es Salaam City to serve peri-urban areas not connected to the central sewerage system. DAWASA has received financing from the International Development Association (IDA) in the form of a credit to implement the project. Prior to implementing the project, the law in Tanzania requires an Environmental Impact Assessment to be conducted and approved by relevant authority. In order to comply with the law in Tanzania, the DAWASA intends to apply a portion of the proceeds of the credit to eligible payments for consulting services for Preparation of Environmental and Social Impact Assessment (ESIA) and Resettlement Action Plan (RAP) Report for construction of off grid sanitation projects.

Dar es Salaam is the largest and most important commercial and industrial centre in Tanzania. According to the Tanzania National Census of August 2022, the City of Dar es Salaam has a population of 5,383,728 (sense.nbs.go.tz, accessed December 24, 2022). About 10% of the population is served by sewers and the rest almost depend on on-site sanitation systems. The sewer coverage is only limited to the area within city centre with a total length of 67.8km and the system is based on a separate system and discharge their effluent into oxidation ponds, and into the sea through sea outfall of about 1.03km long. The onsite sanitation systems result into Faecal sludge of which handling and management throughout the sanitation chain (from domestic containment, transportation as well as disposal and treatment) is currently hygienically inadequate thus posing environmental and public health risks. The Off Grid project is intended to address these challenges. The Off Grid project is divided into several subprojects which will be implemented in the five

municipalities of Dar es Salaam City. One of these is the Construction of Faecal sludge treatment plant at DAWASA Yard, Mkwajuni mtaa in Vijibweni ward, Kigamboni Municipality.

The ESIA study was conducted in accordance with the Environmental Management (Environmental Impact Assessment and Audit) (Amendment) Regulations, 2018. These Regulations provide legal procedures for implementing the requirements of the Environmental Management Act Cap.191 of 2004. The Regulations give mandate to NEMC to oversee the EIA process, which culminates with an award of the EIA Certificate by the Ministry responsible for Environment.

In accordance with the EIA Regulations, NEMC is mandated to screen projects and make decisions of level of EIA required as well as evaluating the adequacy of respective environmental statements. Considering the nature and size of the proposed “Faecal Sludge Project in Kigamboni Municipality”, the project falls under Category “B2” (Non-Mandatory) in accordance with Reg.4 (1)(c) and First Schedule of the amended 2018 Regulations. The regulations require developers to prepare and submit to the National Management Council (NEMC) filled EIA registration forms and “Project Briefs” for all B2 projects. The preparation and content of the “Project Briefs” is provided under Regulation 6(1) of Environmental Impact Assessment and Audit Regulations, 2005. The same has been followed in preparing this “Project Brief”. The ESIA study that ends at the project brief stage since it is a B2 type, was conducted from July 2020 to August 2020. The subsequent corrections following NEMC reviews have been concluded in December 2022.

This project brief for the Proposed Construction of Faecal Sludge Treatment Plant in Kigamboni Municipality is being submitted to NEMC together with EIA Registration Forms for EIA Certificate decision.

1.1 NATURE OF THE PROJECT

The proposed project concerns construction of an engineered Faecal sludge treatment facility for public use at DAWASA Yard, Mkwajuni Mtaa, Vijibweni ward, Kigamboni Municipality. The nature of the project enhances environmental protection through proper handling and disposal of domestic sewage. According to First Schedule of the EIA and Audit Regulations (Amended) of 2018, the nature of the project is small and entails no significant impacts. The project can be categorised as Type B2, which according to the regulations are “small-scale activities and enterprises that require registration but shall not require Environmental Impact Assessment. Further, the projects shall not require screening and scoping, rather, the Project Brief shall be examined and issued with an Environmental Impact Assessment Certificate”.

2.0 PROJECT DESCRIPTION

2.1 Project Location

The project site is located at Mkwajuni Mtaa, Vijibweni ward, Kigamboni Municipal within Dar es Salaam Region. The project site is geographically located at 37S UTM zone with coordinates in Table 1. The site is 13.7 Kilometers from Dar Es Salaam city center when one moves from the City center to Kigamboni Via Nyerere Bridge. (Refer Figure 1, and Figure 2).

Table 1: The coordinates of the project area

S/No.	Coordinates	
	Easting	Northing
1.	536255.830	9241023.404



Figure 1: A Map of Dar es salaam region showing the project Municipal



Figure 2: An Extract Google view to show the location of the project area

2.2 Accessibility

The project area is accessible through Nelson Mandela-Bandari road and Tungi road via Nyerere bridge, about 13.7 km from Dar city center, 3.2 km from Kigamboni Ferry terminal, and approximately 100 meters from Vijibweni road. It is on the right side when one moves from Kigamboni to Mjimwema direction. The proposed site is about 10 meters from Lake oil depot/yard.

2.3 Specific Features

The proposed project site is characterized by both natural vegetation mainly grass vegetation. There are tall grasses, and some trees (Palm trees), mango trees, and Neem plants around the site area (Figure 3). The project site is located adjacent to the lake oil yard; the area is fenced with wire meshes, also there is the existing guardhouse and an operational borehole. While there is no permanent surface water sources in the vicinity of the proposed site for FSTP, groundwater resources is of concern. Groundwater is abundant in almost the entire city of Dar es Salaam.



Figure 3: Some of the natural vegetation at the site, borehole, and Lake oil fence.

2.4 Adjacent Land Use

The adjacent land use includes residential buildings, institutional buildings like ELOI Christian Ministry and Lake Oil yard, power transmission lines, and car wash, figure 4.

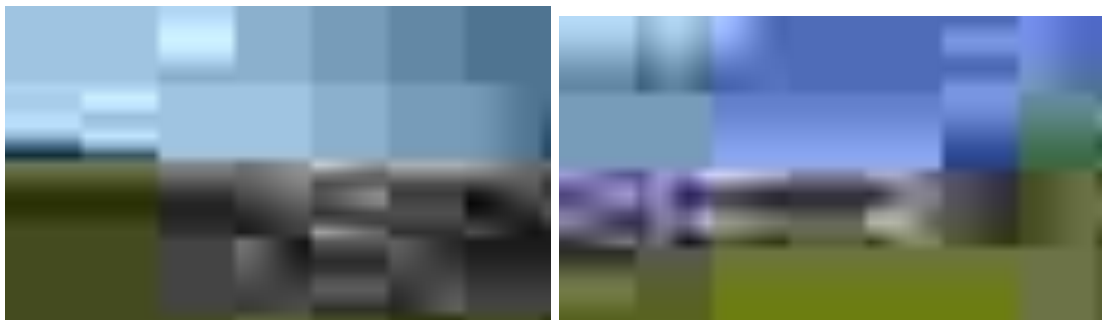


Figure 4: The Residential and institutional buildings around the project site.

2.4.1 Land Ownership

The proposed Faecal Sludge Treatment Plant at DAWASA Yard is on Plot No 13, Block H at Vijibweni Area, Mkwajuni Mtaa. The project site is solely owned by DAWASA, refer the appended Certificate of Occupancy, Appendix II. In this regard DAWASA has apportioned about 6,878 Square Meters piece of land for medium size FSTP.

2.5 PROJECT ACTIVITIES

2.5.1 Mobilization or pre-construction phase

This phase entails mobilization of labour force, and equipment as well as acquisition of various permits as required by the law.

Other activities during this phase include;

- Topographical Survey for setting out purposes,
- Geo-technical Investigation for the areas allocated with the balancing tank and Anaerobic Baffled Reactor (ABR)
- Construction Materials' source Investigation,
- Land acquisition,
- Material storage and material preparation,

Duration 3-4 months

2.5.2 Construction phase

This phase entails all the necessary installations, site grading and placement of the facility components. The major activities include;

- Vegetation clearance and earthworks (foundations excavation),
- Dewatering
- Site access road formation and drainages construction;
- Construction of parking lot and access ramp for tankers;
- Construction of Garbage screen, balancing tank, Biogas digester, Anaerobic Sludge Reactor (ABR) and sludge drying beds;
- Construction of Plant Office, guard house and storage room;
- Preparation of planted gravel filter;
- Plumbing work connecting all treatment units up to the effluent; and
- Installation of biogas collection system to the intended end user.

Duration 18 months

2.5.3 Demobilization phase

This phase will involve the dismantling of temporary structures such as scar forming and removing/spreading spoil materials for proper restoration of the site.

Other activities include;

- General cleanliness of the area, that is clearance of all sorts of solid wastes (plastics, wood, metal, papers, etc);
- Deposit all wastes to the authorized dumpsite;

2.5.4 Operation phase

The phase entails the actual usage of the Faecal sludge Plant. Faecal sludge will be desludged using vacuum takers and disposed of at the proposed facility for further treatment. DAWASA will decide on the mode of operation of the Faecal Sludge Treatment Facility.

2.5.5 Decommissioning Phase

Decommissioning is not anticipated in the foreseeable future as the completed facility will be serving a number of houses which at present incur many costs to dispose fecal sludge and if not so tend to discharge illegally. However, if this will happen, may entail change of use (functional changes) or demolition triggered by change of land use.

2.6 PROJECT DESIGN

2.6.1 Design criteria

The proposed public design was obtained partly using criteria stipulated in the Tanzania national documents, specifically, the National Guideline for Water, Sanitation and Hygiene for Tanzania Schools prepared by the Ministry of Education, Science and Technology (2016); and the Design, Construction Supervision, Operation and Maintenance (DCOM) Manual Volume II, Design of Sanitation Projects, Fourth Edition, prepared by the Ministry of Water (2020).

The proposed technology and construction design follow the objective to execute an engineering design of fecal sludge management facility (one in number at the stated site) which will be simple, cost effective/efficient, easy to operate and maintain performance standards which conform to NEMC.

Technology selection was based on the following four main aspects;

- Land availability
- Context of the location of the treatment sites (existing infrastructures)
- Local operation and maintenance management capacity
- Revenue generation through by-products

2.6.2 Technology description

2.6.2.1 Garbage screen

Domestic sludge is dispersed directly onto the screening inlet chamber to retain the incoming debris before it goes to the preliminary treatment process.

2.6.2.2 Balancing tank

The incoming wastewater is stored in the balancing tank to allow sludge stabilization and controlling flow when it goes to the next treatment units. This tank play key role to reduce shocking loads towards the system especially when the hydraulic loading surpasses plant designed holding capacity.

2.6.2.3 Biogas digester

This unit is designed to separate the incoming wastewater in liquid and solid form as well as the biologically digestion of organic solids. The digestion process takes place without oxygen input, under anaerobic conditions, and generates biogas useful for cooking, lighting and heating. Therefore, the project will produce biogas which will be harvested and used by the nearby facilities ie the nearby residents, but the number of users depends on the volume produced from the nature of the wastewater received in the facility.

2.6.2.4 Anaerobic Baffled Reactor (ABR)

The baffled reactor consists of series of chambers in which the wastewater flows up-stream. Here, the suspended and dissolved solids in the pre-settled waste water undergo anaerobic degradation. The activated sludge settles at the bottom of each chamber and the influent wastewater is forced to flow through this sludge blanket where anaerobic bacteria make use of the pollutants for their metabolism. Progressive decomposition occurs in the

successive chambers. A part of the last chambers can optionally be filled up with coarse filter material like, stones, cinder or plastic rings. The filter materials act as carrier material for an attached bio-film, which consumes the organic water pollutants. In ABR plants the BOD removal efficiency is up to 90% and the pathogen removal ranges between 40-75%. The baffled reactor is resistant to shock load and variable inflow. It operates by gravity and maintenance is reduced to desludging of the chambers at intervals of 1-2 years. This unit is advantageous since its sub-soil construction saves space.

2.6.2.5 Planted Gravel filter

Planted Gravel Filter (PGF) is a constructed wetland suitable for wastewater with low percentage of suspended solids that have already been removed by pre-treatment. The main removal of treatment mechanisms are biological conversion, physical filtration and chemical absorption. The PGF is made of planted filter bodies consisting of graded gravel. The bottom slope is 1% and the flow direction is mainly horizontal. The main plants used in this filter bed are; *Canna indica*, *Reed juncus*, *Papyrus*, *Phragmites* and *Arundo donax*. The plant selection is mainly based on their ability to grow on waste water and have their roots go deep and spread wide. Plants transport oxygen via their roots into the ground. However, in the present DEWATS design the use of plants is only to act as catalysts rather than actually be a treatment medium. BOD removal ranges between 75-90% efficiency on the other hand pathogen removal efficiency is over 95%. The operation and maintenance of the system are simple and spatial requirements for construction are compensated through beautifying landscapes.

2.6.2.6 Sludge Drying Bed (SDB)

This unit is designed for storage and drying of dislodged sludge after 3-6 months from the Biogas Settler, the sludge drying is mainly by using solar energy which kills pathogens. Sludge can then be used as compost in agricultural fields to grow various crops especially bananas.

2.7 Sludge loading intensity

There is a wide range of sludge loadings and intervals of reed beds according to previous researches, when operated with septage and pit latrine sludge. Maximal sludge loading rate of 250kg DM per m² and per years are recommended for septage, meaning sludge from septic tanks have a fairly good degree of stabilization. For this project with a mixture of sludge coming from septic tanks and lined and un-lined pit latrines the receiving sludge is considered as partly anaerobic.

2.8 Proposed Processing steps

The treatment process of the proposed facility follows the cross-section flow diagram in figure 5 from the influents to the effluent.



Figure 5: The Fecal Sludge Treatment Facility cross-section diagram

3.0 POLICIES, LEGISLATION AND INSTITUTIONAL ASPECT

According to the fundamental principles of environment, any developmental activities of this nature such as construction of Faecal Sludge Treatment Plant would have socio-economic and somehow environmental impacts that must be addressed and governed in order to serve public interest and sustainable development. Given the many existing and developing environmental laws, regulations and standards in Tanzania, it is worth considering resorting to constitutional provisions to protect and manage the environment. With increasing environmental awareness in recent decades, the environment has become a higher political priority and many constitutions now expressly guarantee a 'right to a healthy environment', as well as the procedural rights necessary to implement and enforce the substantive rights granted. The public or national interest in this aspect is addressed through government Policies and regulated by Principal Acts and Regulations. The implementation of the proposed project shall touch various sectors; therefore, the developer has to comply with number of cross-sectorial policies and legislations relevant to this project. Also, the listed institutions involved in environmental management for the project is included in this chapter.

3.1 RELEVANT POLICIES

This section focuses on various policies which guide the development aspects for sustainable vision, apart from the national environmental policy, there are numbers of sector policies that are to be reviewed when executing the proposed development and these include;

3.1.1 National Environment Policy 2021

Environmental awareness in the country has significantly increased in recent years. The government has been developing and reviewing national policies to address environmental management in various sectors. Among others, the objective of these policies is to regulate the development undertaken within respective sectors so that they are not undertaken at the expense of the

environment. The national policies that address environmental management as far as this project is concerned and which form the cornerstone of the present study include the following:

3.4.1 National Environmental Policy (NEP, 2021)

The National Environmental Policy of 2021 has just been launched in February 2021. The new policy formulation is a revision of the National Environmental Policy of 1997. The Policy serves as a national framework for planning and sustainable management of the environment in a coordinated, holistic and adaptive approach taking into consideration the prevailing and emerging environmental challenges as well as national and international development issues. Effective implementation of this policy requires mainstreaming of environmental issues at all levels, strengthening institutional governance, and public participation in environmental management regimes. The long-term vision of this policy is geared towards the realization of environmental integrity, assurance of food security, poverty alleviation, and increased contribution of the environmental resources to the national economy. It also recommends strong institutional and governance measures to support the achievement of the desired objectives and goals.

The policy seeks to promote the economy and livelihoods of people while promoting sustainable utilization of natural resources in the country. The policy provides the framework for the formulation of plans, programs, and guidelines for the achievement of sustainable development.

The policy's overall objective is to provide a national framework for guiding harmonized and coordinated environmental management for the improvement of the welfare of present and future generations. The specific objectives are i) to strengthen coordination of environmental management in sectors at all levels; ii) to enhance environmentally sound management of land resources for socioeconomic development; iii) to promote environmental management of water sources; iv) to strengthen conservation of wildlife habitats and biodiversity; v) to enhance conservation of forest ecosystems for sustainable provision of environmental goods and services; vi) to manage pollution for the safe and healthy environment; vii) to strengthen the national capacity for

addressing climate change impacts; viii) to enhance conservation of aquatic system for the sustained natural ecosystem; ix) to ensure safety at all levels of application of modern biotechnology; x) to promote gender consideration in environmental management; xi) to promote good governance in environmental management at all levels; and xii) to ensure predictable, accessible, adequate and sustainable financial resources for environmental management.

3.1.2 National Land Policy of 1997

The National Land Policy states that “the overall aim of a National Land Policy is to promote and ensure a secure land tenure system, to encourage the optimal use of land resources, and to facilitate broad-based social and economic development without upsetting or endangering the ecological balance of the environment”. This study partly responds to this requirement.

3.1.3 Construction Industry Policy (2003)

Among the major objectives of the policy, which supports a sustainable building development sector, include the promotion and application of cost effective and innovative technologies and practices to support socio-economic development activities such as sanitation, water supply, buildings, road-works, shelter delivery and income generating activities and to ensure application of practices, technologies and products which are not harmful to either the environment or human health. Proposed project is in-line with this policy as ultra-modern technology is used during construction and its operation.

3.1.4 National Health Policy (2003)

The health Policy is a vital guide towards health development of any country. It is particularly, important in a country like ours where resources and technology are more limited than in other countries, which are relatively better off in both technology and resources. This Policy is a revision of the 1990 Health Policy, which emphasized on the need for increasing community

involvement in health development and improved access and equity in health and health services.

The Policy recognizes the challenges of consolidating the principles of the previous health policy in community involvement, improved health services provision, access and equity while addressing the different dimensions of reforms that are taking place in the Public Sector.

The proposed project will adhere to policy requirements to ensure no transmission of such communicable diseases between construction workers and the community, protect workers from all sorts of health risks and hazards; and provide adequate sanitation services within the project and ensure that its activities are not a source of health issues.

3.1.5 National Gender Policy of 2000

The overall objective of the Gender and Development Policy is to promote gender equality and equal participation of men and women through facilitation of access to education, child care, and employment and decision making. Also, this policy is to provide guidelines that will ensure that gender-sensitive plans and strategies are developed in all sectors and institutions. While the policy aims at establishing strategies to eradicate poverty, it emphasizes gender quality and equal opportunity of both men and women to participate in development undertakings and to value the role played by each member of society. The proposed project will adhere the requirements addressed under this policy.

3.1.6 National Human Settlements Development Policy (2018)

Among the objectives of this policy is to improve the level of the provision of infrastructure and social services for the development of sustainable human settlements and to make serviced land available for shelter to all sections of the community. Such infrastructure and services constitute the backbone of urban/rural economic activities. Fecal Sludge Treatment Plant (FSTP) is one among of the important infrastructure for the Mkwajuni community and country at large

3.2 PRINCIPAL LEGISLATIONS AND REGULATIONS

The ESIA team reviewed several legislations relevant to the construction of Fecal Sludge Treatment Plant. These encompass Principal Acts that support and provide guidelines to implement the intended project as discussed below.

3.2.1 Environmental Management Act (2004)

Among the major purposes of the EMA are to provide the legal and institutional framework for sustainable management of the environment in Tanzania; to outline principles for management, impact and risk assessment, the prevention and control of pollution, waste management, environmental quality standards, public participation, compliance, and enforcement; to provide the basis for the implementation of international instruments on the environment; to provide for the implementation of the National Environmental Policy; to provide for the establishment of the National Environmental Fund and to provide for other related matters.

Part III, Section 15(a) states that "*in matters about the environment, the Director of Environment shall coordinate various environment management activities being undertaken by other agencies to promote the integration of environmental considerations into development policies, plans, programs, strategies projects and undertake strategic environmental assessments to ensure the proper management and rational utilization of environmental resources on a sustainable basis for the improvement of the quality of human life in Tanzania*".

Part X of the law deals with Environmental Quality Standards. Section 140 of this act states that "*The National Environmental Standards Committee of the Tanzania Bureau of Standards established under the Tanzania Bureau of Standards Act, 1975 shall develop, review and submit to the Minister proposal for environmental standards and criteria concerning; water quality; discharge of*

effluent into the water; air quality; control of noise and vibration pollution; sub-sonic vibrations; soil quality, control of noxious smells; light pollution; and any other environmental quality standard” Some of these standards have already been published in the government *gazette* while others are not in place. This project shall take into account all the standards specified by this act.

3.2.2 The Environmental Management (Fees and Charges) Regulations, 2021

These Regulations shall apply in relation to an act or service in respect of which fees and charges are payable under the Act and Regulations made thereunder. The regulations emphasize that “a person shall not, upon payment of fees and charges prescribed in the Schedule to these Regulations, carry on any of the following”:

- Environmental Impact Assessment;
- Environmental Compliance Monitoring and Audit;
- Registration of Environmental Experts;
- Environmental Quality Standards;
- Noise and Vibrations; or
- other activities related to the environment

This project complies with the regulations since the proponent has already paid registration fees and review charges as directed by NEMC.

3.2.3 The Environmental Management (Control of hazardous Waste) regulations, 2021

The objective of these regulations is to protect the environment and human health by preventing or reducing the generation of Hazardous waste, the adverse impacts of the generation and management of hazardous waste and by reducing overall impacts of resource use and improving the efficiency of such use, which are crucial for the transition to a circular economy. The regulation requires that “any person generating, collecting, storing, transporting, treating, recycling, reusing, recovering and disposing of

hazardous waste or any person exercising jurisdiction under these Regulations shall, assure that there are no adverse impacts to be generated or caused by the activity conducted. Project developer will comply with the requirements of this regulation by reducing the construction materials which may generate hazardous impacts, as well as proper handling of such waste such as in use of fuels for various purposes etc.

3.2.4 The Environmental Management (Control of Noise and vibration) regulations, 2015

The regulations focus on the maintenance of a healthy environment for all the people in Mainland Tanzania, the tranquility of their surrounding and their psychological well-being by regulating noise and vibration levels to prescribe the maximum permissible noise and vibration levels from a facility or activity to which a person may be exposed. The project developer will make sure that all the guidelines under this policy will be considered to ensure the healthy environment to everyone.

3.2.5 The Environmental Management (Prohibition of Plastic Carrier bags) regulations, 2019

Regulations are meant to impose a total ban on the import, export, manufacturing, sale, and use of plastic carrier bags regardless of their thickness. Plastic carrier bags has a wide definition in the Regulations, as a bag made of plastic film, with or without handles, or gussets and to which its layer is in any thickness. The Regulations also categorically state that no person shall sell or offer for sale beverages or other commodities wrapped in plastics unless the nature of such commodities require wrappings by plastics, and restricts any licensing authority from issuing any licenses after the Regulations come into force. Project developer will make sure that there will be no use of plastic bags within the project site and the whole project life time, also in case of the need of carrier bags the proponent will make sure that there will be an alternative bags which are allowed by the regulations. For the commodities that are

wrapped in plastic, then the proponent will make sure that such plastic will be handled properly.

3.2.6 The Environmental Management (Solid Waste Management) regulations, 2007

The solid waste management regulation of 2007, provides general directive on management of solid waste as follows: -

Regulation detail the requirements and responsibilities for managing solid waste in Tanzania

Highlight waste minimization and cleaner production principles alongside the duty to safeguard the public health and the environment from adverse effects of solid waste. Detail permitting requirements, notably that any person dealing with solid waste as collector, transporter, waste depositor or manager of a transfer station will apply to the LGA for a permit. The local authority will also issue licenses to individuals or companies qualified to operate solid waste disposal sites; permit is required to operate an LGA waste disposal site. The proposed project is expected to generate solid waste in construction phase. Therefore, to comply with this regulation the Project developer will engage the registered solid waste collection contractor.

3.2.7 The Environmental Management (Water Quality) regulations, 2009

Regulations provide for institutional and legal framework for sustainable management and development of water resources; to outline principles for water resources management; to provide for the prevention and control of water pollution; to provide for participation of stakeholders and the general public in implementation of the National Water Policy. These regulations require the sustainable management of water sources and proper use of the available sources without causing any damage towards such sources. Also, the regulations emphasize that it is every one's responsibility to conserve and preserve the available water sources in Tanzania. During all phases of the project there will be water demand, hence the project developer will make sure that there will be a sustainable use of water. Also during construction and

maintenance phase the developer will make sure that the water supply pipes will not be damaged in either ways

3.2.8 The Environmental Management (Air Quality) regulations, 2009

The Regulations were formed in order to: -

- Prohibit emissions and releases of hazardous substances into the environment
- Prescribe permissible emission limits and quantities of emissions of sulphur oxide, carbon monoxide, black smoke and suspended particulate matters, nitrogen oxide, ozone, hydrocarbons, dust and lead
- Empower NEMC to issue air pollutant emission permits, enforce compliance, undertake emergency prevention and issue stop orders
- Set baseline parameters on air quality and emissions based on a number of practical considerations and acceptable limits and ensure protection of human health and the environment from various sources of pollution.

The proposed project will adhere the requirements of this Act, emission limits will be monitored to the permissible limits.

3.2.9 The Environmental Management (Soil Quality) regulations, 2009

These Regulations, made by the Minister of State under sections 143, 144 and 230 of the Environmental Management Act, concern soil pollution and soil quality standards and provide with respect to a soil protection permit and compliance system. They also concern measures of enforcement. The object of these Regulations is to

- Set limits for soil contaminants in agriculture and habitat;
- Enforce minimum soil quality standards prescribed by the National Environmental Standards Committee.

Also, the regulations require that, the contaminants of volatile organic compounds in habitat and agricultural soils shall comply with parameters and upper limits as prescribed and contaminants of heavy metals in habitat; agricultural soils shall comply with parameters and upper limits as prescribed

and contaminants of pesticides in habitat and agricultural soils shall comply with parameters and upper limits as prescribed. Local government authority may prescribe special or specific measures and guidelines for soil conservation applicable to their respective areas of jurisdictions which are not below standards prescribed under these Regulations. The Project developer will comply with the requirements made under these regulations.

3.2.10 Occupational Health and Safety Act 2003

The provisions of this law require employers to provide decent working environment to employees to guarantee their health and safety. Occupational health and safety services are important for sustainable development of a country, as they reduce occupational accidents and diseases which can have huge economic burden to individuals, enterprises and the nation as whole. Improving health and safety of workers will significantly increase productivity at the workplaces to encourage more investments, increase job creation, higher morale, and job satisfaction hence industrial harmony. The law also entails employers to fulfil obligations of ensuring safety of the equipment's used by workers and providing proper safety gears as required.

3.2.11 The Water Supply and Sanitation Act No. 12 of 2009

This is also a new legislation that provides for sustainable management and adequate operation and transparent regulation of water supply and sanitation services; provides for establishment of water supply and sanitation authorities as well as community owned water supply organizations; and provides for appointment for service providers. The main aim of this law is to ensure the right of every Tanzanian to have access to efficient, effective and sustainable water supply and sanitation services for all purposes by taking into account among others protection and conservation of water resources and development and promotion of public health and sanitation; and protection of the interest of customers. Under this law, the Minister responsible for water affairs shall establish water authority and cluster water authorities in order to achieve commercial viabilities.

3.12 Engineers Registration Act and its Amendments 1997 and 2007

The Acts regulate the engineering practice in Tanzania by registering engineers and monitoring their conduct. It establishes the Engineering Registration Board (ERB), the law requires any local or foreigner engineer to register with ERB before practicing in the country. Project developer will continue to comply as it has utilized the services of registered engineering firm for its structural designs which it will continue to use to supervise the construction process.

3.2.13 The Contractors Registration (Amendment) Act, 2008

The Contractors Registration Act requires contractors to be registered by the Contractors Board (CRB) before engaging in practice. It requires foreign contractors to be registered by the Board before gaining contracts in Tanzania. Project Developer shall comply with the law requirement during the recruitment of contractors for project implementation.

3.2.14 The Architects and Quantity Surveyors Act (1997)

The Act requires Architects and Quantity Surveyors to be involved in the project to be registered by the Architects and Quantity Surveyor Board (AQSB) before engaging in practice. It also requires foreign contractors to be registered by the Board before gaining contracts in Tanzania. Project Developer has complied with the law requirement during the recruitment of architects who have designed the project and will continue to utilize registered persons in the project implementation.

3.2.15 The Urban Planning Act (2007)

The law provides for the orderly and sustainable development of land in urban areas, to preserve and improve amenities; to provide for the grant of consent to develop land and powers of control over the use of land and to provide for

other related matters. Under Section 3, among others the law seeks to improve level of the provision of infrastructure and social services for sustainable human settlement development. This act established planning authorities which include the city, municipal, town and township councils in the country which have responsibilities including:

- Secure the orderly and environmentally sustainable development of area under its jurisdiction;
- Prepare general and detailed planning schemes;
- Control building densities and access to buildings;
- Recommending approval of building schemes and subdivision of plots by developers;
- Secure cooperation of all agencies, utility bodies, land owners and other bodies and institutions involved in the preparation and implementation of planning process;

3.2.16 Public Health Act (2009)

Provide for the promotion, preservation, maintenance of public health with a view to ensuring the provisions of comprehensive, functional and sustainable public health services to the general public. Part III (e) of the act requires premises owners to keep their premises free of mosquitoes and other disease vectors, vermin or causative agents; Section 54 prohibits causing or suffering from nuisance likely to be injurious or dangerous to health, land, premises, air or water; Part IV (c) assigns responsibility to City council to remove or appoint an agent to collect, transport and dispose solid and liquid waste and charge fees to beneficiaries of this service and responsibilities for prescribing types of wastes and guidelines for their collection and disposal; Section 101 it gives rights to any private sewer to connect it to any available public sewer to discharge foul or storm water therefore the project may connect to and discharge sewage or storm water into the available trunk main. However, the quality of the sewage should be as per agreed with the water authority.

The Contracting Authority will ensure that the project design, construction and operation does not constitute a nuisance; meets the requirements meets public health requirements

3.2.17 World Bank guidelines for Environmental Management

The main objective of this EMP is to establish a set of mitigation and monitoring measures to minimize the adverse social and environmental impacts that can take place during the implementation stage of the subproject. The measures especially focus on sensitive receptors or sensitive locations. The EMP also provides specific information about the monitoring program during construction stage including locations, frequency and reporting process. This project complies with these guidelines as it has ESMP which contains mitigation and monitoring plans of the identified impacts.

4.0 BASELINE INFORMATION

4.1 INTRODUCTION

This section provides baseline data on the relevant environmental characteristics of the project area. Much of the description of the environment is site specific. Other aspects such as that of climate and socio-economic issues are broad covering the whole Kigamboni municipal Council. The Consultant relied on primary data as collected from the site as well as secondary data and information gleaned from the literature for the project area.

4.2 Climatic Condition

The climatic condition of Kigamboni is tropical with high temperatures, modest winds, high humidity and absence of a cold season. The temperature of Kigamboni District ranges from a minimum of 18oC in July to a maximum of 32oC in February. The mean annual temperature is 26oC with a mean daily range of ± 4 oC. Seasonal variations are slight with the mean seasonal range being ± 4 oC. The humidity of air is related to the rainfall pattern and is higher during the long rains. Daily maximum humidity occurs at dawn, averaging 96 percent while minimum humidity is experienced in the afternoons, averaging 67 percent. Municipality receives moderate rainfall from November to December, and heavy rainfall between March and May. Rainfall patterns are however, extremely variable and unpredictable. The rainfall ranges over 1000 mm per year, and the temperature ranges from 18 to 32 centigrade. The peak temperatures occur during September/October and January/February prior to the onset of the rainy season; normally rains cease in early of June and the winds blow from east to west most of the year.

The micro climate in the Planning Area is highly influenced by monsoon winds. The wind system of the area is typical of the wind regime of the Western Indian Ocean, which is characterized by the south-easterly winds (SE monsoons) during the months of June to October, and the north-easterly winds (NE monsoons) from November to March. Winds in the region are quite weak, with a range of 1.4m/s to 7.8m/s. The SSE and SE monsoons are usually strong, the peak speeds occur in April and July. The northern monsoons are lighter and

peak speed occurs in February. This wind system is coupled with an almost complete clockwise current system that changes character with the changing wind.

4.2.1 Lowland

The land is found along flood plains of Migombani areas in the Municipality. The land is suitable for urban agricultural activities including gardening. However, the area is characterized by unplanned settlements which are prone to flash flooding. Southern low land parts of Kisarawe II, Amani Gomvu, Kimbiji and Chekeni Mwasonga. Most of the area is covered by sandy soil. The main natural vegetation is characterized by Coastal shrubs, Miombo woodland, Coastal swamps and mangrove trees.

4.2.2 Topography

Similar to many other parts of Dar es Salaam Region, Kigamboni terrain is undulating. It ranges from flat to gently undulating plains, developed on old alluvial terrace. The terrain rises from the sea level in wards along the shore line to a maximum of 120 m above mean sea level in few areas of Kisarawe II and Vijibweni wards. The large part of Kigamboni has elevation between 20m to 50m, in areas such as Kimbiji Ward. The low lying areas range between 1m to 25m in Mkwajuni, Kigamboni, Tungi, Mjimwema, Somangira and Pembamnazi wards.

4.2.3 Geology and Soil

Kigamboni is covered by geological formations of Neogene, Quaternary and Recent deposits. The Neogene sediments consist of interblended sandy clay and clayey sand with places of pure sand, clay and limestone. The soil cover is predominantly sandy clay intercalated with weathered limestone. However, existing drill information suggest the underneath geology to be dominated with calcareous sand, sandy clay intercalated with limestone.

4.3 Population Characteristics

According to the Population and Housing Census of the year 2012 the Council had a total population of 162,932 where 81,199 were males and females were 81,733. The population projection for the year 2018 is 225,938 where males are 112,597 and females are 113,341 at 5.4% annual growth rate. Kigamboni, Vijibweni and Mjimwema wards have relatively large population sizes compared to other wards. Kisarawe II has the least population compared to other wards. According to 2019 population projections, Kigamboni Municipal is expected to have a total population of 238,591 with 118,905 males and 119,686 females.

4.3.1 Population Composition and Distribution

A population's composition may be described in terms of basic demographic features such as age, sex, family and household status and by features of the population's social and economic context, education, occupation, ethnicity, religion, income and wealth.

4.4 Social economic services

4.4.1 Energy

Kigamboni Municipality is connected to the National Grid with supplied capacity of 17MW against a peak demand of 18 to 20MW. About 56% of surveyed households were connected to TANESCO's electricity network. The remaining 44% are dependent on solar and generators as alternative sources of energy. The existing number of customers is 32,735 with 42 major customers and 32,687 minor ones.

Findings from the most recent survey indicate that Kigamboni, Mjimwema, and Vijibweni wards have many households connected to the national grid (TANESCO). This is mainly due to the fact that these wards accommodate the majority inhabitants in Kigamboni Municipality. On the contrary, Pembamnazi, Kimbiji and Somangila wards have fewer connections. These are sparsely populated and located far from the city. Therefore, long distance combined with

low demand appears to be the main factors behind the observed low connection rate.

The demand for electricity in Kigamboni Municipality is growing very fast due to a rapid population growth hence, increasing the number of households as well as the number of large, medium and small scale industries. Since our Country is promoting an Industrial Economy, KGMC is the only district in the City of Dar es Salaam with large virgin areas for industrial establishment and construction of major residential apartments. Meeting with the expected demand of electricity from these industries and households at large, management of TANESCO Kigamboni in collaboration with the Ministry of Energy and Mining is implementing a project for constructing a large electricity production plant at Dege area with capacity of providing 48MW per day. This project will have a special feeder for industrial purposes and investment activities.

4.4.2 Health Sector

Health Sector entails its administrative structure, availability of resources, and provision of services, performance and dynamics. Service provision or delivery is an immediate output of the inputs into the health system, such as workforce, procurement and supplies and finances. Hence increased inputs should lead to improved service delivery and enhanced access to services so ensuring availability and access to health services.

4.4.3 Health Facilities

Health facilities include hospitals, Health Centers and Dispensaries plus other places where health workers provide health services to the community.

In Kigamboni there is only one hospital that operates in the Municipal which is publicly owned and located at Vijibweni, 4 health centers, 3 of them are owned by the Government, 34 dispensaries are operating in the Municipal, 19 of them are publicly owned and 15 owned by Private Sector. The findings suggest that

the purposive effort is required to either build health centers or increase number of dispensaries in Kigamboni Municipality. Similarly private health facilities need to be increased in the council because they serve the community effectively. The table on the next page shows the availability of Kigamboni Health Facilities by Ownership and Ward

4.4.4 Education Sector

The Education and Training Policy of 2014 expanded compulsory basic education in Tanzania to include one year of pre-primary, six years of primary and four years of secondary education. Advanced secondary education and tertiary education remain optional and are not included in the programme for free basic education. Under the new policy, children are required to start education between the age of four and six (UNICEF, 2018). Therefore, in Tanzania education sector covers Pre – Primary, Primary, Secondary, Vocational Educational Education and Colleges/ Universities.

4.4.5 Water Supply and Sanitation

The average water demand consumption in Kigamboni Municipality is 17.4 m³ Million per day (80 litres per person a day). On average, water wells owned by the government have the capacity of producing 8.89m³ million per day equivalent to 51.1%. The remaining population is served by privately owned wells, water vendors, and water boozers. The Municipal has a total of 88 deep wells, among them 27 wells are for public use, 61 are owned by government institutions (35- primary schools, 9-secondary schools, 17-dispensaries).

The municipal Council has strategies to ensure that the challenges are solved to meet the country`s water distribution and availability to all people at least 95% in 2020. However through water sector and sanitation programme, the Municipal Council continues with construction of new water infrastructures at Malimba Street-Somangila Ward, Chambewe Street-Pembamazi Ward and Kibene Street, Vijibweni Ward. These three projects when completed will have the capacity to serve 8,144 people (4,644 people from Kibene Street, 2,518

people from Malimba – Street and 982 people from Chambewa Street) which is equivalent to increase of 3.7% of Kigamboni Municipality residents.

Furthermore, the Municipal Council with the aid from DAWASA is implementing an off grid and Sanitation water Project financed by the World Bank. The project is aimed at extending in areas where DAWASA hasn't yet covered. The Council has suggested 10 projects that have the capacity to serve 35,250 people which is equivalent to 16.2 % of all people living in Kigamboni. Also DAWASA is implementing water distribution scheme from Ruvu Juu water source whereby the water service from Ruvu is now made available at Mwalimu Nyerere Memorial Academy, TPDC housing and Navy.

4.4.6 Sanitation and Hygiene Services

For ensuring good health and a favorable living environment in any community, sanitation facilities are essential. Total number of households with toilets vary by wards. The households with toilets ranged from 1,282 to 3,182 households.

The number of households with improved toilets ranged from 562 in Pembamazi to 3,484 in Somangila. Results shows that, the highest number of households without improved toilets (1,849) was in Somangila ward

According to the available data 1.4% of Kigamboni residents are connected to the central sewerage system, the remaining majority manage waste onsite through either pit latrines or WC systems. The MoHCDGEC (2017) reports that majority of residents in Kigamboni Municipal use pit latrines to manage their waste water or sewage. The report was in consistent with congruent to findings from household surveys which indicated that about half of the households [15,851(48.07%)] in the Municipality use pour flush latrines which include septic tank and soak away pit.

On-site sanitation system entails disposal of effluent typically within or near the household. This is regarded as the most common type of sanitation system among developing societies and particularly Sub-Saharan Africa

4.4.7 Waste Water Management

Management of liquid waste in Kigamboni Municipal is one of the responsibilities of DAWASA, which is also regulated by EWURA. In the meantime, DAWASA manages less than 1.5% of waste water produced in Kigamboni. Individuals have been engaged in waste water management using methods which are eventually hazardous to the environment leading to wide spread underground water pollution.

Solid Waste Management

Kigamboni Municipality generates 210 tonnes of solid waste per day which is composed of plastic, organic waste and scraps. These wastes are generated from industries, commercial areas, institutions and households. Household Survey, 2018 indicated that more than 80% of waste generated from households is organic waste. Most of solid waste produced according to 64% of surveyed households was reportedly dumped on-site i.e. within household premises. The remaining 36 % noted that they dispose waste off-site that is away from household premises.

The current solid waste management practices in Kigamboni Municipal involve open dumping, collection and disposal where 55% of households dump their waste onsite while 45% collect them and dispose elsewhere. About 44% of households handle the waste at the household level by collecting and storing those using available facilities such as bags, buckets, bins and others which later are collected by private companies contracted by the Municipal to collect waste at an average cost of Tzs. 3000 per month. The Municipal has no trucks for collection and disposal of solid waste, but it has contracted private companies in five urban wards, namely Kigamboni, Tungi, Vijibweni, Mjimwema and Vijibweni. The remaining wards dispose their solid waste onsite or hire local waste collectors to dispose them elsewhere at the cost of Tzs. 1000 - 2000 per bag. KGMC had an area delineated as transfer site at Muungano Street specifically for collection of solid waste and subsequently transfer of the wastes to Pugu Kinyamwezi dump site. Unfortunately, the area was turned into a dumping site and thereafter, the Municipal prohibited the disposal of waste at Muungano transfer site. In addition, illegal dumping has been practised in other areas in Kigamboni Municipal including Chamgoi-Dege (Somangila), along

Nguwa River, and Bwafuru-Kizito Huonjwa (Kimbiji). This is due to lack of a proper place designated for solid waste disposal.

4.4.8 Water Table and water quality analysis

Groundwater is abundant in almost the entire Dar es salaam City. This is evidenced by the fact that shallow wells are one of the sources of domestic water supply for most of the households around the project site and therefore the water table is high.

Data for Water quality from shallow wells close to the project site were as presented in figure 4-1 and 4-1. However, the engineering design of the facility has taken on board all factors to ensure no contamination of groundwater is likely to occur.



Figure 4.1 Water quality test results (*Source Design Report 2021*)





Figure 4.2 Water quality test results (*Source Design Report 2021*)

4.4.9 Air quality

The air quality observations indicate that the general air quality in the project area is good as there is no strange activity contributing to air pollution. However, seasonal variation, as well as localized and temporal deterioration in air quality, do occur. Smokes and greenhouse gases such as carbon dioxide, carbon

monoxide are expected to be emitted from moving vehicles due to the burning of fossil fuels that passes at Vijibweni road and other street roads closer to the project area. During the construction phase, the air quality of the area will be impacted and the proponent will be advised to use good quality material vehicles.

4.4.10 Noise levels

The noise level at the project area is mainly due to moving vehicles along the road, moving air (wind) or rain, and birds. Project activities during construction will change patterns and amplitude of noise in the project area. Operations of construction machines may cause adverse impacts on residents, and workers. The proponent has to ensure proper provision of ear masks to the workers and all works have to be executed during the daytime.

5.0 STAKEHOLDER VIEW ON THE PROPOSED PROJECT

During the conduction of this study, different stakeholders were consulted. Among these include the Kigamboni Municipal Council and the community at Ferry bus stand (see Figure 6). Consultations were made through meetings.



Figure 6: Stakeholder's consultation meeting at Kigamboni Municipal Council office

During the meeting, the consultant gave a brief explanation of the proposed faecal sludge treatment Plant. The project description covered the proposed location, type, and design of the plant (a typical design was displayed). The stakeholders were given chance to give their views on the project. Moreover, the consultant offered the chance to clarify issues where stakeholders wanted to be given more explanations. The comments by stakeholders were analyzed and incorporated in the design of mitigation measures. Table 2 summarizes the issues raised. The names of the stakeholders consulted are given in Appendix I while minutes of meetings conducted are given in appendix IV.

Table 2: Stakeholders issues and concerns

Institution	Name	Position	Issues/ concerns	Response
KIGAMBONI MUNICIPAL COUNCIL	Arch. Ng'wilabuzu N. Ludigija	Municipal Director, MD	-The design and ESIA studies should complete a time to pave way for Construction activities -The Local community should be Sensitized to the benefits of the proposed facilities	Section 7.3.2.1 Table 3
KIGAMBONI MUNICIPAL COUNCIL	Bachi Shayo	Ag. DMO	-The implementation of the project will enhance the development -The technology is good since it occupies a small piece of land as compared to WSP	Section 5.1 Section 6.2.1
KIGAMBONI MUNICIPAL COUNCIL	Rajab Gundumu	Estate Manager	-The location of Municipal Director's office is expected to have several facilities like; Police station, Bus stand, Health Center. It is taken as the Centre of the Municipal	
KIGAMBONI MUNICIPAL COUNCIL	Veronica J Kiluvia	Ag. MCDO	-Wanted to know why the proposed sites and not other places?	Section 5.1
KIGAMBONI MUNICIPAL COUNCIL	Wenceslaus Lindi	MAHRO	-Due to the Centeredness of the Municipal Simplified Sewerage System should be put in place	Section 5.1

6.0 PROJECT REQUIREMENTS AND WASTE GENERATION

6.1 Project requirements

6.1.1 Construction materials and labour force

The main materials for Faecal Sludge Treatment Plant include cement, aggregates (stones), water, steel, sand, timbers, blocks, uPVC pipes, IPS Pipes and gravels. All materials are available in the local sources in Tanzania. The estimated quantities of the materials to be included in the BoQ.

In addition to that, material such as stone and gravels can be acquired from registered dealers such as M/S Even Enterprises Company Limited who has a license to mine at Lugoba area in Bagamoyo District, Appendix VI.

6.1.2 Labour force

The labour force will be determined by the Contractor; nevertheless, it is projected that during the construction phase the project will require not less than 50 workers both skilled and non-skilled laborers for each phase of project construction.

6.1.3 Machinery and Equipment

The proposed project development will employ various standard construction equipment and machinery. Equipment expected to be used during the construction works are Excavators, Tippers, Concrete Mixers, poker vibrators, Wheel barrow, Compactor, etc. All equipment and machineries for construction works needed by the proposed project will be determined when the bill of quantities (BoQ) and selection of Contractor is finalized. These equipments shall be temporary and shall be demobilized once project is completed.

6.2 Wastes generation

The major wastes generation associated with the project are spoil soils resulting from earthworks during the foundation excavations, solid wastes and liquid waste. The spoil soil shall be stock piled around the public toilet for further use in landscaping the site at the end of the project.

6.2.1 Liquid waste management

A total of 120m³ per day of liquid waste is estimated to be received at the receiving chamber of the proposed facility during the maximum operation phase. The project operations will conform to the National Effluent Standard of Tanzania with regard to waste water produced by the plant. After the treatment process is done, the effluent which is rich in nutrients is expected to cater for irrigation taking the advantage of the ongoing agriculture fields adjacent to the project site. However, in case the nutritious effluent will not be used for irrigation, there is a possibility of discharging direct to the river within the marsh which drains to Indian Ocean.

6.2.2 Solid waste management

About 0.5-1 tonnes per month of domestic refuse and other solid wastes is estimated to be generated and trapped at the garbage screen during the project construction and operation phase respectively. A well-established solid waste collection system will be instituted. The system will involve among other things wastes segregation at source, recycling or reuse of some wastes and final disposal to the approved city/municipal dumpsite.

The project management team will provide waste bins and recycling receptacles of different type to enable sorting. Compostable materials will be sent direct to the city dumpsite area. Table 3 below shows solid and liquid waste wastes to be generated by the project and the methods of their disposal.

Table 3: Management of construction and operation wastes

Solid waste			
Type of waste	Sources	Estimated Quantity (Kg)	Disposal / Management procedure
Debris and Rubble (overburden)	Site clearance	3,000-5,000	Fill material for road potholes, etc.
Biodegradable materials mainly domestic waste (food, paper, wood etc.)	- Construction crew	(50-100Kg) per Month	Accessible litter bins within the camp site and later to the city waste disposal system (engage a registered private

			company), Final disposal will be at Municipal dumpsite
Non-biodegradable materials (plastic, glass)	- Construction crew	(2-5) kg per day	Recycling/ reuse (Plastics to be sent to authorised plastic recyclers and glass bottles and scrape to be sent to the recyclers)
Hazardous waste, Scrap metals	- Worn out Machinery parts and other metal cuttings	(10-15) per day	Sold to authorised Scrap metal and waste oil dealers respectively
Liquid waste			
Type of waste	Sources	Estimated Quantity (m³) per day	Disposal / Management procedure
- Excreta (domestic) human - Grey water /cleaners	- Toilets and floor cleaning	1.6	Use of septic tanks and when full will empty to the wastewater treatment facility ie Toangoma FSTP
- Oils and greases	Machinery parts and trucks	- None	- Car maintenance will be done at proper garages

7.0 POTENTIAL IMPACTS

7.1 Positive impacts

7.1.1 Improved living conditions and economic growth

The project will improve the living conditions in Kigamboni Municipal whereby the project operation phase will do away with illegal faecal sludge dislodging especially

during rainy season or during the night. The charged fee for emptying septic tanks and pit latrines will be such as affordable by the intended customer. Thus, there will be increased money circulation that result into increased income consequently better standard of living of people in the project area.

7.1.2 Employment opportunities

Labour force for the project will be originated from Vijibweni ward and the surrounding communities in Kigamboni areas. Even though during construction the employment will be on short term basis, employees will have been benefiting from the project. Some will witness their incomes and livelihood improvement.

7.1.3 Improved urban agriculture

Farming activities in urbanised Kigamboni is vital to the economy of the local community. With the effluent rich in nutrients and manure from dried sludge the farming activities will have been moved to the high production level. That is to say, farming activities especially of bananas will be going on despite the driest months of June, July and August.

7.1.4 Increased socio-cultural interaction

Increased socio-cultural interaction is another anticipated positive impact. The implementation of the project will bring many people from different cultural backgrounds. The interactions may bring about social changes in the communities around the project areas. Interaction with technocrats as a result of new immigrants (customers) into the area will stimulate adoption of the new technologies.

7.1.5 Increased Revenue to the nation through taxes, both direct and indirect

DAWASA is expected to increase government revenue collection at Municipal Council and at National level. This will be enhanced by time to time payment of all charges to dislodge septic tanks and pit latrines of the respective household. The revenue collected will contribute towards economic development within the municipal and the country at large.

7.1.6 Biogas production potential

Among other positive impacts gas production for domestic uses is anticipated to serve the local communities and institutions. In this case, the Kigamboni Hospital which is in proximity to the project site will be the immediate beneficiary of the produced biogas.

7.1.7 Minimized Forest products harvesting

Source of energy for cooking in most of the households originates from the forest products. Charcoal and firewood are the most commonly used for domestic purposes. The biogas production from the plant will minimize the use of forest products as to why the gas will be available to the local community. However, the quantity of the biogas produced depends on the quality of influent to the facility.

7.1.8 Cost reduction for sewage management

The proposed facility will make it easier for the Institutions and households which at present incur unbearable costs for proper dislodging the septic tanks when full. That simply means the households in the vicinity and the institutions will benefit through direct connection to the treatment facility depending on the nature of topography.

7.2 Negative impacts

7.2.1 Increased HIV/AIDS and other sexual related diseases:

Local communities surrounding the project area have to be aware of the fact that HIV/AIDS is present in their areas but accede to it not being at an alarming rate. The communities were worried that with an influx of people into the project area the pace of spread will accelerate especially during the construction phase.

Mitigation Measures

- Contractor shall enforce a code of conduct in the project area to encourage respect for the local community and to maintain self-cleanliness of the working area at all times.
- The contractor shall deploy locally available labour to reduce risk of spreading communicable diseases (especially STDs).

- In order to prevent more HIV/AIDS infection, during the implementation phase, the project should include information education and communication component (IEC) in its budget. This will help to raise more awareness on HIV/AIDS, and means to suppress its incidence.
- A safety, health and environment induction course shall be conducted to all workers, putting more emphasis on HIV/AIDS, which has become a national disaster.

7.2.2 Loss of biodiversity

Loss of biodiversity will be experienced during the site clearance for the construction activities to start. Huge biomass will be cleared that may include important and rare species.

Mitigation Measures

- Close supervision of earthworks shall be observed in order to confine land clearance within the area where the construction activities are to take place.

7.2.3 Land degradation and increased erosion

Establishment of new facility within the project area might result into land degradation and promote soil erosion.

Mitigation Measures

- Unnecessary ground clearance and sensitive re-alignments shall be avoided.
- Lined drainage channels at sensitive terrains shall be provided to control speed and volumes of storm-water.
- The contractor should plant grass or any other vegetation cover to minimise exposed soil surface.
- Directing flow to properly designated channels within the facility site.

7.2.4 Noise pollution

Noise pollution is likely to occur due to the application of construction equipment and generators at the site.

Mitigation Measure

- The proponent shall maintain equipment in good running conditions to ensure that ambient noise level and vibrations pollution into the environment is very minimum to comply with Tanzania standards
- The noisy construction activities will be scheduled at normal working hours. Regular inspection and maintenance of construction vehicles and equipment will be done to ensure that they have mufflers installed and worn parts are replaced

7.2.5 Air Pollution from dust emission

Air pollution is likely to occur due to the emission of suspended particulate matter (dust) to the atmosphere from the construction activities.

Mitigation Measure

- Mixing equipment shall be sealed properly and vibrating equipment will be equipped with dust removing devices.
- Also all vehicles that generate excessive black smoke will not be used.
- Adequate training and use of personal protective equipment (PPE) such as eye glasses and dust masks will be ensured in order to reduce risks associated with dust.

7.2.6 High Risk of Health associated with construction work

Construction activities exposes the workers to a lot of risks for example risk of falling into the excavated pits more than 3 metres deep, risk of injuries from falling objects or sharp pointed objects e.t.c

Mitigation measure

- The project proponent shall ensure that all personnel are provided with appropriate protective gear.
 - All works shall be planned and conducted in accordance with relevant OHS Guidelines. First Aid Kit as well as regular medical check-ups for the workers will be provided during the entire working hours.
 - Adequate number of firefighting equipment/extinguishers will be provided in every few distance to help putting off fire in case of occurrence.
-

- Excavated pits should be protected by warning tape and guardrails to prevent workers from falling

7.2.7 Waste generation during construction

A lot of waste will be generated especially during construction stage. For example, excavation of foundations will generate a lot of spoil materials that will need to be disposed of. Construction of walls and roof will both generate wastes. Other wastes will be generated from cleaning of construction equipment and containers like mixers and paint buckets.

Mitigation measures:

- Stick to the design specifications
- Provide waste containers
- Provide training to workers and orient them towards environmental protection values

7.2.8 High Risk of Health associated during operation

There will be unhealthy environment contaminated by human waste during emptying the tricycles of vehicles if not well managed.

Mitigation measure

- The project proponent shall ensure that all personnel are provided with appropriate protective gear.
- Awareness to the plant operators to avoid any technical failure
- Also awareness to the truck drivers/ operators on the best way of emptying or desludging their vehicles

8.0 ACTION PLAN FOR PREVENTION AND MANAGEMENT OF ACCIDENTS DURING IMPLEMENTATION STAGE

The project shall be implemented in compliance to labour laws in Tanzania, in particular, the Occupational Health and Safety Act (2003). Clauses to protect the health and safety of workers shall be included in the contract documents for implementation stage.

8.1 Health and Safety

The proponent is committed to protect the health and safety of its employees and those of its contractors, to ensuring that activities are conducted in a manner that protects the environment and people. The Contractor shall provide and enforce the use of appropriate personal protective equipment for all workers e.g. overalls, gloves, masks, etc. (wherever required). Tanzanian/international construction standards will be followed for quality and safety to workers. First aid facility will be installed at the construction site.

8.2 Security

The whole proposed project will take care of security matter of the site by fencing the whole project area and provide gates for entrance and exit purpose. The project proponent shall have a 24 hours security services from a private company to secure the whole project premise at the site. Also since the nature of investment involves fecal sludge management facility with the potential of biogas production. The project proponent will install the best firefighting system at site. The purpose of fire protection is to protect life, good and activities within the project site.

The following are some of the active and passive fire-fighting equipment that will be employed;

- Fire detection system
- Fire hydrant system
- Portable Fire Extinguishers

8.3 Monitoring, Maintenance and repair

The management of the facility will be upon both DAWASA and Kigamboni Municipal Council to ensure the approved design or plan is implemented accordingly. Furthermore, provision of basic services is being executed at high quality as intended.

8.4 Project Alternatives

Consideration of project alternatives is crucial in ensuring that the developer and decision-makers have a wider base from which they can choose the most appropriate option. In this comprehensive project brief, the following alternatives are considered.

Hybrid Constructed Wetlands (CW)

Constructed Wetlands (CWs) are a natural, low-cost, Eco technological biological wastewater treatment technology designed to mimic processes found in natural wetland ecosystems, which is now standing as the potential alternative or supplementary systems for the treatment of wastewater (*Source Design Report 2021*).

No project alternative

The no project alternative entails retaining the current status quo without developing the proposed FSTP. Adopting this option would mean avoiding most of the negative effects associated with the establishment of the FSTP and missing all the positive benefits that would accrue such as improved community life and reduction of the communicable diseases and improving sanitation.

Analysis of alternatives: To improve the public health and sanitation at Vijibweni ward and surrounding community, DAWASA and LGA selected the aforementioned location, which until this more is considered to be favorable place due to a need of the FSTP. Moreover, the selected design of this FSTP and technology for onsite wastewater treatment were chosen by considering the nature of the place and demand of surrounded community.

9.0 ENVIRONMENTAL AND SOCIAL MANAGEMENT PLAN

9.1 Environmental and Social Management Plan

The Environmental and Social Management Plan (ESMP) presents the implementation schedule of the proposed mitigation measures for both environmental and social impacts. The ESMP for the proposed Construction of Faecal Sludge Treatment Plant at DAWASA Yard, Vijibweni area is summarized in Table 4. The ESMP also indicates environmental costs needed to implement the recommended mitigation measures. The Faecal Sludge site selection process and engineering designs have already included some of the mitigation measures recommended in this report. Additional recommendations are provided in the ESMP to enable the Faecal Sludge Treatment Plant to be constructed and operated in environmentally friendly manner.

DAWASA in collaboration with Kigamboni Municipality shall be the main implementer of the ESMP through. The environmental measures incorporated in the detailed engineering design will be attached to the Bills of Quantities and Contract Documents. Moreover, there will be an Environmental, Social, Health and Safety (ESHS) Code of Conduct to be signed by the Contractor(s) to show their commitment in the implementation of the Environmental, Social, Health and Safety. The implementation of the Code will be supervised by DAWASA or his consultant.

The ESHS Code is a set of Guidelines attached to the Bidding Document and Contract to be adopted by Contractor during project implementation. It contains the commitment and obligations of the Contractor and its subsidiaries (i.e. Sub-Contractors and staff) to undertake construction activities in accordance with all applicable Laws, Rules, and Regulations. The Contractor and its subsidiaries shall comply with the Code of Conduct with high ethical standards. Failure to observe the Code, will subject the firm to disciplinary action, including Contract termination. Violation of the Code, is violation of Law which may result to civil and/or criminal penalties to Contractors, Supervisors or Firm.

Some of the issues to be included in the ESHS shall include;

- Site specific **ESMP, HSMP,**
- Traffic Management Plan (**TMP**), **where applicable**
- HIV/AIDS Awareness Program,
- Occupational Health and Safety Awareness Program.
- Sexual Harassment Prevention Policy
- Child Labour Prevention Policy

The environmental and social mitigation and enhancement measures incorporated in the detailed engineering design will be attached to the Contract Documents. The Contractor shall take stock of the contents of the Project Brief.

Table 4: Environmental and Social Management Plan for the Proposed Construction of Fecal Sludge Treatment Plant at DAWASA Yard, Mkwajuni Mtaa, Vijibweni ward, Kigamboni Municipal

Impact	Mitigation Measure	Responsible Institution	Estimated One Time Cost (TZS)	Estimated Annual cost (TZS)
Increased waste generation	<ul style="list-style-type: none"> ○ Stick to the design specifications ○ Provide waste containers ○ Provide training to workers and orient them towards environmental protection values 	DAWASA	To be included in the BOQ	
Increased HIV/AIDS and other STD	<ul style="list-style-type: none"> ○ Contractor shall enforce a code of conduct in the project area to encourage respect for the local community and to maintain self-cleanliness of the working area at all times. ○ The contractor shall deploy locally available labour to reduce risk of spreading communicable diseases (especially STDs). ○ In order to prevent more HIV/AIDS infection, during the implementation phase, the project should include information education and communication component (IEC) in its budget. This will help to raise more awareness on HIV/AIDS, and means to suppress its incidence. 	DAWASA	6,000,000.00	

Impact	Mitigation Measure	Responsible Institution	Estimated One Time Cost (TZS)	Estimated Annual cost (TZS)
	<ul style="list-style-type: none"> ○ A safety, health and environment induction course shall be conducted to all workers, putting more emphasis on HIV/AIDS, which has become a national disaster. 			
Land degradation and increased erosion	<ul style="list-style-type: none"> ○ The contractor should Plant vertiver grasses to minimize exposed soil surface. ○ To obtain the construction materials official negotiated should be performed with wards leaders in order to avoid conflict. 	DAWASA	25,000,000	
Noise pollution during construction	<ul style="list-style-type: none"> ○ The proponent shall maintain equipment in good running conditions to ensure that ambient noise level and vibrations pollution into the environment is very minimum to comply with Tanzania standards ○ All construction works will be scheduled at normal working hours. ○ Proper inspection and maintenance of construction vehicles and equipment will be done to ensure that they have mufflers installed and worn parts are replaced 	DAWASA	2,000,000.00	

Impact	Mitigation Measure	Responsible Institution	Estimated One Time Cost (TZS)	Estimated Annual cost (TZS)
Dust generation during construction	<ul style="list-style-type: none"> ○ Mixing equipment shall be sealed properly and vibrating equipment will be equipped with dust removing devices. ○ Also all vehicles that generate excessive black smoke will not be used. ○ Adequate training and use of personal protective equipment (PPE) such as eye glasses and dust masks will be ensured in order to reduce risks associated with dust. 	DAWASA	3,000,000.00	
Health Risks associated with construction works	<ul style="list-style-type: none"> ○ The project proponent shall ensure that all personnel are provided with appropriate protective gear. ○ All works shall be planned and conducted in accordance with relevant OHS Guidelines. First Aid Kit as well as regular medical check-ups for the workers will be provided during the entire working hours. ○ Adequate number of firefighting equipment/extinguishers will be provided in every few distance to help putting off fire in case of occurrence. 	DAWASA	1,000,000.00	

Project Brief of the Proposed Fecal Sludge Treatment Plant at DAWASA Yard, Mkwajuni Mtaa

Impact	Mitigation Measure	Responsible Institution	Estimated One Time Cost (TZS)	Estimated Annual cost (TZS)
	<ul style="list-style-type: none"> ○ Excavated pits should be protected by warning tape and guardrails to prevent workers from falling ○ The developer to ensure adequate supply of provisions ○ Adhere to good maintenance 			
Total			38,000,000	10,000,000.00

10.0 MONITORING PLAN

10.1 Environmental Monitoring

The national EIA guidelines require the developer to prepare and undertake monitoring plan of implemented development projects. Monitoring is needed to check if and to what extent the impacts are mitigated, benefits enhanced and new problems addressed. Recommendations for monitoring have been included in the Table 5. The monitoring plan also assigns responsibilities for different actors. Moreover, the ward and street environmental committees will shoulder the long-term monitoring of the project.

Table 5: Monitoring Plan for the Proposed Construction of Fecal Sludge Treatment Plant at DAWASA Yard, Mkwajuni Mtaa, Vijibweni ward, Kigamboni Municipal

Parameter	Monitoring Frequency	Sampling Area	Measurement Unit	Method	Target Level/Standard	Responsibility for monitoring	Estimated Annual (or once cost (TZS)
Mobilization Phase							
Dust	Daily	Immediate working area	ppm	Physical-visual	TBS	DAWASA	None
Air Quality	Daily	Around the Inspection chambers	µg/m ³	Smelling (nasal)	TBS	DAWASA	2,500,000.00
Waste Generation	Weekly	At the working area	Amount of waste	Physical measurement or estimation	All waste contained	DAWASA	In BOQ
Health risks	Daily	At working area	Accidents	Counting	NO accident	DAWASA	In BOQ
HIV/AIDS	Monthly	Workers	Training	Numbers	One per month during construction phase only	DAWASA	5,000,000.00
Biodiversity	Once (at commencement)	Working area	Destruction of habitat or removal of biodiversity	Area affected	Minimal disturbance to biodiversity	DAWASA	1,000,000.00
Construction phase							
Dust (PM 2.5, PM 10)	Weekly	Immediate working area	ppm	Physical-visual	TBS	DAWASA	None
Air Quality	Twice a week	Around the Inspection chambers	µg/m ³	Smelling (nasal)	TBS	DAWASA	2,500,000.00
Waste Generation	Weekly	At the working area	Amount of waste	Physical measurement or estimation	All waste contained	DAWASA	In BOQ

Project Brief of the Proposed Fecal Sludge Treatment Plant at DAWASA Yard, Mkwajuni Mtaa

Parameter	Monitoring Frequency	Sampling Area	Measurement Unit	Method	Target Level/Standard	Responsibility for monitoring	Estimated Annual (or once cost (TZS)
Health risks	Daily	At working area	Accidents	Counting	NO accident	DAWASA	In BOQ
HIV/AIDS	Monthly	Workers	Training	Numbers	One per month during construction phase only	DAWASA	5,000,000.00
Biodiversity	Once (at commencement)	Working area	Destruction of habitat or removal of biodiversity	Area affected	Minimal disturbance to biodiversity	DAWASA	1,000,000.00
Demobilization Phase							
Dust (PM 2.5, PM 10)	Weekly	Immediate working area	ppm	Physical-visual	TBS	DAWASA	None
Air Quality	Weekly	Around the Inspection chambers	µg/m ³	Smelling (nasal)	TBS	DAWASA	500,000.00
Waste Generation	Weekly	At the working area	Amount of waste	Physical measurement or estimation	All waste contained	DAWASA	In BOQ
Health risks	Daily	At working area	Accidents	Counting	NO accident	DAWASA	In BOQ
HIV/AIDS	Monthly	Workers	Training	Numbers	One per month during construction phase only	DAWASA	5,000,000.00
Biodiversity	Once (at commencement)	Working area	Destruction of habitat or removal of biodiversity	Area affected	Minimal disturbance to biodiversity	DAWASA	1,000,000.00
Operation phase							
Air Quality	Twice a week	Around the Inspection chambers	µg/m ³	Smelling (nasal)	Absence of nuisance smells	DAWASA	500,000.00

Project Brief of the Proposed Fecal Sludge Treatment Plant at DAWASA Yard, Mkwajuni Mtaa

Parameter	Monitoring Frequency	Sampling Area	Measurement Unit	Method	Target Level/Standard	Responsibility for monitoring	Estimated Annual (or once cost (TZS)
Waste Generation	Monthly	At the working area	Amount of waste	Physical measurement or estimation	All waste contained	DAWASA	In operation manual
Health risks	Monthly	At working area	Accidents	Counting	NO accident	DAWASA	In operation manual
HIV/AIDS	Annually	Workers	Training	Numbers	One per month during construction phase only	DAWASA	In operation manual
Total							28,000,000.00

11.0 PROJECT BUDGET

The investment cost for the proposed Faecal Sludge Treatment Plant is estimated to be around Tshs. 700 million that will be financed by The World Bank.

12.0 CONCLUSION

The proposed project is of greater profit to the community and the country at large as it promotes and improve sanitation in the streets. When there is good and improved sanitation, then the outbreak of diseases like diarrhoea and associated stomach and waterborne diseases are also reduced and prevented hence improved public health.

The impacts identified are preventable and of less negativity to the community, therefore the developer can be provided with the environmental clearance certificate in order to commence the implementation of the project.

It is, therefore, concluded that implementation of the proposed construction of the Faecal sludge treatment plant at DAWASA Yard, Mkwajuni mtaa will entail no detrimental impacts provided that the recommended mitigation measures are adequately and timely put in place. The identified adverse impacts shall be managed through the proposed mitigation measures and implementation regime laid down in this EIS. DAWASA is committed to implementing all the recommendations given in the EIS and further carrying out the environmental auditing and monitoring schedules.

References

1. Bicknell, J.; Dodman, D., and Satterthwaite, D., (eds.), 2009. Adapting Cities to Climate Change: Understanding and Addressing the Development Challenges. London, UK: Earthscan, 397p.
2. Investment profile of Kigamboni Municipal council
3. Nicholls, R.J., Wong, P.P., Burkett, V.R., Codignotto, J.O., Hay, J.E., McLean, R.F., Ragoonaden, S. and Woodroffe, C.D. 2007. Coastal systems and low-lying areas. In: M.L. Parry, O.F. Canziani, J.P. Palutikof, P.J. van der Linden, and C.E. Hanson, (Eds), Climate Change 2007: Impacts, Adaptation and Vulnerability. Contribution of Working Group II to the Fourth Assessment Report of the Intergovernmental Panel on Climate Change, Cambridge University Press, Cambridge, UK, p. 315-356.
4. Population and Assets Exposure to Coastal Flooding in Dar es Salaam (Tanzania): Vulnerability to Climate Extremes
5. Kigamboni Municipal Socio-economic profile 2010/2011

Appendix I: List of Stakeholders Consulted







Appendix II: Land Ownership Document



The first part of the document discusses the importance of maintaining accurate records. It emphasizes that proper record-keeping is essential for ensuring the integrity and reliability of the data. This section also covers the various methods used to collect and analyze the information, highlighting the challenges and solutions involved in the process.

The second part of the document focuses on the practical aspects of the study. It details the experimental setup, the procedures followed, and the results obtained. This section provides a clear and concise overview of the work, allowing readers to understand the methodology and the findings of the research.

In conclusion, the document highlights the significance of the research and the contributions it has made to the field. It also discusses the implications of the findings and the potential for future research in this area.






The following text is a transcription of the content in the lower section of the page. It appears to be a list or a set of instructions, possibly related to the diagram above. The text is arranged in several lines and includes some bolded or highlighted terms.





Figure 1

The following table provides a summary of the data presented in the chart above. The data is organized into two main sections, each with its own set of rows and columns. The first section contains three rows of data, and the second section contains two rows. The columns represent different categories or metrics, though the specific labels are not legible.

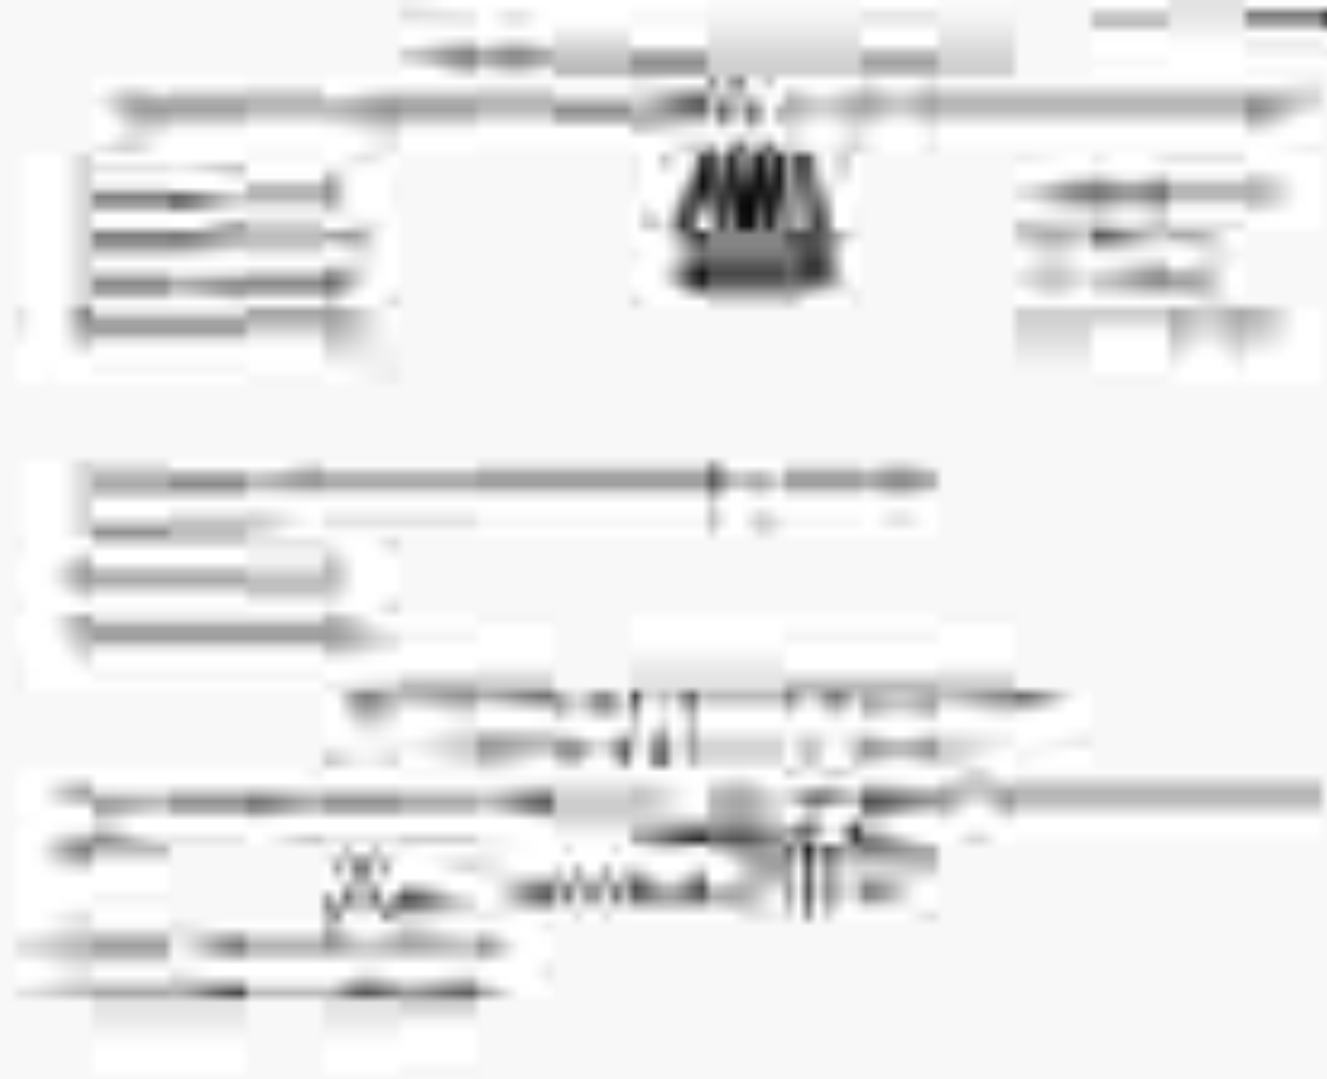

Appendix III: Architectural drawings

NOTES:

1. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE SHOWN
2. DO NOT SCALE FROM THIS DRAWING
3. THE SCALES GIVEN ON THIS DRAWING REFER TO THE A1 SIZE ORIGINAL DRAWING
4. THE SUBGRADE SHALL BE COMPACTED TO 99% MAXIMUM DRY DENSITY BEFORE THE PLACEMENT OF HARDCORE
5. CONCRETE SHALL BE CLASS C30/37 FOR STRUCTURAL MEMBERS AND CLASS C8/10 FOR BLINDING
6. THE MAXIMUM SIZE OF AGGREGATE SHALL BE 20mm UNLESS OTHERWISE SHOWN
7. REINFORCEMENT SHALL BE HIGH TENSILE DEFORMED TYPE WITH A CHARACTERISTIC YIELD STRESS OF AT LEAST 429N/mm²
8. COVER TO REINFORCEMENT SHALL BE:
 - FOUNDATIONS 50mm
 - SLABS 25mm
 - WALLS AND BEAMS 30mm
9. LAPS TO ALL REINFORCEMENT SHALL BE 50 * BAR DIAMETER UNLESS OTHERWISE SHOWN

01

R MP

15000

PLAN VIEW
SCALE 1:50

02

SECTION 01-01
SCALE 1:50

SLOPE

SLOPE

SLOPE

SLOPE

FEEDING TANK

C

E'

6000

DETAIL D'

01

DESIGN BY		
DRAWN BY	SCALE	AS SHOWN
CHECKED BY		
APPROVED BY	DATE	JANUARY-2022
SHEET NO:	DRAWING NO.	FSTP-106-01

PROJECT	CONSTRUCTION OF FAECAL SLUDGE TREATMENT PLANTS (FSTP) WORKS IN DAR ES SALAAM
TITLE	FECAL SLUDGE TREATMENT PLANT - SMALL SIZE (50m ³) VIJIBWENI FSTP - SLUDGE RECEIVING RAMP PLAN VIEW AND SECTIONS GENERAL ARRANGEMENTS


REVISION	
DATE	
NATURE OF REV.	
CHECKED BY	
APPROVED BY	

DAR ES SALAAM WATER SUPPLY & SANITATION AUTHORITY (DAWASA)
CONSULTANT
DOHWA Engineering CO., LTD IN ASSOCIATION WITH LUPTAN CONSULTS LTD AND WWS




NOTES:

1. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE SHOWN
2. DO NOT SCALE FROM THIS DRAWING
3. THE SCALES GIVEN ON THIS DRAWING REFER TO THE A1 SIZE ORIGINAL DRAWING
4. THE SUBGRADE SHALL BE COMPACTED TO 99% MAXIMUM DRY DENSITY BEFORE THE PLACEMENT OF HARDCORE
5. CONCRETE SHALL BE CLASS C30/37 FOR STRUCTURAL MEMBERS AND CLASS C8/10 FOR BLINDING
6. THE MAXIMUM SIZE OF AGGREGATE SHALL BE 20mm UNLESS OTHERWISE SHOWN
7. REINFORCEMENT SHALL BE HIGH TENSILE DEFORMED TYPE WITH A CHARACTERISTIC YIELD STRESS OF AT LEAST 429N/mm²
8. COVER TO REINFORCEMENT SHALL BE:
 - FOUNDATIONS 50mm
 - SLABS 25mm
 - WALLS AND BEAMS 30mm
9. LAPS TO ALL REINFORCEMENT SHALL BE 50 * BAR DIAMETER UNLESS OTHERWISE SHOWN

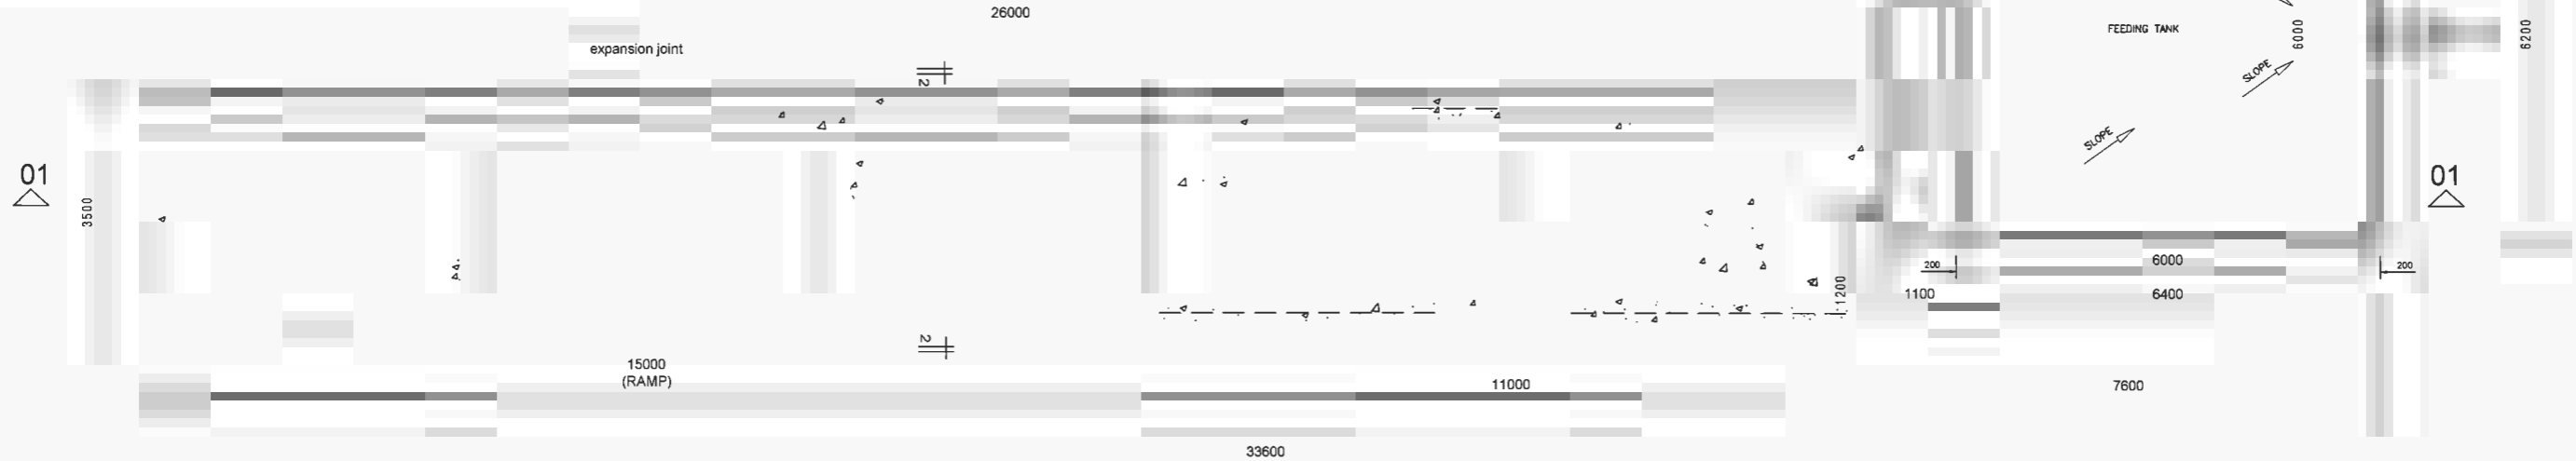

PLAN VIEW
SCALE 1:50

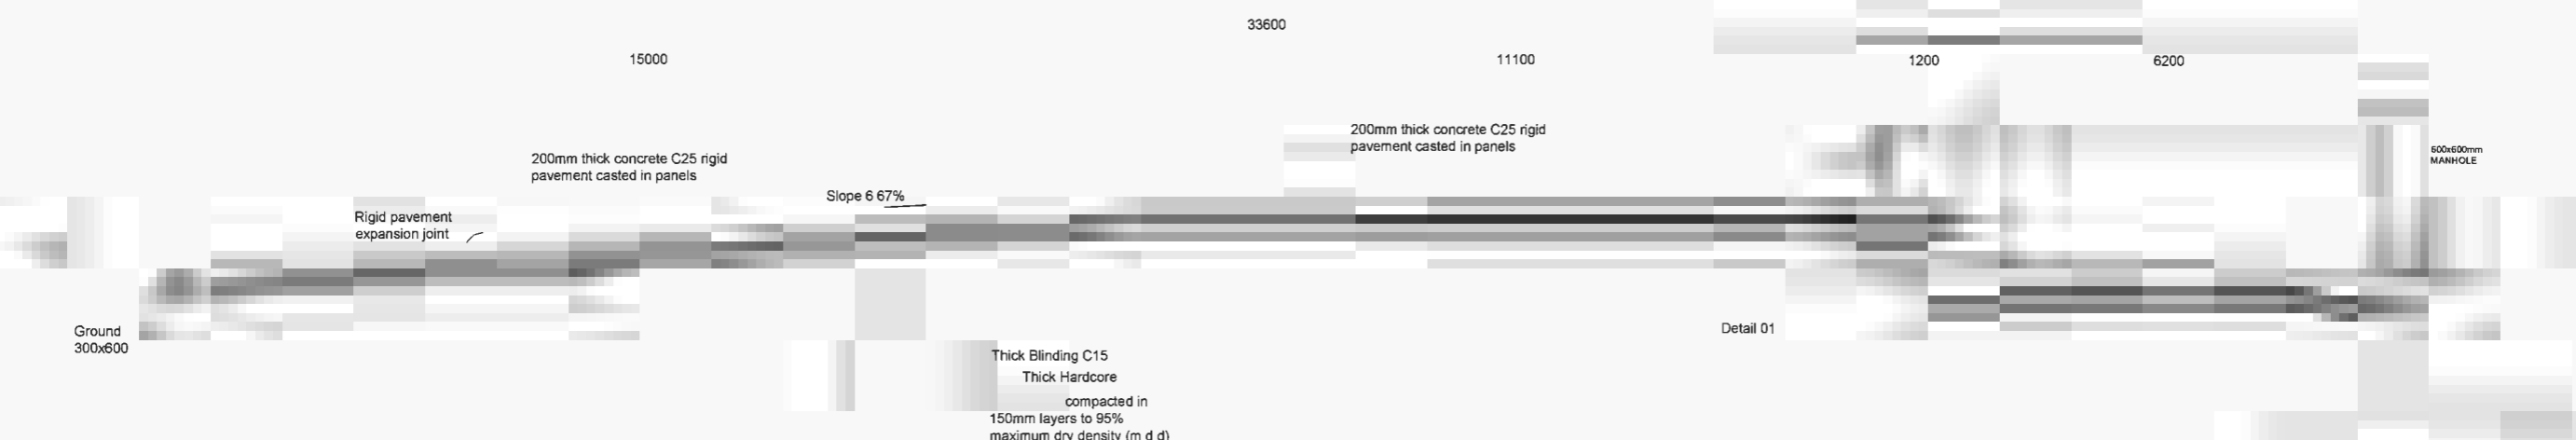

SECTION 01-01
SCALE 1:50

DESIGN BY	SCALE	AS SHOWN
DRAWN BY		
CHECKED BY		
APPROVED BY	DATE	JANUARY-2022
SHEET NO:	DRAWING NO	FSTP-106-01-1

PROJECT
CONSTRUCTION OF FAECAL SLUDGE TREATMENT PLANTS (FSTP) WORKS IN DAR ES SALAAM


TITLE
FECAL SLUDGE TREATMENT PLANT - SMALL SIZE (50m³) VIJIBWENI FSTP - SLUDGE RECEIVING RAMP
STRUCTURAL DRAWINGS - PLAN & SECTION GENERAL ARRANGEMENT DETAILS

REVISION	DAR ES SALAAM WATER SUPPLY & SANITATION AUTHORITY (DAWASA)
DATE	
NATURE OF REV.	
CHECKED BY	DOHWA Engineering CO., LTD IN ASSOCIATION WITH LUPTAN CONSULTS LTD AND WWS
APPROVED BY	




NOTES:

1. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE SHOWN
2. DO NOT SCALE FROM THIS DRAWING
3. THE SCALES GIVEN ON THIS DRAWING REFER TO THE A1 SIZE ORIGINAL DRAWING
4. THE SUBGRADE SHALL BE COMPACTED TO 99% MAXIMUM DRY DENSITY BEFORE THE PLACEMENT OF HARDCORE
5. CONCRETE SHALL BE CLASS C30/37 FOR STRUCTURAL MEMBERS AND CLASS C8/10 FOR BLINDING
6. THE MAXIMUM SIZE OF AGGREGATE SHALL BE 20mm UNLESS OTHERWISE SHOWN
7. REINFORCEMENT SHALL BE HIGH TENSILE DEFORMED TYPE WITH A CHARACTERISTIC YIELD STRESS OF AT LEAST 429N/mm²
8. COVER TO REINFORCEMENT SHALL BE:
 - FOUNDATIONS 50mm
 - SLABS 25mm
 - WALLS AND BEAMS 30mm
9. LAPS TO ALL REINFORCEMENT SHALL BE 50 * BAR DIAMETER UNLESS OTHERWISE SHOWN

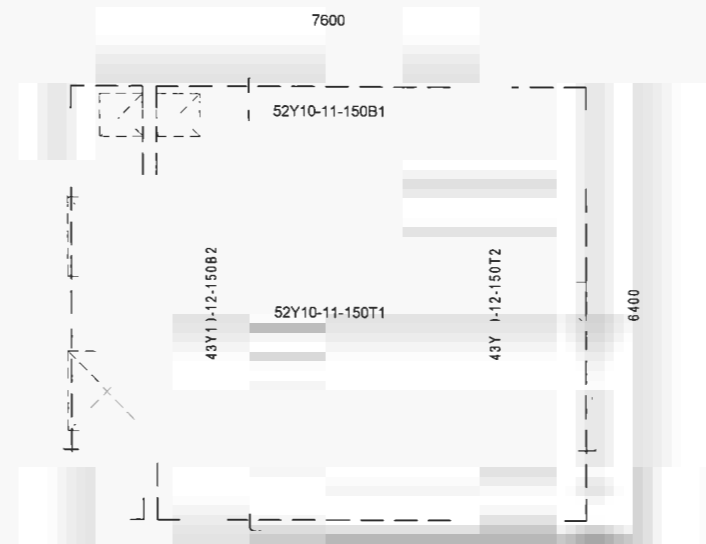

TOP SLAB

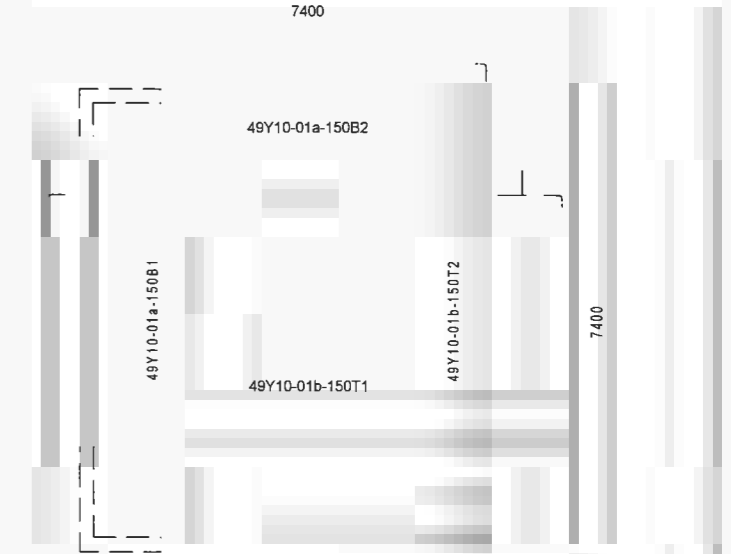


FOUNDATION BASE




Ground beam
300x500
SCALE 1:25




Section 2-2
SCALE 1:25

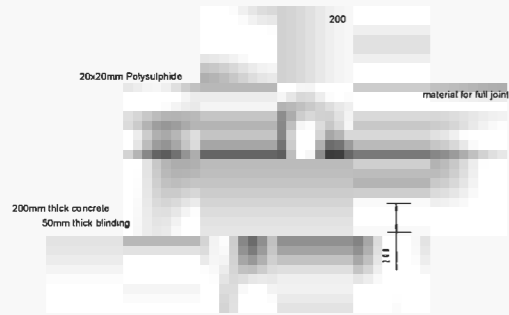

Isolation Joint for Ramp and Walls
SCALE 1:25

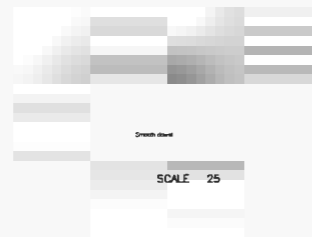


SCALE 25

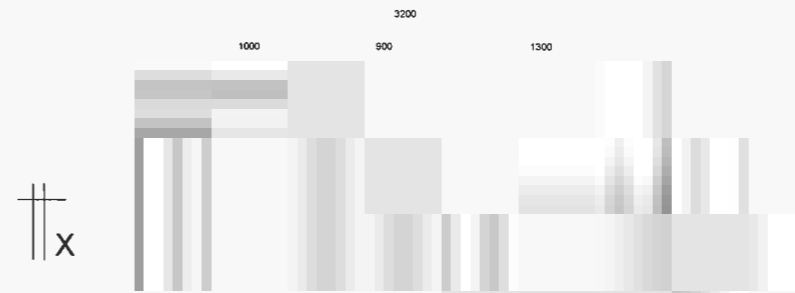


Ramp Staircase Plan View
SCALE 1:25



Ramp Staircase RC Details
1:25

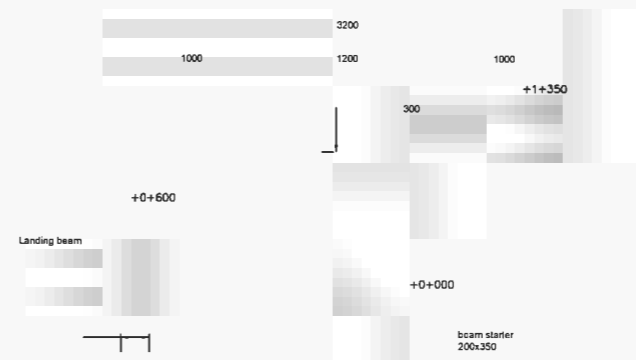

Ramp Staircase Section X-X
SCALE 1:25

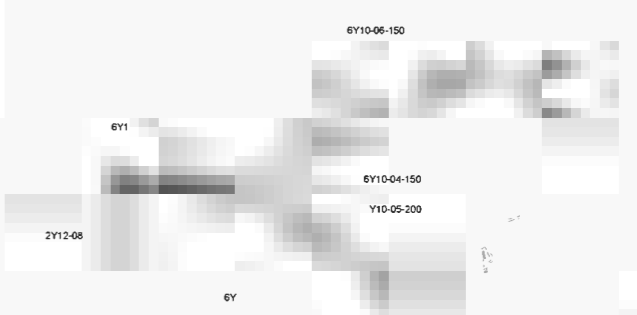

Ramp Staircase RC
SCALE 1:25

DESIGN BY		SCALE	AS SHOWN
DRAWN BY			
CHECKED BY			
APPROVED BY		DATE	JANUARY-2022
SHEET NO:		DRAWING NO	FSTP-106-01-3

PROJECT
CONSTRUCTION OF FAECAL SLUDGE TREATMENT PLANTS (FSTP) WORKS IN DAR ES SALAAM

TITLE
FECAL SLUDGE TREATMENT PLANT - SMALL SIZE (50m³) VIJIBWENI FSTP - SLUDGE RECEIVING RAMP
STRUCTURAL DRAWINGS - FOUNDATION, SLAB, COLUMN & STAIRCASE REINFORCEMENTS DETAILS

REVISION	
DATE	
NATURE OF REV	
CHECKED BY	
APPROVED BY	

DAR ES SALAAM WATER SUPPLY & SANITATION AUTHORITY (DAWASA)
CONSULTANT
DOHWA Engineering CO., LTD IN ASSOCIATION WITH LUPTAN CONSULTS LTD AND WWS

NOTES:

- 1 ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE SHOWN
- 2 DO NOT SCALE FROM THIS DRAWING
3. THE SCALES GIVEN ON THIS DRAWING REFER TO THE A1 SIZE ORIGINAL DRAWING
4. THE SUBGRADE SHALL BE COMPACTED TO 99% MAXIMUM DRY DENSITY BEFORE THE PLACEMENT OF HARDCORE
5. CONCRETE SHALL BE CLASS C30/37 FOR STRUCTURAL MEMBERS AND CLASS C8/10 FOR BLINDING
6. THE MAXIMUM SIZE OF AGGREGATE SHALL BE 20mm UNLESS OTHERWISE SHOWN
7. REINFORCEMENT SHALL BE HIGH TENSILE DEFORMED TYPE WITH A CHARACTERISTIC YIELD STRESS OF AT LEAST 429N/mm²
8. COVER TO REINFORCEMENT SHALL BE:
 - FOUNDATIONS 50mm
 - SLABS 25mm
 - WALLS AND BEAMS 30mm
- 9 LAPS TO ALL REINFORCEMENT SHALL BE 50 * BAR DIAMETER UNLESS OTHERWISE SHOWN

Ramp and Feeding tank

Member	Mark	Diameter	Total Numbers	Length (mm)	Unit weight (kg/m)	Total weight (kg)	Bar bending shape
Rigid pavement	01	Y10	130	3700	0.616	297	
	02,03	Y10	90	5100	0.616	283	
Base	01a	Y10	196	7800	0.616	942	
	01b	Y10	196	7550	0.616	912	
	02a	Y10	14	7550	0.616	66	
	02b	Y10	14	7550	0.616	66	
	03a	Y10	98	1400	0.616	85	
	03b	Y10	98	1150	0.616	70	
Walls	02a	Y10	14	7550	0.616	66	
	04	Y12	172	2925	0.888	447	
	06	Y10	96	6500	0.616	385	
	07	Y12	118	2325	0.888	244	
Top slab	08	Y10	32	1350	0.616	27	
	11	Y10	104		0.616	417	
	12	Y10	86	7600	0.616	403	
	Total					4710	

Access Staircase

Member	Mark	Diameter	Total Numbers	Length (mm)	Unit weight (kg/m)	Total weight (kg)	Bar bending shape	
Foot ng	01	Y10	16	1200	0.616	12		
	02	Y10	10	850	0.312	3		
Staircase	03	Y10	4	1850	0.888	7		
	01	Y08	24	1130	0.312			
	02	Y12	4	1400	0.616	5		
	03	Y10	6	2400	0.616	9		
	04	Y10	6	2325	0.616	9		
	05	Y10	30	1000	0.616	19		
	06	Y10	12	700	0.616	5		
	07	Y10	6	1650	0.616	6		
	08	Y12	4	1700	0.888	6		
	09	Y10	6	3500	0.616	13		
	10	Y10	6	3500	0.616	13		
						Tota	116	

DESIGN BY _____
 DRAWN BY _____ SCALE NOT TO SCALE
 CHECKED BY _____
 APPROVED BY _____ DATE JANUARY-2022
 SHEET NO: _____ DRAWING NO. FSTP-106-01-4

PROJECT CONSTRUCTION OF FAECAL SLUDGE TREATMENT PLANTS (FSTP) WORKS IN DAR ES SALAAM
 TITLE FECAL SLUDGE TREATMENT PLANT - SMALL SIZE (50m³) VIJIBWENI FSTP - SLUDGE RECEIVING RAMP
 STRUCTURAL DRAWINGS - REINFORCEMENTS BAR BENDING SCHEDULE

REVISION _____
 DATE _____
 NATURE OF REV. _____
 CHECKED BY _____
 APPROVED BY _____

DAR ES SALAAM WATER SUPPLY & SANITATION AUTHORITY (DAWASA)
 CONSULTANT
 DOHWA Engineering CO., LTD IN ASSOCIATION WITH LUPTAN CONSULTS LTD AND WWS

HWA

NOTES:

1. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE SHOWN
2. DO NOT SCALE FROM THIS DRAWING
3. THE SCALES GIVEN ON THIS DRAWING REFER TO THE A1 SIZE ORIGINAL DRAWING
4. THE SUBGRADE SHALL BE COMPACTED TO 99% MAXIMUM DRY DENSITY BEFORE THE PLACEMENT OF HARDCORE
5. CONCRETE SHALL BE CLASS C30/37 FOR STRUCTURAL MEMBERS AND CLASS C8/10 FOR BLINDING
6. THE MAXIMUM SIZE OF AGGREGATE SHALL BE 20mm UNLESS OTHERWISE SHOWN
7. REINFORCEMENT SHALL BE HIGH TENSILE DEFORMED TYPE WITH A CHARACTERISTIC YIELD STRESS OF AT LEAST 429N/mm²
8. COVER TO REINFORCEMENT SHALL BE:
 - FOUNDATIONS 50mm
 - SLABS 25mm
 - WALLS AND BEAMS 30mm
9. LAPS TO ALL REINFORCEMENT SHALL BE 50 * BAR DIAMETER UNLESS OTHERWISE SHOWN



PLAN VIEW
SCALE 1:50



SECTION 01-01
SCALE 1:50



SECTION 02-02
SCALE 1:50




DESIGN BY _____
 DRAWN BY _____ SCALE AS SHOWN
 CHECKED BY _____
 APPROVED BY _____ DATE JANUARY-2022
 SHEET NO: _____ DRAWING NO. FSTP-106-02

PROJECT
 CONSTRUCTION OF FAECAL SLUDGE TREATMENT PLANTS (FSTP) WORKS IN DAR ES SALAAM
 FECAL SLUDGE TREATMENT PLANT - SMALL SIZE (50m³) VIJIBWENI FSTP - BIOGAS DIGESTER PLAN
 VIEW AND SECTIONS GENERAL ARRANGEMENTS

REVISION
 DATE _____
 NATURE OF REV. _____
 CHECKED BY _____
 APPROVED BY _____


DAR ES SALAAM WATER SUPPLY & SANITATION AUTHORITY
 (DAWASA)
 CONSULTANT
 DOHWA Engineering CO., LTD IN ASSOCIATION
 WITH LUPTAN CONSULTS LTD AND WWS

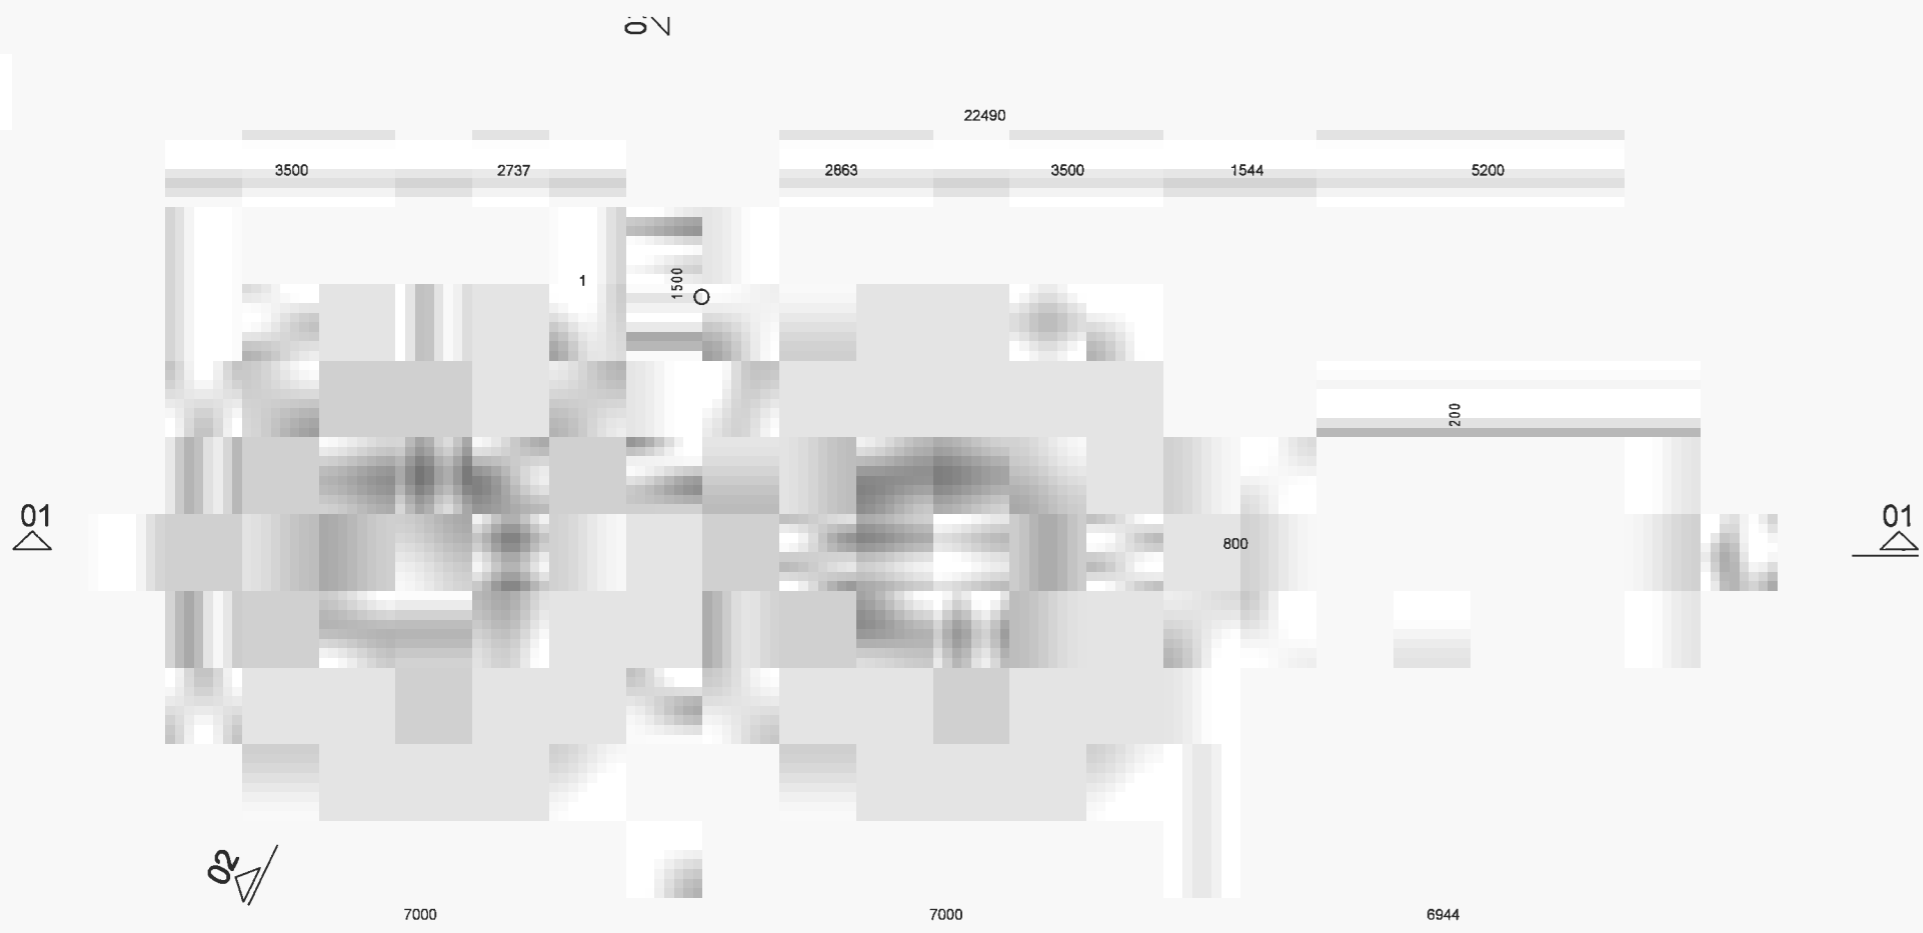

PLAN VIEW
SCALE 1:50



SECTION 01-01
SCALE 1:50

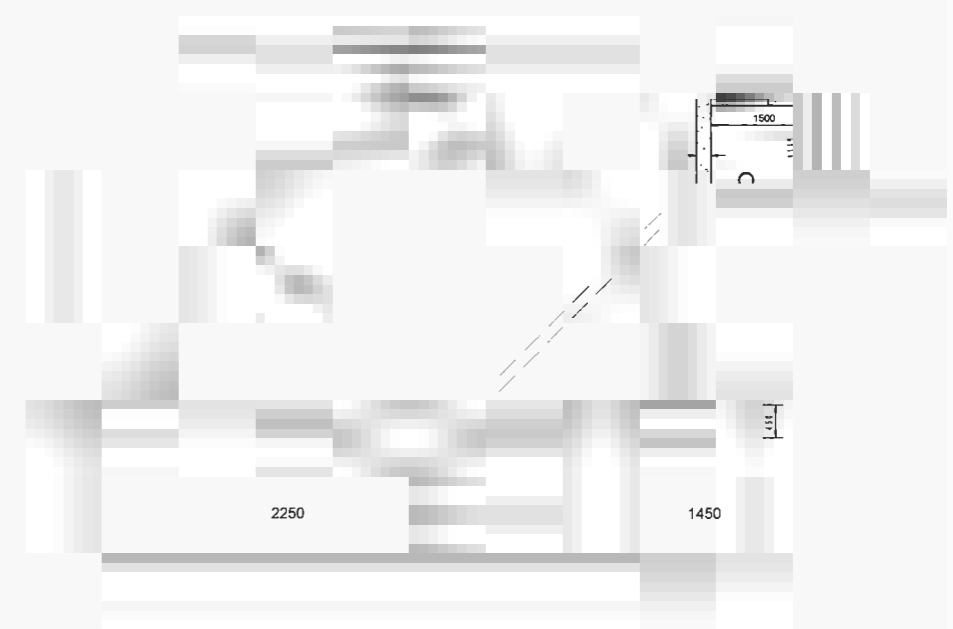

SECTION 02-02
SCALE 1:50

NOTES:

1. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE SHOWN
2. DO NOT SCALE FROM THIS DRAWING
3. THE SCALES GIVEN ON THIS DRAWING REFER TO THE A1 SIZE ORIGINAL DRAWING
4. THE SUBGRADE SHALL BE COMPACTED TO 99% MAXIMUM DRY DENSITY BEFORE THE PLACEMENT OF HARDCORE
5. CONCRETE SHALL BE CLASS C30/37 FOR STRUCTURAL MEMBERS AND CLASS C8/10 FOR BLINDING
6. THE MAXIMUM SIZE OF AGGREGATE SHALL BE 20mm UNLESS OTHERWISE SHOWN
7. REINFORCEMENT SHALL BE HIGH TENSILE DEFORMED TYPE WITH A CHARACTERISTIC YIELD STRESS OF AT LEAST 429N/mm²
8. COVER TO REINFORCEMENT SHALL BE:
 - FOUNDATIONS 50mm
 - SLABS 25mm
 - WALLS AND BEAMS 30mm
9. LAPS TO ALL REINFORCEMENT SHALL BE 50 * BAR DIAMETER UNLESS OTHERWISE SHOWN

DESIGN BY _____
 DRAWN BY _____
 CHECKED BY _____
 APPROVED BY _____
 SHEET NO: _____

SCALE AS SHOWN
 DATE JANUARY-2022
 DRAWING NO FSTP-106-02-1



PROJECT CONSTRUCTION OF FAECAL SLUDGE TREATMENT PLANTS (FSTP) WORKS IN DAR ES SALAAM
 TITLE FECAL SLUDGE TREATMENT PLANT - SMALL SIZE (50m³) VIJIBWENI FSTP - BIOGAS DIGESTER
 STRUCTURAL DRAWINGS - PLAN & SECTION GENERAL ARRANGEMENT DETAILS

REVISION _____
 DATE _____
 NATURE OF REV _____
 CHECKED BY _____
 APPROVED BY _____

DAR ES SALAAM WATER SUPPLY & SANITATION AUTHORITY (DAWASA)
 CONSULTANT
 DOHWA Engineering CO., LTD IN ASSOCIATION WITH LUPTAN CONSULTS LTD AND WWS

NOTES:

1. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE SHOWN
2. DO NOT SCALE FROM THIS DRAWING
3. THE SCALES GIVEN ON THIS DRAWING REFER TO THE A1 SIZE ORIGINAL DRAWING
4. THE SUBGRADE SHALL BE COMPACTED TO 99% MAXIMUM DRY DENSITY BEFORE THE PLACEMENT OF hardcore
5. CONCRETE SHALL BE CLASS C30/37 FOR STRUCTURAL MEMBERS AND CLASS C8/10 FOR BLINDING
6. THE MAXIMUM SIZE OF AGGREGATE SHALL BE 20mm UNLESS OTHERWISE SHOWN
7. REINFORCEMENT SHALL BE HIGH TENSILE DEFORMED TYPE WITH A CHARACTERISTIC YIELD STRESS OF AT LEAST 429N/mm²
8. COVER TO REINFORCEMENT SHALL BE:
 - FOUNDATIONS 50mm
 - SLABS 25mm
 - WALLS AND BEAMS 30mm
9. LAPS TO ALL REINFORCEMENT SHALL BE 50 * BAR DIAMETER UNLESS OTHERWISE SHOWN

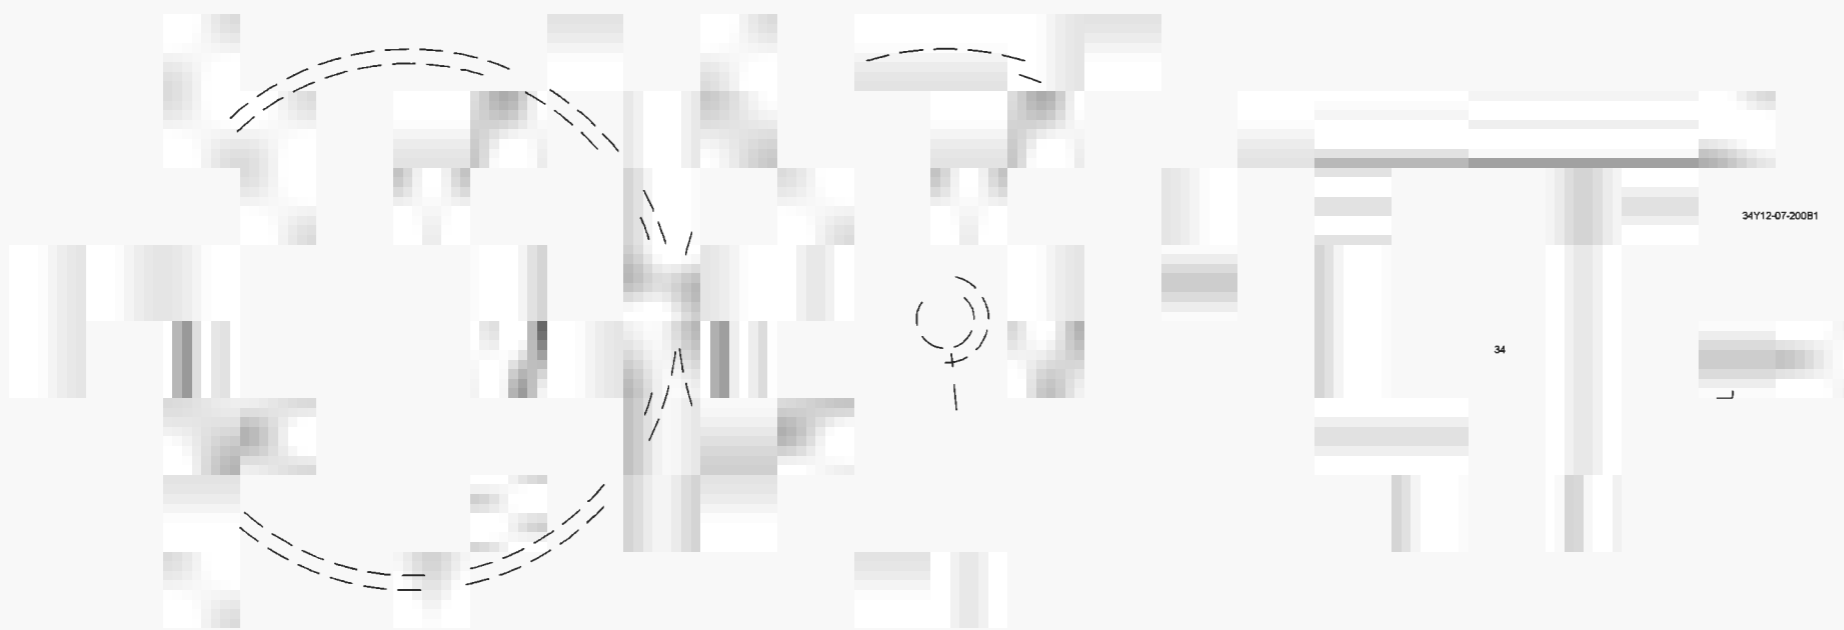

FOUNDATION BASE
SCALE 1:50

DESIGN BY	SCALE	AS SHOWN
DRAWN BY	DATE	JANUARY-2022
CHECKED BY	DRAWING NO.	FSTP-106-02-3
APPROVED BY		
SHEET NO:		

PROJECT
CONSTRUCTION OF FAECAL SLUDGE TREATMENT PLANTS (FSTP) WORKS IN DAR ES SALAAM

TITLE
FECAL SLUDGE TREATMENT PLANT - SMALL SIZE (50m³) VIJIBWENI FSTP - BIOGAS DIGESTER
STRUCTURAL DRAWINGS - FOUNDATION BASE REINFORCEMENTS DETAILS

REVISION
DATE
NATURE OF REV
CHECKED BY
APPROVED BY

DAR ES SALAAM WATER SUPPLY & SANITATION AUTHORITY (DAWASA)
CONSULTANT

DOHWA Engineering CO., LTD IN ASSOCIATION WITH LUPTAN CONSULTS LTD AND WWS

Bar Bending schedule- Biogas Digester

member	Mark	Diameter	Total Numbers/Area	Length (mm)	Unit weight (kg/m)	Total weight (kg)	Bar bending shape
Base	01	Y12	310	4400	0.888	1,212	
	02,04	Y12	176	12000	0.888	1,876	
	03	Y12	310	4500	0.888	1,240	
		Y12	62	2700	0.888	149	
	07	Y12	68	4550	0.888	275	
	08	Y12	46	8100	0.888	331	
	Walls	11	Y12	294	6350	0.888	1,658
12		Y12	120	8500	0.888	906	
13,16		Y12	34	4750	0.888	144	
14,17		Y12	34	3650	0.888	111	
15		Y12	92	3300	0.888	270	
18, 19		Y12	68	1260	0.888	76	
20		Y12	34	2200	0.888	67	
21		Y12	7	3950	0.888	25	
22		Y12	7	3950	0.888	25	
23		Y12	26	1150	0.888	27	
24		Y10	36	7650	0.616	170	
25		Y10	62	3550	0.616	136	

Hidden beams	Mark	Diameter	Total Numbers/Area	Length (mm)	Unit weight (kg/m)	Total weight (kg)	Bar bending shape
	08a	Y16	8	3600	0.888	1,578	
	08c	Y16	8	3300	0.888	1,578	
	09	Y08	216	1350	0.312	91	
	09a	Y08	72	950	0.312	22.56	
	10	Y16	24	10500	0.888	2,126.4	
						Total	9,364

NOTES:


1. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE SHOWN
2. DO NOT SCALE FROM THIS DRAWING
3. THE SCALES GIVEN ON THIS DRAWING REFER TO THE A1 SIZE ORIGINAL DRAWING
4. THE SUBGRADE SHALL BE COMPACTED TO 99% MAXIMUM DRY DENSITY BEFORE THE PLACEMENT OF HARDCORE
5. CONCRETE SHALL BE CLASS C30/37 FOR STRUCTURAL MEMBERS AND CLASS C8/10 FOR BLINDING
6. THE MAXIMUM SIZE OF AGGREGATE SHALL BE 20mm UNLESS OTHERWISE SHOWN
7. REINFORCEMENT SHALL BE HIGH TENSILE DEFORMED TYPE WITH A CHARACTERISTIC YIELD STRESS OF AT LEAST 429N/mm²
8. COVER TO REINFORCEMENT SHALL BE:
 - FOUNDATIONS 50mm
 - SLABS 25mm
 - WALLS AND BEAMS 30mm
9. LAPS TO ALL REINFORCEMENT SHALL BE 50 * BAR DIAMETER UNLESS OTHERWISE SHOWN

DESIGN BY
DRAWN BY
CHECKED BY
APPROVED BY

SCALE AS SHOWN
DATE JANUARY-2022
PROJECT CONSTRUCTION OF FAECAL SLUDGE TREATMENT PLANTS (FSTP) WORKS IN DAR ES SALAAM
ECAL SLUDGE TREATMENT PLANT - SMALL SIZE (50m³) VIJIBWENI FSTP - BIOGAS DIGESTER

REVISION
DATE
NATURE OF REV
CHECKED BY


DAR ES SALAAM WATER SUPPLY & SANITATION AUTHORITY (DAWASA)
CONSULTANT
DOHWA Engineering CO., LTD IN ASSOCIATION

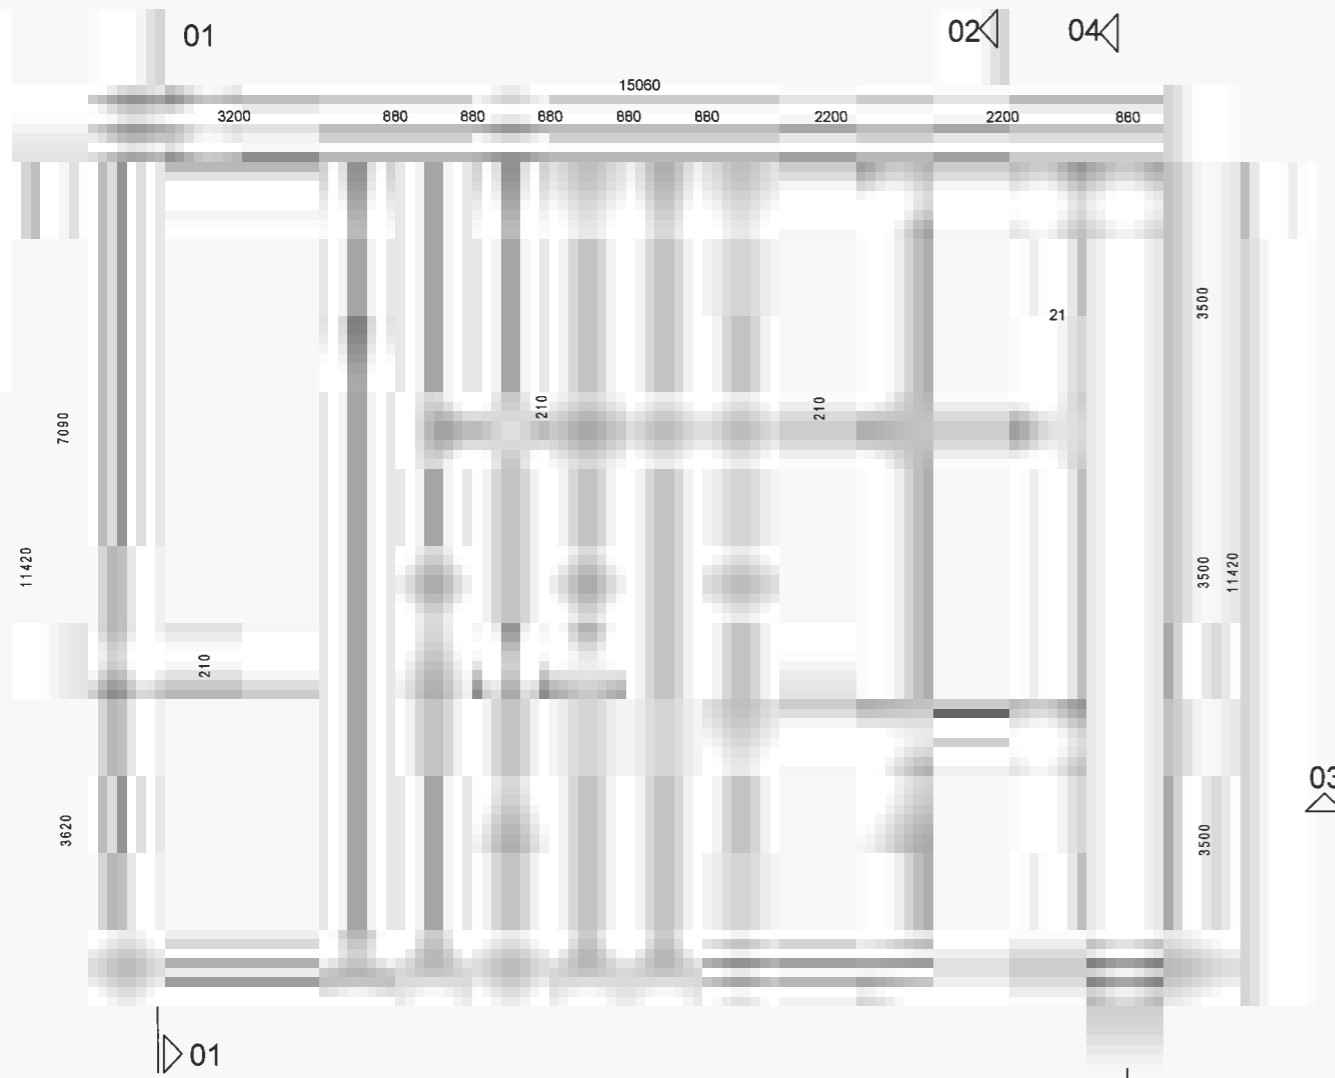


PLAN VIEW
SCALE 1:50



SECTION 01-01
SCALE 1:50

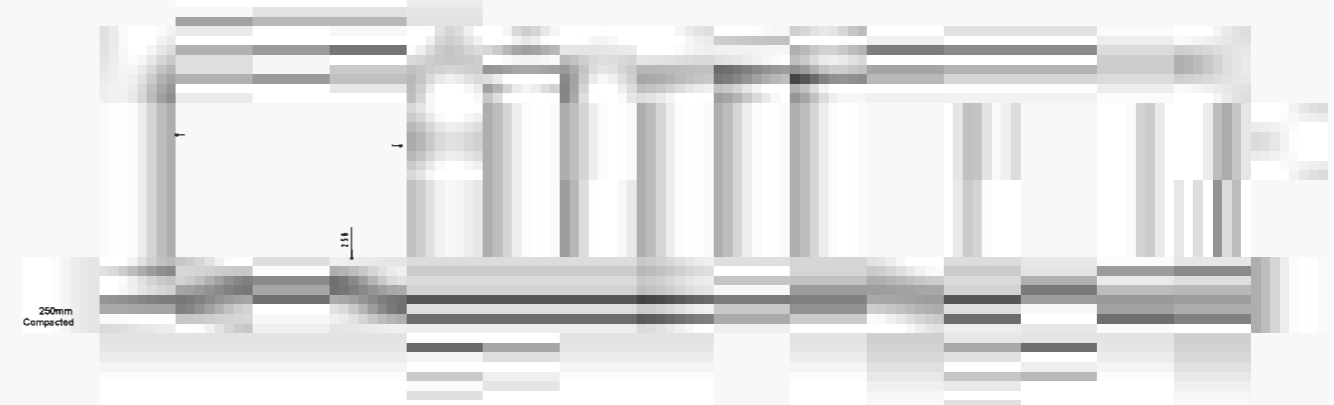

SECTION 03-03
SCALE 1:50

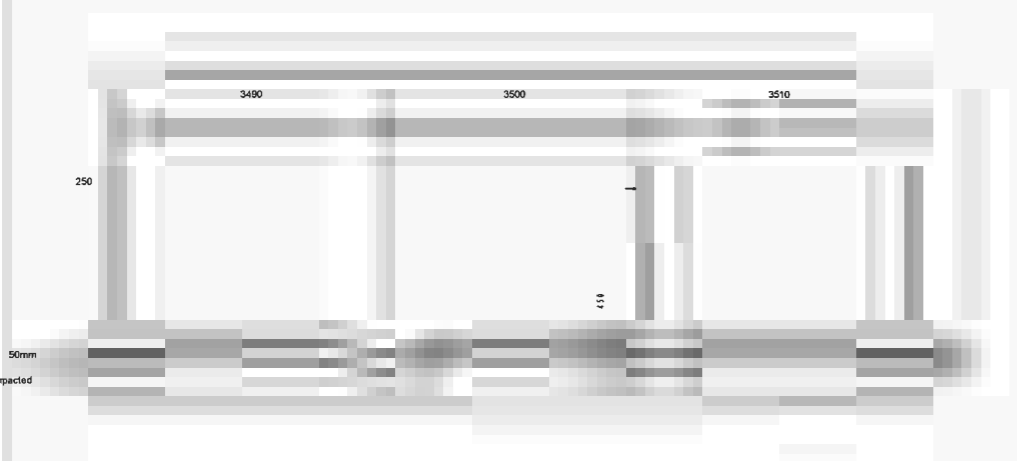

SECTION 02-02
SCALE 1:50



SECTION 04-04
SCALE 1:50

NOTES:

1. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE SHOWN
2. DO NOT SCALE FROM THIS DRAWING
3. THE SCALES GIVEN ON THIS DRAWING REFER TO THE A1 SIZE ORIGINAL DRAWING
4. THE SUBGRADE SHALL BE COMPACTED TO 99% MAXIMUM DRY DENSITY BEFORE THE PLACEMENT OF HARDCORE
5. CONCRETE SHALL BE CLASS C30/37 FOR STRUCTURAL MEMBERS AND CLASS C8/10 FOR BLINDING
6. THE MAXIMUM SIZE OF AGGREGATE SHALL BE 20mm UNLESS OTHERWISE SHOWN
7. REINFORCEMENT SHALL BE HIGH TENSILE DEFORMED TYPE WITH A CHARACTERISTIC YIELD STRESS AT LEAST 429N/mm²
8. COVER TO REINFORCEMENT SHALL BE:
 - FOUNDATIONS 50mm
 - SLABS 25mm
 - WALLS AND BEAMS 30mm
9. LAPS TO ALL REINFORCEMENT SHALL BE 50 * BAR-DIAMETER, SHOWN


DESIGN BY _____
 DRAWN BY _____
 CHECKED BY _____
 APPROVED BY _____
 SHEET NO: _____

SCALE AS SHOWN
 DATE JANUARY-2022
 DRAWING NO. FSTP-105-03-1


PROJECT CONSTRUCTION OF FAECAL SLUDGE TREATMENT PLANTS (FSTP) WORKS IN DAR ES SALAAM
 TITLE FAECAL SLUDGE TREATMENT PLANT - SMALL SIZE (50m³) VIJIBWENI FSTP - INTERGRATED SETTLER, ABR & ANAEROBIC FILTER STRUCTURAL DRAWINGS - PLAN & SECTION GENERAL ARRANGEMENT

REVISION _____
 DATE _____
 NATURE OF REV. _____
 CHECKED BY _____
 APPROVED BY _____


DAR ES SALAAM WATER SUPPLY & SANITATION AUTHORITY (DAWASA)
 TANT
 DOHWA Engineering CO., LTD IN ASSOCIATION WITH LUPTAN CONSULTS LTD AND WWS

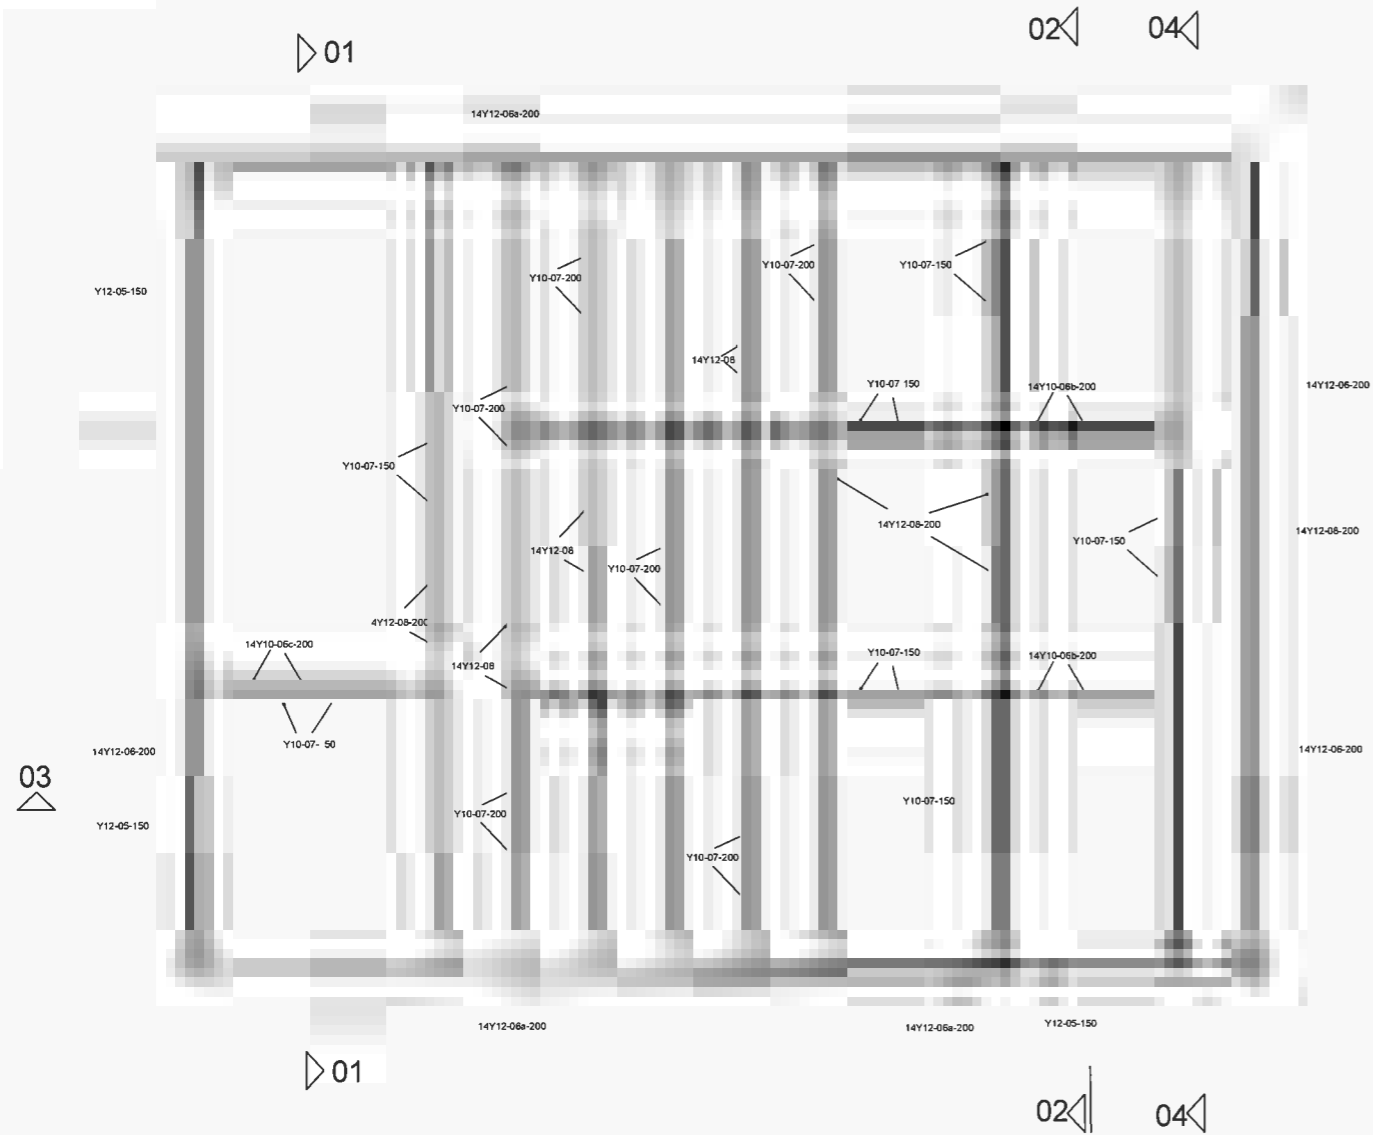

SECTION 01-01
SCALE 1:50

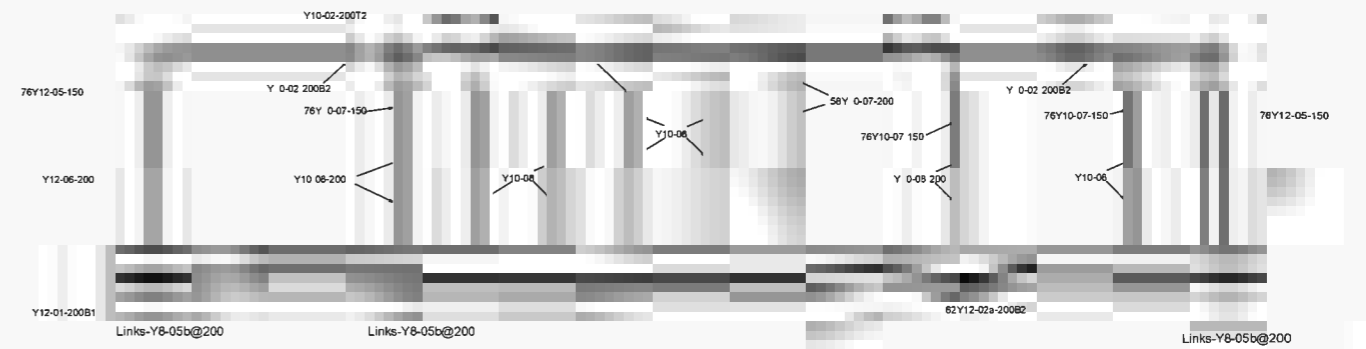

SECTION 03-03
SCALE 1:50

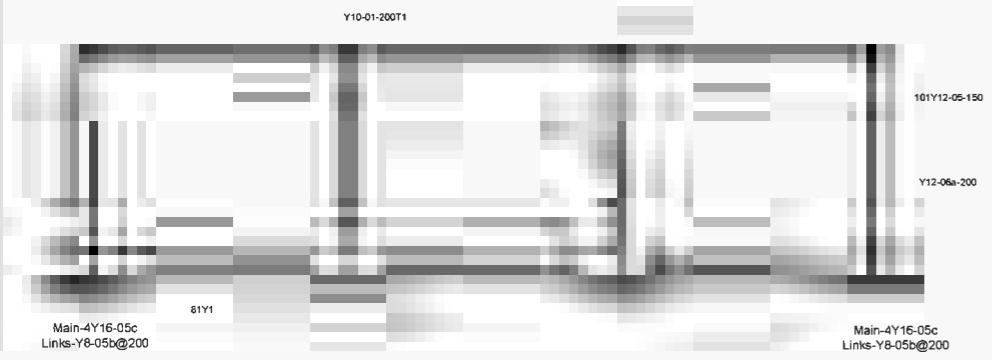

SECTION 02-02
SCALE 1:50



SECTION 04-04
SCALE 1:50

NOTES:

1. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE SHOWN
2. DO NOT SCALE FROM THIS DRAWING
3. THE SCALES GIVEN ON THIS DRAWING REFER TO THE A1 SIZE ORIGINAL DRAWING
4. THE SUBGRADE SHALL BE COMPACTED TO 99% MAXIMUM DRY DENSITY BEFORE THE PLACEMENT OF HARDCORE
5. CONCRETE SHALL BE CLASS C30/37 FOR STRUCTURAL MEMBERS AND CLASS C8/10 FOR BLINDING
6. THE MAXIMUM SIZE OF AGGREGATE SHALL BE 20mm UNLESS OTHERWISE SHOWN
7. REINFORCEMENT SHALL BE HIGH TENSILE DEFORMED TYPE WITH A CHARACTERISTIC YIELD STRESS OF AT LEAST 429N/mm²
8. COVER TO REINFORCEMENT SHALL BE:
 - FOUNDATIONS 50mm
 - SLABS 25mm
 - WALLS AND BEAMS 30mm
9. LAPS TO ALL REINFORCEMENT SHALL BE 50 * BAR DIAMETER SHOWN

DESIGN BY	SCALE	AS SHOWN
DRAWN BY		
CHECKED BY		
APPROVED BY	DATE	JANUARY-2022
SHEET NO:	DRAWING NO	FSTP-106-03-2

PROJECT
CONSTRUCTION OF FAECAL SLUDGE TREATMENT PLANTS (FSTP) WORKS IN DAR ES SALAAM


TITLE
FECAL SLUDGE TREATMENT PLANT - SMALL SIZE (50m³) VIJIBWENI FSTP - INTERGRATED SETTLER, ABR & ANAEROBIC FILTER STRUCTURAL DRAWINGS - FOUNDATION & WALLS REINFORCEMENTS DETAILS

REVISION	
DATE	
NATURE OF REV.	
CHECKED BY	
APPROVED BY	

DAR ES SALAAM WATER SUPPLY & SANITATION AUTHORITY (DAWASA)
CONSULTANT
DOHWA Engineering CO., LTD IN ASSOCIATION WITH LUPTAN CONSULTS LTD AND WWS



Foundation Base reinforcement details

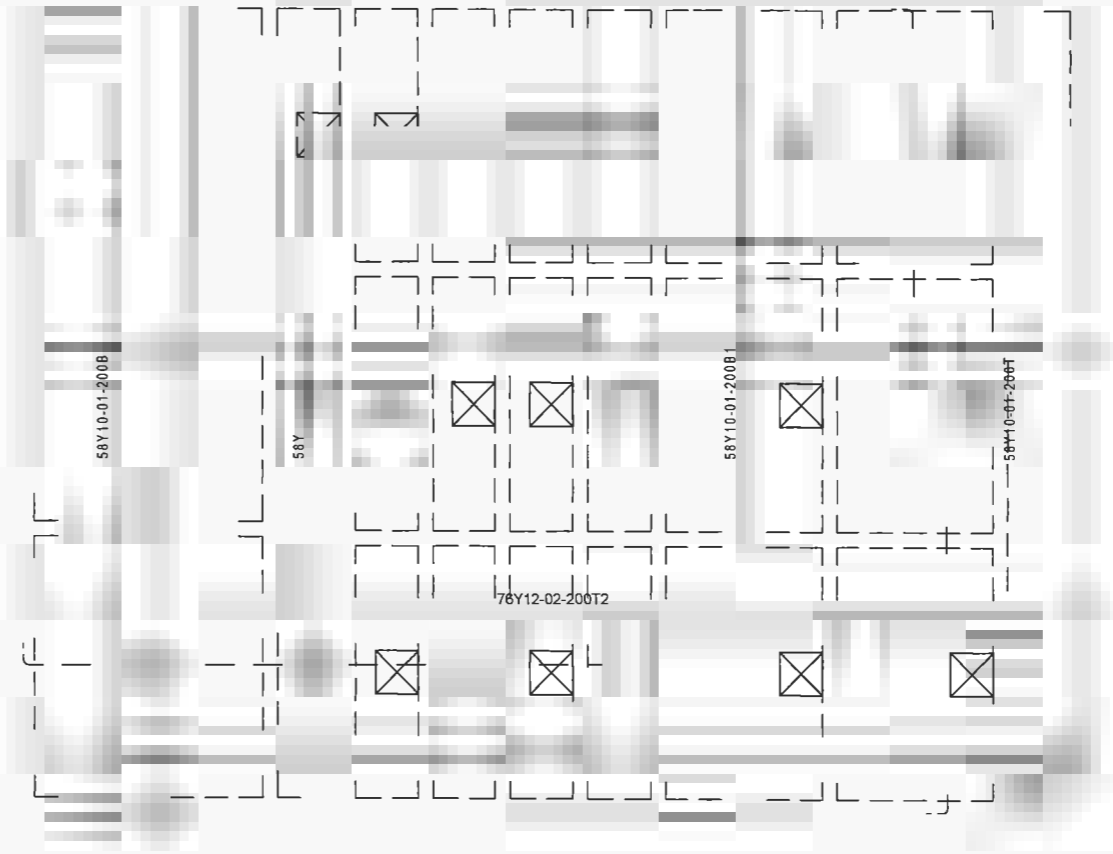

Top slab reinforcement details

NOTES:

1. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE SHOWN
2. DO NOT SCALE FROM THIS DRAWING
3. THE SCALES GIVEN ON THIS DRAWING REFER TO THE A1 SIZE ORIGINAL DRAWING
4. THE SUBGRADE SHALL BE COMPACTED TO 99% MAXIMUM DRY DENSITY BEFORE THE PLACEMENT OF HARDCORE
5. CONCRETE SHALL BE CLASS C30/37 FOR STRUCTURAL MEMBERS AND CLASS C8/10 FOR BLINDING
6. THE MAXIMUM SIZE OF AGGREGATE SHALL BE 20mm UNLESS OTHERWISE SHOWN
7. REINFORCEMENT SHALL BE HIGH TENSILE DEFORMED TYPE WITH A CHARACTERISTIC YIELD STRESS OF AT LEAST 429N/mm²
8. COVER TO REINFORCEMENT SHALL BE:
 - FOUNDATIONS 50mm
 - SLABS 25mm
 - WALLS AND BEAMS 30mm
9. LAPS TO ALL REINFORCEMENT SHALL BE 50 * BAR DIAMETER UNLESS OTHERWISE SHOWN

DESIGN BY	SCALE	AS SHOWN
DRAWN BY		
CHECKED BY		
APPROVED BY	DATE	JANUARY-2022
SHEET NO:	DRAWING NO	FSTP-106-03-3

PROJECT
CONSTRUCTION OF FAECAL SLUDGE TREATMENT PLANTS (FSTP) WORKS IN DAR ES SALAAM

TITLE
FECAL SLUDGE TREATMENT PLANT - SMALL SIZE (50m³) VIJIBWENI FSTP - INTERGRATED SETTLER, ABR & ANAEROBIC FILTER - FOUNDATION BASE & TOP SLAB REINFORCEMENT DETAILS

REVISION	
DATE	
NATURE OF REV.	
CHECKED BY	
APPROVED BY	

DAR ES SALAAM WATER SUPPLY & SANITATION AUTHORITY (DAWASA)
CONSULTANT
DOHWA Engineering CO., LTD IN ASSOCIATION WITH LUPTAN CONSULTS LTD AND WWS

Bar Bending schedule

Member	Mark	Diameter	Total Numbers/Area	Length (mm)	Unit weight (kg/m)	Total weight (kg)	Bar bending shape
Base	01	Y12	81	6750	0.888	468	
	01a	Y12	81	7000	0.888	504	
	02	Y12	62	10250	0.888	565	
	02a	Y12		10000	0.888	551	
Walls	03,03a	Y12	162	6550	0.888	943	
	04	Y12	124	8650	0.888	952	
	05	Y12	708	3500	0.888	2,200	
	06	Y12	112	6350	0.888	632	
	06a	Y12	112	8250	0.888	821	
	06b	Y10	56	9350	0.616	323	
	06c	Y10	28	3650	0.616	63	
	07	Y10	1284	3500	0.616	2,769	
Bott beam	08	Y10	448	6350	0.616	1,753	
	05a	Y16	24	6300	1.578	239	
	05b	Y08	351	1400	0.312	154	
Top Slab	05c	Y16	16	8350	1.578	211	
	01	Y10	232	6350	0.616	907	
	02	Y10	304	8250	0.616	1,545	
Total						15,600	

NOTES:

- ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE SHOWN
- DO NOT SCALE FROM THIS DRAWING
- THE SCALES GIVEN ON THIS DRAWING REFER TO THE A1 SIZE ORIGINAL DRAWING
- THE SUBGRADE SHALL BE COMPACTED TO 99% MAXIMUM DRY DENSITY BEFORE THE PLACEMENT OF HARDCORE
- CONCRETE SHALL BE CLASS C30/37 FOR STRUCTURAL MEMBERS AND CLASS C8/10 FOR BLINDING
- THE MAXIMUM SIZE OF AGGREGATE SHALL BE 20mm UNLESS OTHERWISE SHOWN
- REINFORCEMENT SHALL BE HIGH TENSILE DEFORMED TYPE WITH A CHARACTERISTIC YIELD STRESS OF AT LEAST 429N/mm²
- COVER TO REINFORCEMENT SHALL BE:
 - FOUNDATIONS 50mm
 - SLABS 25mm
 - WALLS AND BEAMS 30mm
- LAPS TO ALL REINFORCEMENT SHALL BE 50 * DIAMETER UNLESS OTHERWISE SHOWN

DESIGN BY
 DRAWN BY
 CHECKED BY
 APPROVED BY
 SHEET NO:


SCALE AS SHOWN
 DATE JANUARY-2022
 DRAWING NO. FSTP-106-03-4

PROJECT
 CONSTRUCTION OF FAECAL SLUDGE TREATMENT PLANTS (FSTP) WORKS IN DAR ES SALAAM

TITLE
 FECAL SLUDGE TREATMENT PLANT - SMALL SIZE (50m³) VIJIBWENI FSTP - INTERGRATED SETTLER, ABR & ANAEROBIC FILTER - REINFORCEMENT DETAILS & BAR BENDING SCHEDULE

REVISION
 DATE
 NATURE OF REV.
 CHECKED BY
 APPROVED BY

DAR ES SALAAM WATER SUPPLY & SANITATION AUTHORITY (DAWASA)
 TANT
 DOHWA Engineering CO., LTD IN ASSOCIATION WITH LUPTAN CONSULTS LTD AND WWS

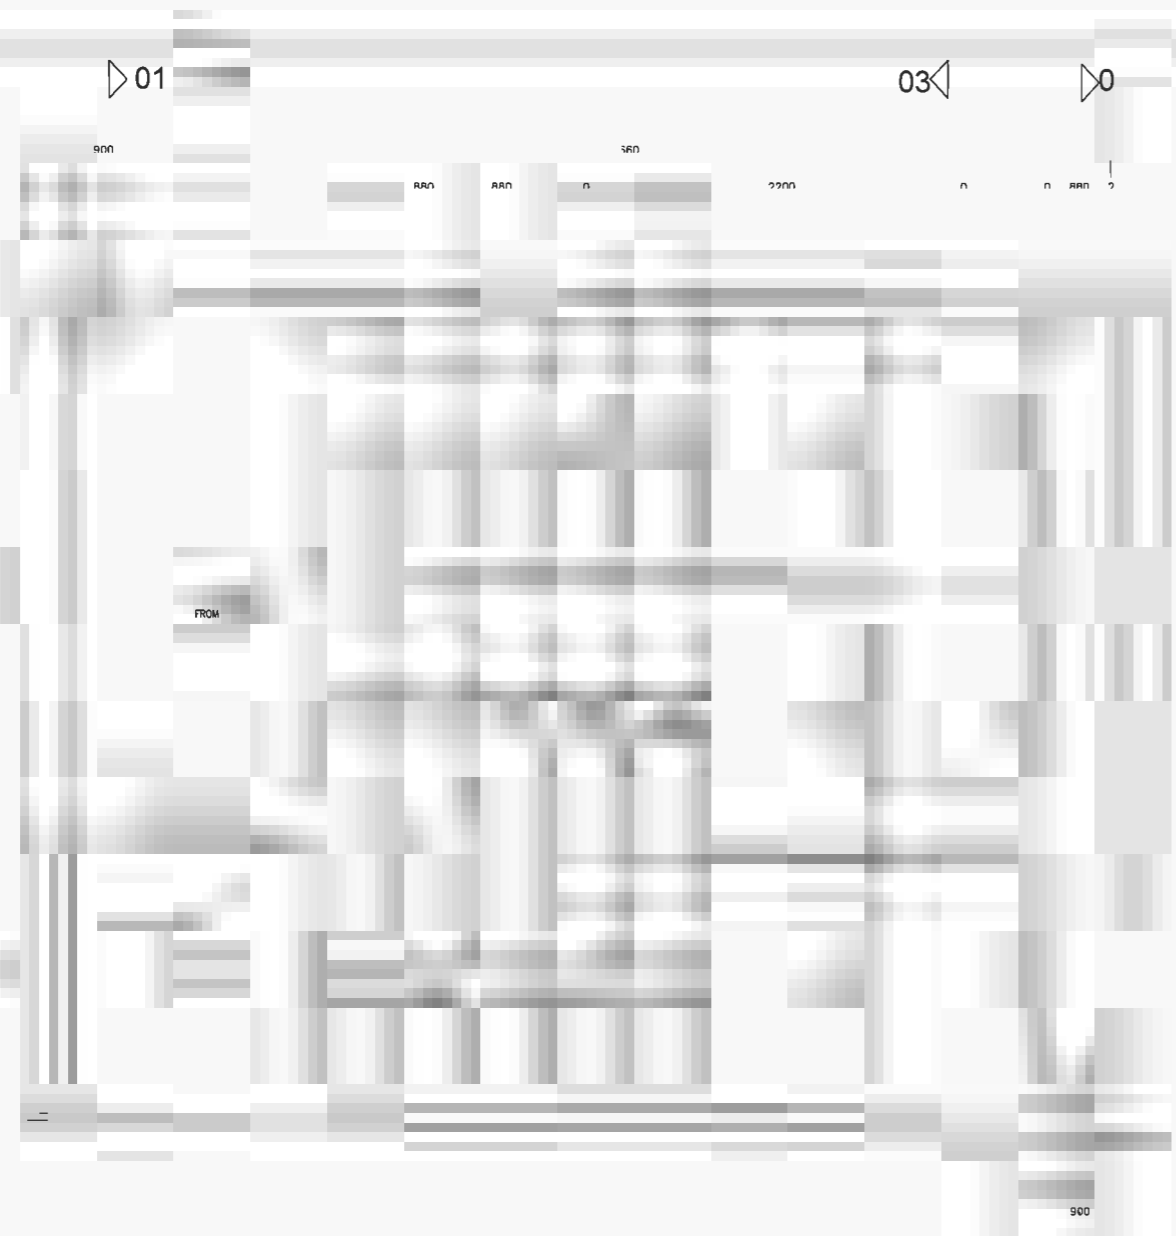

▷ 01 ▷ 02

PLAN VIEW
SCALE 1:50



SECTION 04-04
SCALE 1:50

NOTES:

1. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE SHOWN
2. DO NOT SCALE FROM THIS DRAWING
3. THE SCALES GIVEN ON THIS DRAWING REFER TO THE A1 SIZE ORIGINAL DRAWING
4. THE SUBGRADE SHALL BE COMPACTED TO 99% MAXIMUM DRY DENSITY BEFORE THE PLACEMENT OF HARDCORE
5. CONCRETE SHALL BE CLASS C30/37 FOR STRUCTURAL MEMBERS AND CLASS C8/10 FOR BLINDING
6. THE MAXIMUM SIZE OF AGGREGATE SHALL BE 20mm UNLESS OTHERWISE SHOWN
7. REINFORCEMENT SHALL BE HIGH TENSILE DEFORMED TYPE WITH A CHARACTERISTIC YIELD STRESS OF AT LEAST 429N/mm²
8. COVER TO REINFORCEMENT SHALL BE:
 - FOUNDATIONS 50mm
 - SLABS 25mm
 - WALLS AND BEAMS 30mm
9. LAPS TO ALL REINFORCEMENT SHALL BE 50 * BAR DIAMETER UNLESS OTHERWISE SHOWN



SECTION 01-01
SCALE 1:50











SECTION 03-03
SCALE 1:50

DESIGN BY		SCALE	AS SHOWN
DRAWN BY			
CHECKED BY			
APPROVED BY		DATE	JANUARY-2022
SHEET NO:		DRAWING NO.	FSTP-106-03-A

PROJECT
CONSTRUCTION OF FAECAL SLUDGE TREATMENT PLANTS (FSTP) WORKS IN DAR ES SALAAM

TITLE
FECAL SLUDGE TREATMENT PLANT - SMALL SIZE (50m³) VIJIBWENI FSTP - INTERGRATED SETTLER, ABR & ANAEROBIC FILTER - PLAN VIEW AND SECTIONS GENERAL ARRANGEMENTS

REVISION		DAR ES SALAAM WATER SUPPLY & SANITATION AUTHORITY (DAWASA)
DATE		CONSULTANT
NATURE OF REV.		DOHWA Engineering CO., LTD IN ASSOCIATION WITH LUPTAN CONSULTS LTD AND WWS
CHECKED BY		
APPROVED BY		

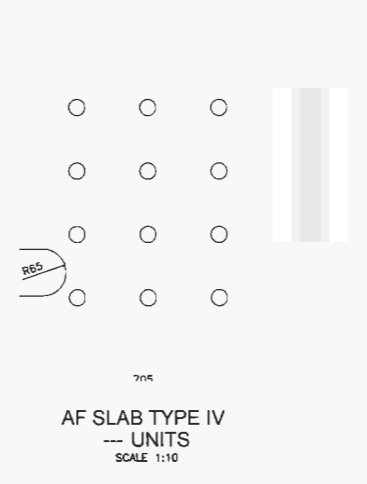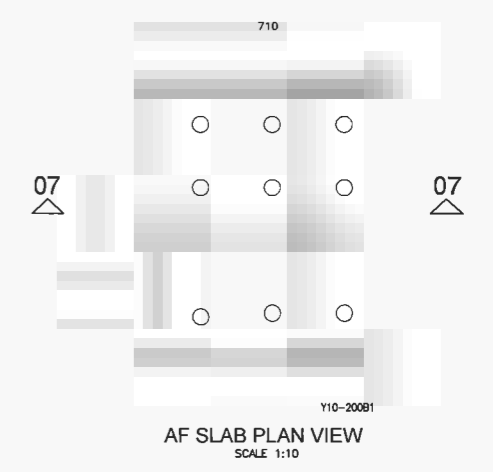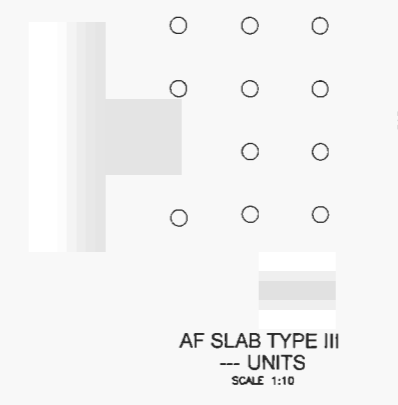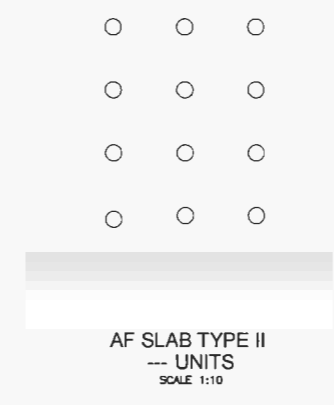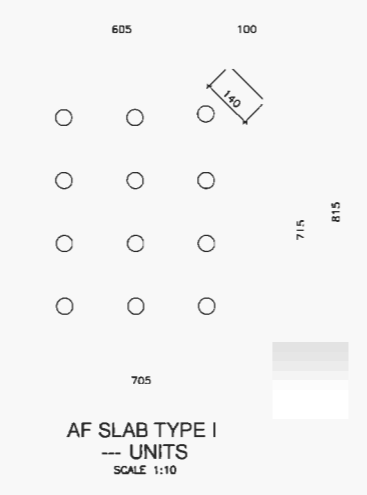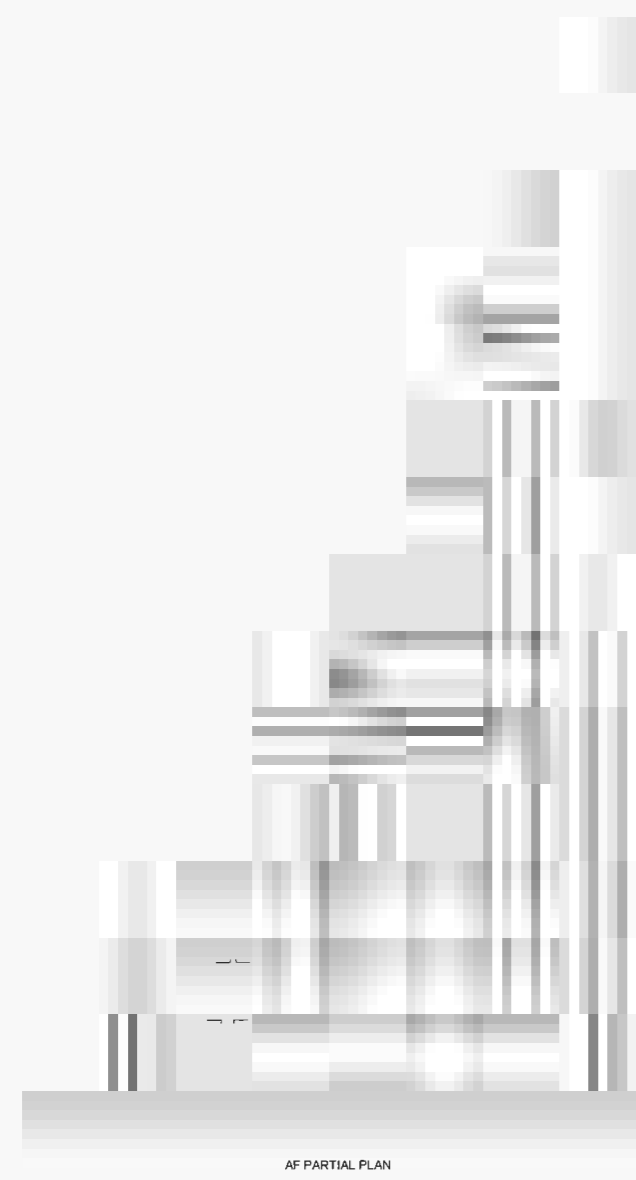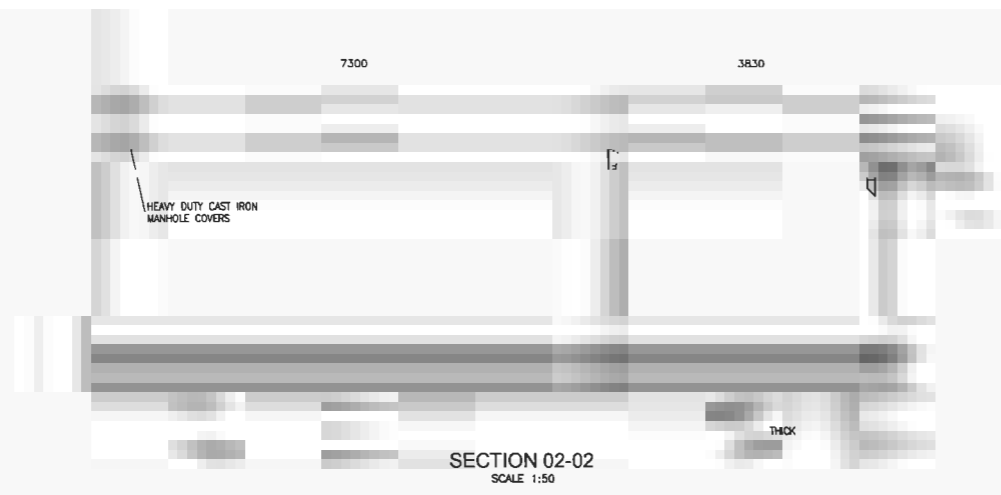


DESIGN BY
 DRAWN BY
 CHECKED BY
 APPROVED BY
 SHEET NO:

SCALE AS SHOWN
 DATE JANUARY-2022
 DRAWING NO. FSTP-106-03-B


PROJECT CONSTRUCTION OF FAECAL SLUDGE TREATMENT PLANTS (FSTP) WORKS IN DAR ES SALAAM
 TITLE FECAL SLUDGE TREATMENT PLANT - SMALL SIZE (50m³) VIJIBWENI FSTP - INTERGRATED SETTLER, ABR & ANAEROBIC FILTER - SECTIONS & FILTERS GENERAL ARRANGEMENTS

REVISION
 DATE
 NATURE OF REV.
 CHECKED BY
 APPROVED BY

DAR ES SALAAM WATER SUPPLY & SANITATION AUTHORITY (DAWASA) CONSULTANT
 DOHWA Engineering CO., LTD IN ASSOCIATION WITH LUPTAN CONSULTS LTD AND WWS

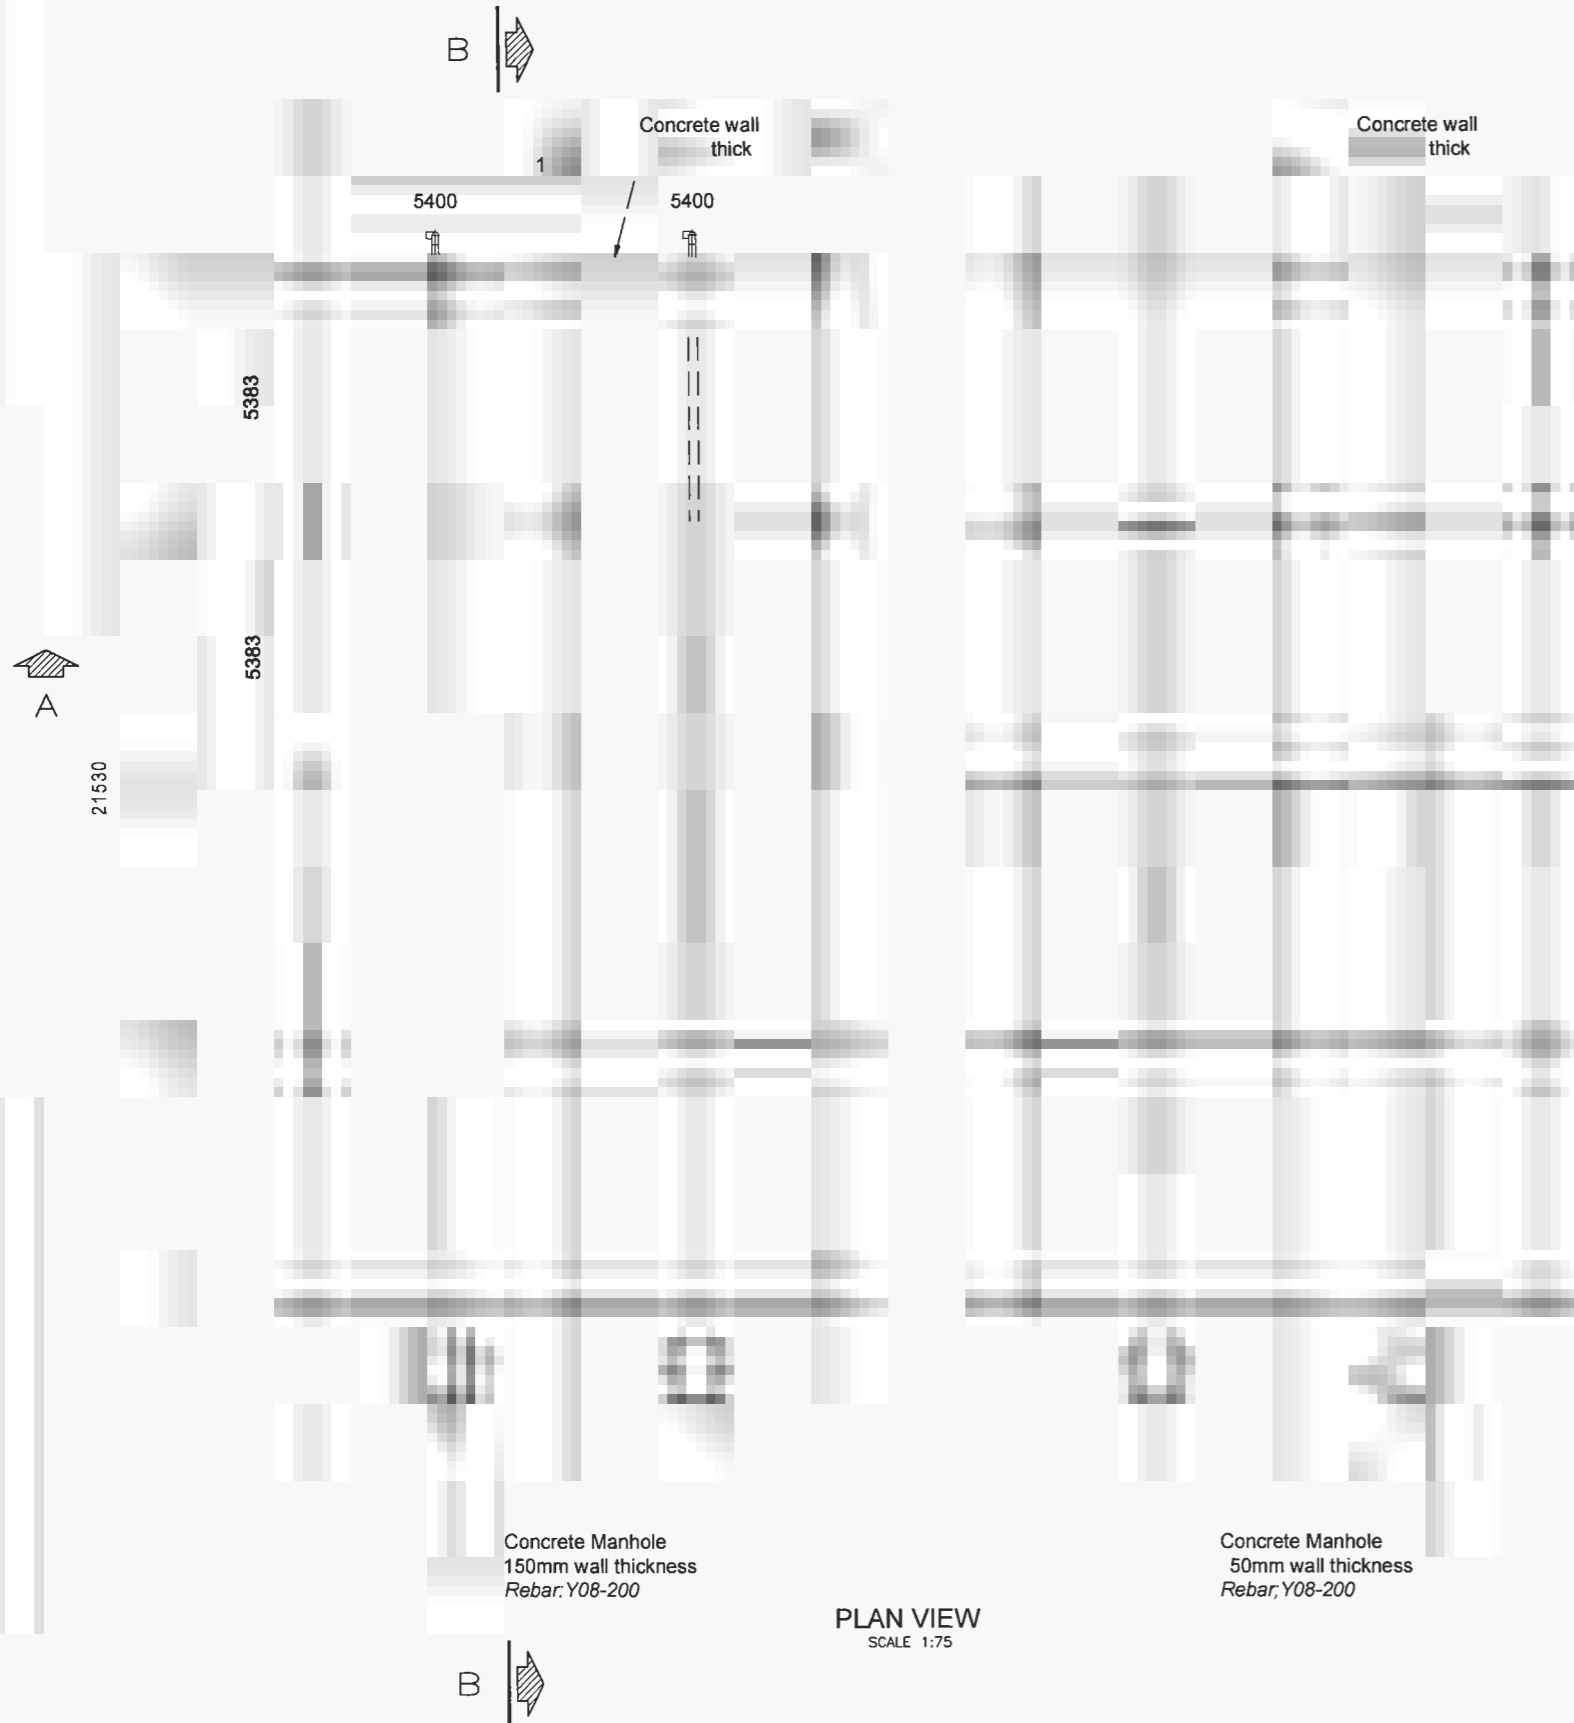

PLAN VIEW
SCALE 1:75

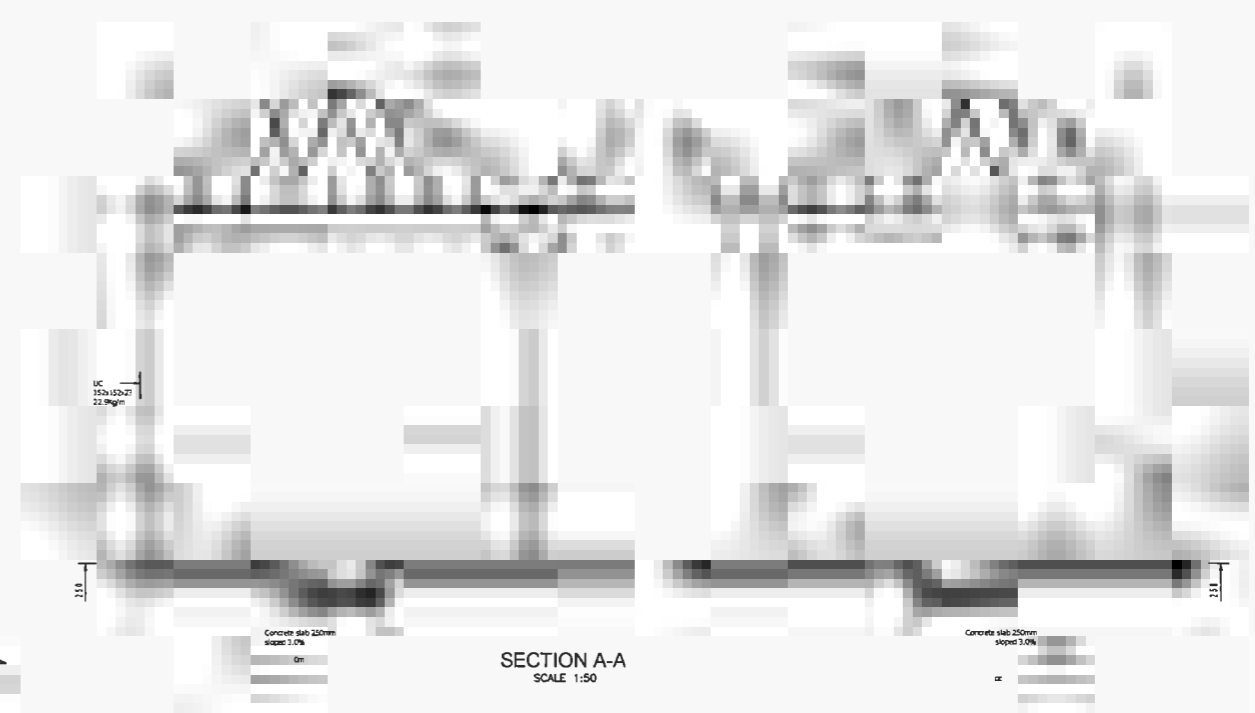

SECTION A-A
SCALE 1:50

NOTES:

1. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE SHOWN
2. DO NOT SCALE FROM THIS DRAWING
3. THE SCALES GIVEN ON THIS DRAWING REFER TO THE A1 SIZE ORIGINAL DRAWING
4. THE SUBGRADE SHALL BE COMPACTED TO 99% MAXIMUM DRY DENSITY BEFORE THE PLACEMENT OF HARD CORE
5. CONCRETE SHALL BE CLASS C30/37 FOR STRUCTURAL MEMBERS AND CLASS C8/10 FOR BLINDING
6. THE MAXIMUM SIZE OF AGGREGATE SHALL BE 20mm UNLESS OTHERWISE SHOWN
7. REINFORCEMENT SHALL BE HIGH TENSILE DEFORMED TYPE WITH A CHARACTERISTIC YIELD STRESS OF AT LEAST 429N/mm²
8. COVER TO REINFORCEMENT SHALL BE:
 - FOUNDATIONS 50mm
 - SLABS 25mm
 - WALLS AND BEAMS 30mm
9. LAPS TO ALL REINFORCEMENT SHALL BE 50 * BAR DIAMETER UNLESS OTHERWISE SHOWN

DESIGN BY _____
 DRAWN BY _____
 CHECKED BY _____
 APPROVED BY _____
 SHEET NO: _____



SCALE AS SHOWN
 DATE JANUARY-2022
 DRAWING NO. FSTP-106-03-2

PROJECT CONSTRUCTION OF FAECAL SLUDGE TREATMENT PLANTS (FSTP) WORKS IN DAR ES SALAAM

TITLE FECAL SLUDGE TREATMENT PLANT - SMALL SIZE (50m³) VIJIBWENI FSTP - UNPLANTED DRYING BEDS
 STRUCTURAL DRAWINGS - GENERAL ARRANGEMENTS DETAILS


REVISION _____
 DATE _____
 NATURE OF REV. _____
 CHECKED BY _____
 APPROVED BY _____

DAR ES SALAAM WATER SUPPLY & SANITATION AUTHORITY
 (DAWASA)
 CONSULTANT
 DOHWA Engineering CO., LTD IN ASSOCIATION
 WITH LUPTAN CONSULTS LTD AND WWS

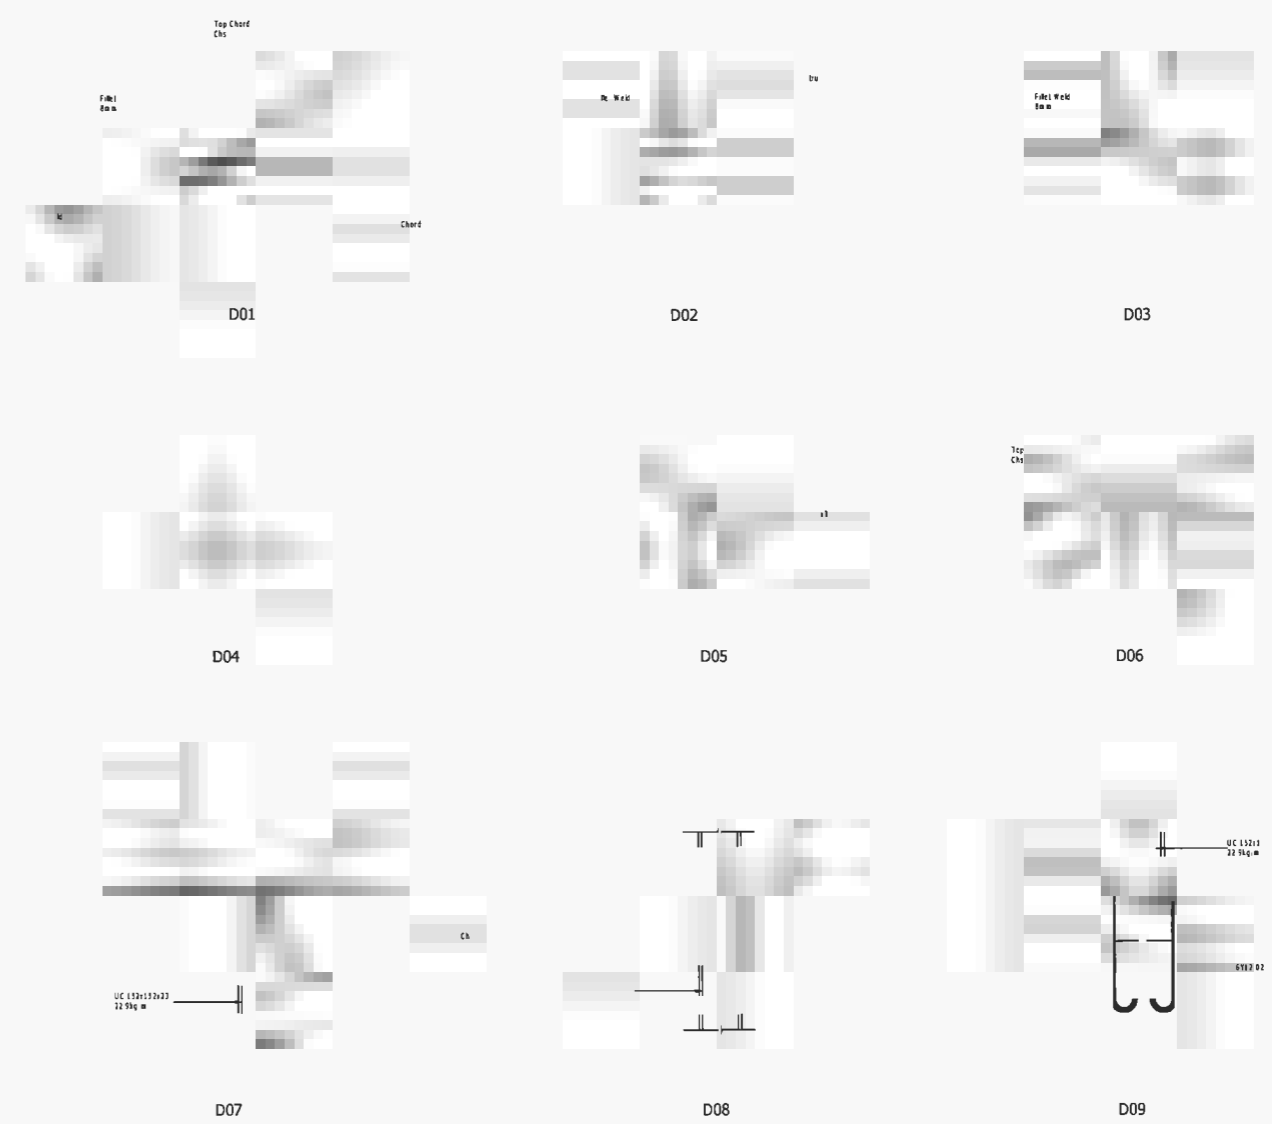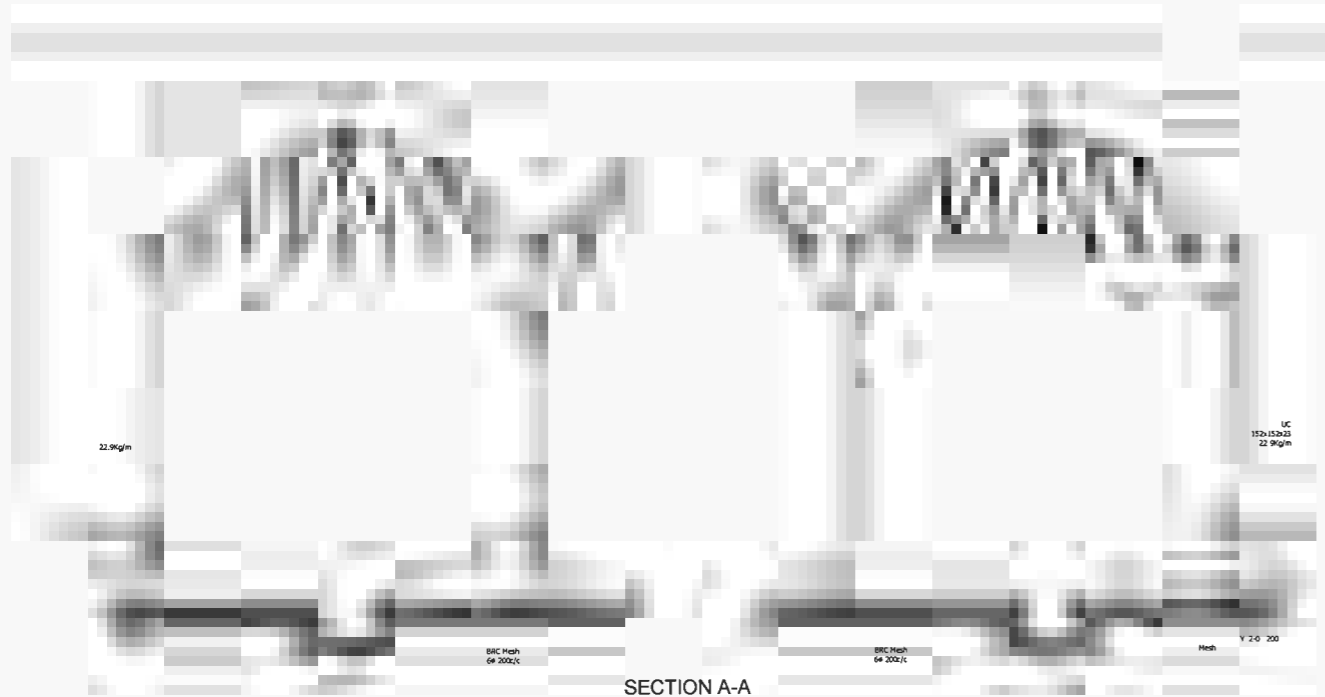

BAR BENDING SCHEDULE

Mark	Diameter	Total Numbers/Area	Length (mm)	Unit weight (kg/m)	Total weight (kg)	Bar bending shape
01	Y12	168	1250	0.888	187	
02	Y12	72	1750	0.888	112	
03	Y08	84	1110	0.312	29	
BRC Mesh	R06	124sqm		2.22kg/m ²	275	
					Total per unit	603
					Nos of Units	4
					Total	2,412

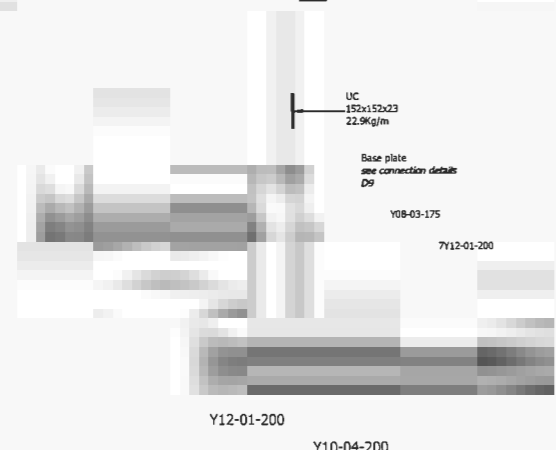

TYPICAL STEP SECTION DETAILS SCALE 1:25



DETAILS TYPICAL WALL SECTION SCALE 1:25

CONNECTION DETAILS SCALE 1:10

NOTES:

- ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE SHOWN
- DO NOT SCALE FROM THIS DRAWING
- THE SCALES GIVEN ON THIS DRAWING REFER TO THE A1 SIZE ORIGINAL DRAWING
- THE SUBGRADE SHALL BE COMPACTED TO 99% MAXIMUM DRY DENSITY BEFORE THE PLACEMENT OF HARDCORE
- CONCRETE SHALL BE CLASS C30/37 FOR STRUCTURAL MEMBERS AND CLASS C8/10 FOR BLINDING
- THE MAXIMUM SIZE OF AGGREGATE SHALL BE 20mm UNLESS OTHERWISE SHOWN
- REINFORCEMENT SHALL BE HIGH TENSILE DEFORMED TYPE WITH A CHARACTERISTIC YIELD STRESS OF AT LEAST 429N/mm²
- COVER TO REINFORCEMENT SHALL BE:
 - FOUNDATIONS 50mm
 - SLABS 25mm
 - WALLS AND BEAMS 30mm
- LAPS TO ALL REINFORCEMENT SHALL BE 50 * BAR DIAMETER UNLESS OTHERWISE SHOWN


DESIGN BY
DRAWN BY
CHECKED BY
APPROVED BY
SHEET NO:

SCALE AS SHOWN
DATE JANUARY-2022
DRAWING NO. FSTP-106-04-2

PROJECT CONSTRUCTION OF FAECAL SLUDGE TREATMENT PLANTS (FSTP) WORKS IN DAR ES SALAAM
TITLE FECAL SLUDGE TREATMENT PLANT - SMALL SIZE (50m³) VIJIBWENI FSTP - UNPLANTED DRYING BEDS
STRUCTURAL DRAWINGS - REINFORCEMENTS DETAILS, STEEL CONNECTION & FOUNDATION DETAILS

REVISION
DATE
NATURE OF REV.
CHECKED BY
APPROVED BY

DAR ES SALAAM WATER SUPPLY & SANITATION AUTHORITY (DAWASA)
CONSULTANT
DOHWA Engineering CO., LTD IN ASSOCIATION WITH LUPTAN CONSULTS LTD AND WWS

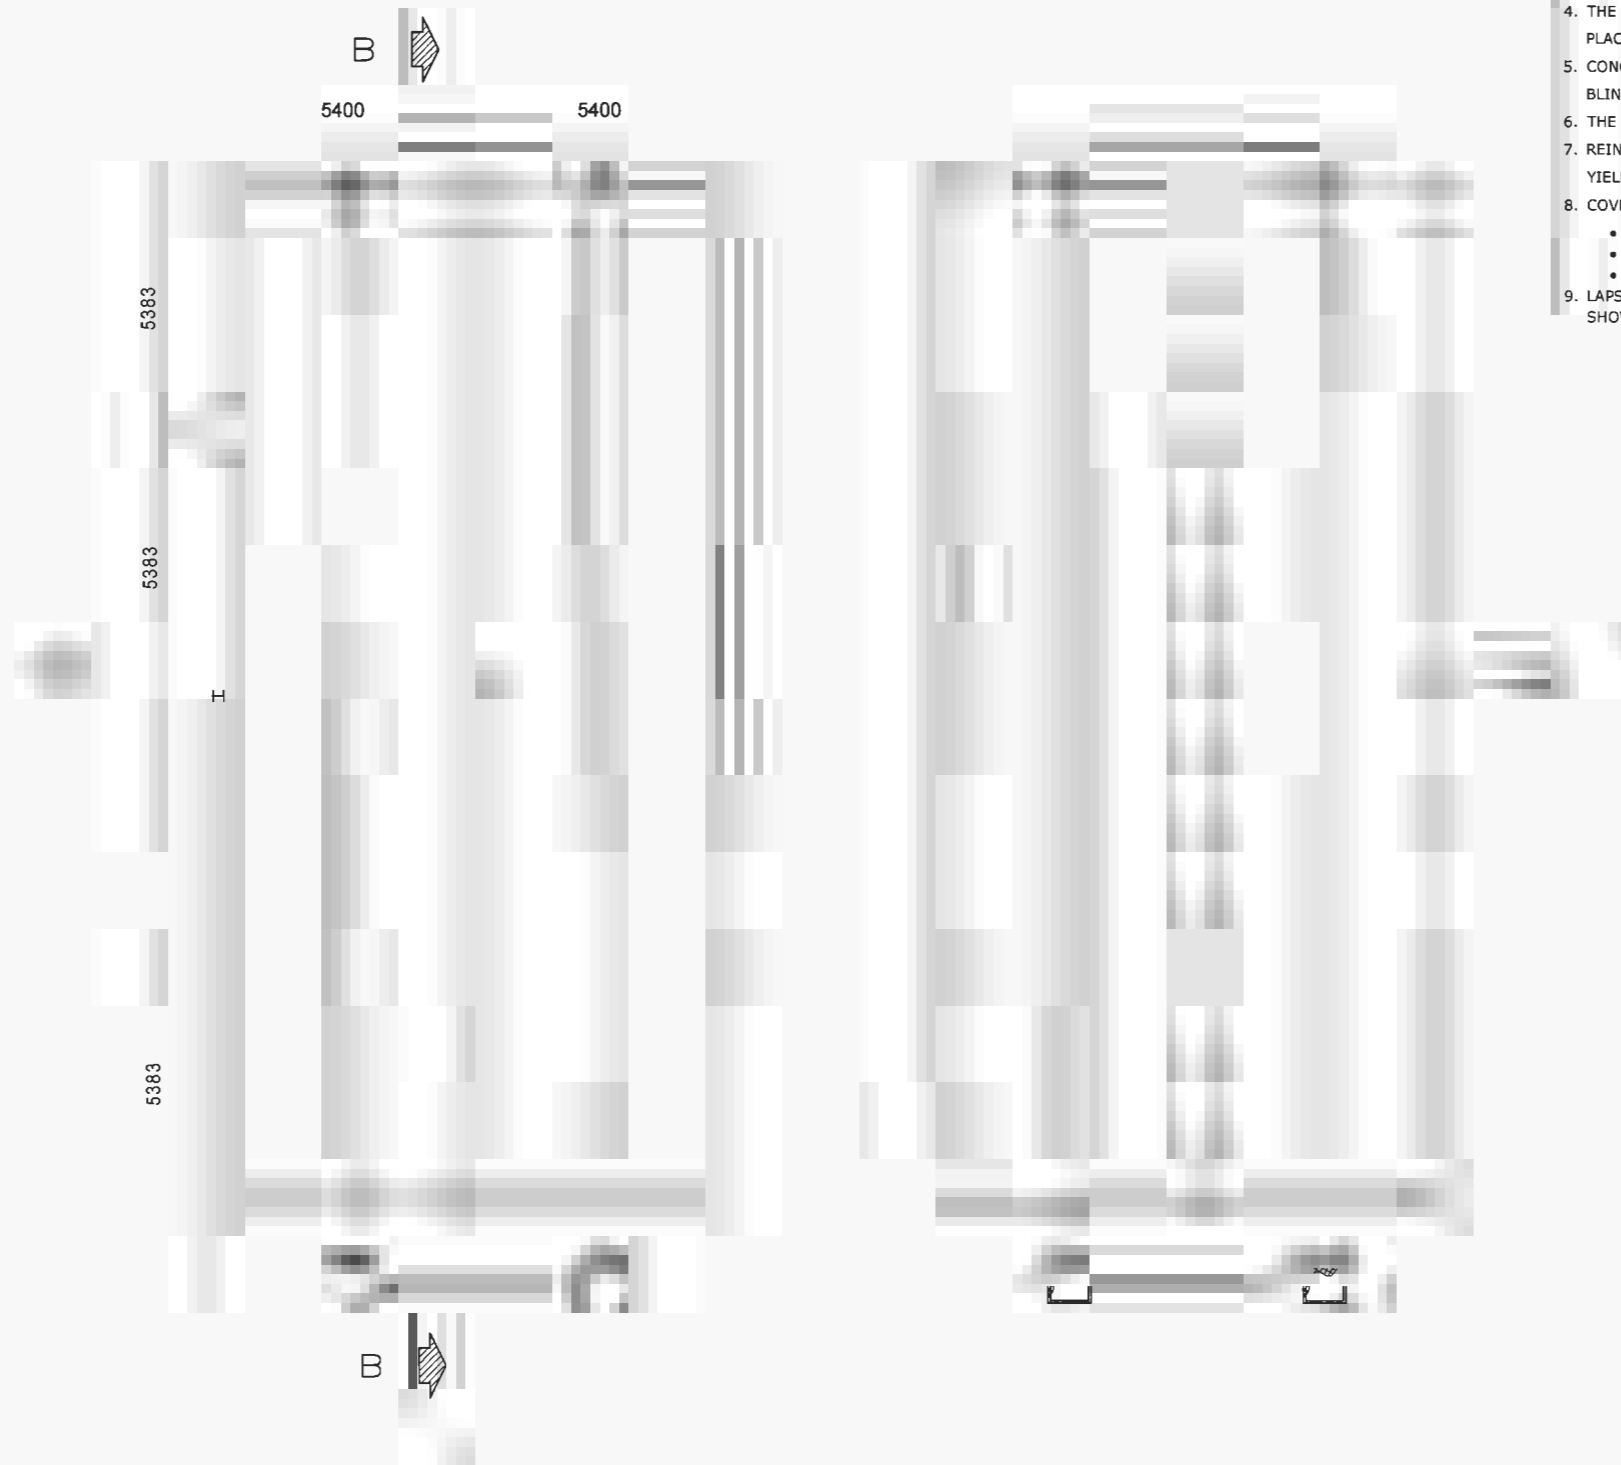

NOTES:

1. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE SHOWN
2. DO NOT SCALE FROM THIS DRAWING
3. THE SCALES GIVEN ON THIS DRAWING REFER TO THE A1 SIZE ORIGINAL DRAWING
4. THE SUBGRADE SHALL BE COMPACTED TO 99% MAXIMUM DRY DENSITY BEFORE THE PLACEMENT OF HARDCORE
5. CONCRETE SHALL BE CLASS C30/37 FOR STRUCTURAL MEMBERS AND CLASS C8/10 FOR BLINDING
6. THE MAXIMUM SIZE OF AGGREGATE SHALL BE 20mm UNLESS OTHERWISE SHOWN
7. REINFORCEMENT SHALL BE HIGH TENSILE DEFORMED TYPE WITH A CHARACTERISTIC YIELD STRESS OF AT LEAST 429N/mm²
8. COVER TO REINFORCEMENT SHALL BE:
 - FOUNDATIONS 50mm
 - SLABS 25mm
 - WALLS AND BEAMS 30mm
9. LAPS TO ALL REINFORCEMENT SHALL BE 50 * BAR DIAMETER UNLESS OTHERWISE SHOWN

X
△

DESIGN BY _____
 DRAWN BY _____ SCALE 1:75
 CHECKED BY _____
 APPROVED BY _____ DATE JANUARY-2022
 SHEET NO: _____ DRAWING NO. FSTP-106-04-A

PROJECT CONSTRUCTION OF FAECAL SLUDGE TREATMENT PLANTS (FSTP) WORKS IN DAR ES SALAAM
 TITLE FECAL SLUDGE TREATMENT PLANT - SMALL SIZE (50m³) VIJIBWENI FSTP - UNPLANTED DRYING BEDS (UDB) PLAN VIEW GENERAL ARRANGEMENT

REVISION _____
 DATE _____
 NATURE OF REV. _____
 CHECKED BY _____
 APPROVED BY _____

DAR ES SALAAM WATER SUPPLY & SANITATION AUTHORITY (DAWASA)
 CONSUL
 DOHWA Engineering CO., LTD IN ASSOCIATION WITH LUPTAN CONSULTS LTD AND WWS

B 


21.95
21.10



NOTES:

1. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE SHOWN
2. DO NOT SCALE FROM THIS DRAWING
3. THE SCALES GIVEN ON THIS DRAWING REFER TO THE A1 SIZE ORIGINAL DRAWING
4. THE SUBGRADE SHALL BE COMPACTED TO 99% MAXIMUM DRY DENSITY BEFORE THE PLACEMENT OF HARDCORE
5. CONCRETE SHALL BE CLASS C30/37 FOR STRUCTURAL MEMBERS AND CLASS C8/10 FOR BLINDING
6. THE MAXIMUM SIZE OF AGGREGATE SHALL BE 20mm UNLESS OTHERWISE SHOWN
7. REINFORCEMENT SHALL BE HIGH TENSILE DEFORMED TYPE WITH A CHARACTERISTIC YIELD STRESS OF AT LEAST 429N/mm²
8. COVER TO REINFORCEMENT SHALL BE:
 - FOUNDATIONS 50mm
 - SLABS 25mm
 - WALLS AND BEAMS 30mm
9. LAPS TO ALL REINFORCEMENT SHALL BE 50 * BAR DIAMETER UNLESS OTHERWISE SHOWN

SECTION B-B

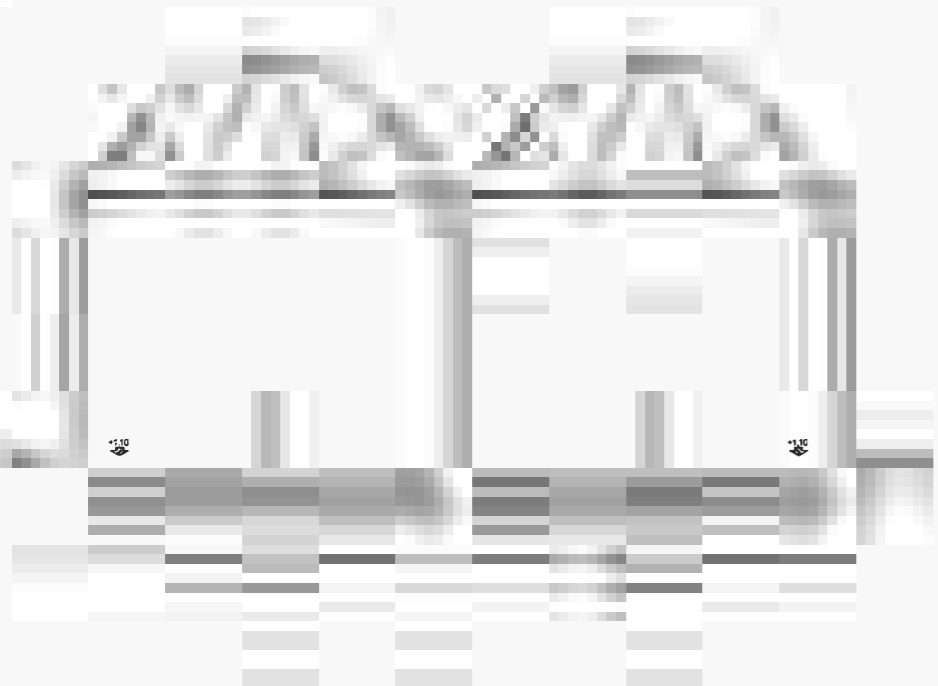

SECTION A-A



LEGEND:

- DRYING BEDS FOR FSTP**
- ① SLUDGE FEEDING PIPE
 - ② SLUDGE FEEDING PIPE
 - ③ SLUDGE FEEDING GATE VALVE
 - ④ DRAIN COLLECTION PERFORATED PIPE
 - ⑤ REMOVABLE PLATE
 - ⑥ LIGHT METALLIC STRUCTURE AND SEMI TRANSPARENT ROOF COVER
 - ⑦ COATED MILD STEEL COLUMN - I SECTION
 - ⑧ GRAVEL BOTTOM LAYER - H=0.2m, GRAVEL Ø 15-30mm
 - ⑨ INTERMEDIATE SAND LAYER - H=0.1m, SAND Ø 7-15mm
 - ⑩ TOP SAND LAYER H=0.1m, SAND Ø 0.2-0.6mm
 - ⑪ WET SLUDGE LAYER H=0.4m
 - ⑫ LEACHATE OUTLET PIPE

DESIGN BY
DRAWN BY
CHECKED BY
APPROVED BY
SHEET NO:

SCALE 1:50
DATE JANUARY-2022
DRAWING NO. FSTP-106-04-A

PROJECT CONSTRUCTION OF FAECAL SLUDGE TREATMENT PLANTS (FSTP) WORKS IN DAR ES SALAAM
TITLE FECAL SLUDGE TREATMENT PLANT - SMALL SIZE (50m²) VIJIBWENI FSTP - UNPLANTED DRYING BEDS (UDB) SECTIONS GENERAL ARRANGEMENT

REVISION
DATE
NATURE OF REV
CHECKED BY
APPROVED BY

DAR ES SALAAM WATER SUPPLY & SANITATION AUTHORITY (DAWASA) CONSULTANT
DOHWA Engineering CO., LTD IN ASSOCIATION WITH LUPTAN CONSULTS LTD AND WWS





NOTES:

1. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE SHOWN
2. DO NOT SCALE FROM THIS DRAWING
3. THE SCALES GIVEN ON THIS DRAWING REFER TO THE A1 SIZE ORIGINAL DRAWING
4. THE SUBGRADE SHALL BE COMPACTED TO 99% MAXIMUM DRY DENSITY BEFORE THE PLACEMENT OF HARDCORE
5. ALL PIPES ARE PVC DN110, PN6

PLAN VIEW
SCALE 1:50

DESIGN BY
DRAWN BY
CHECKED BY
APPROVED BY
SHEET NO:

SCALE AS SHOWN
DATE JANUARY-2022
DRAWING NO. FSTP-106-05-1

PROJECT CONSTRUCTION OF FAECAL SLUDGE TREATMENT PLANTS (FSTP) WORKS IN DAR ES SALAAM
TITLE FECAL SLUDGE TREATMENT PLANT - SMALL SIZE (50m³) VIJIBWENI FSTP - PLANTED GRAVEL FILTER - PLAN VIEW GENERAL ARRANGEMENT DETAILS

REVISION
DATE
NATURE OF REV.
CHECKED BY
APPROVED BY

CLIENT
DAR ES SALAAM WATER SUPPLY & SANITATION AUTHORITY (DAWASA)
CONSULTANT
DOHWA Engineering CO., LTD IN ASSOCIATION WITH LUPTAN CONSULTS LTD AND WWS

DETAIL 1

641



DETAIL 2

SECTION X - X
SCALE 1:25



SECTION Y - Y
SCALE 1:25



NOTES:

1. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS
2. DO NOT SCALE FROM THIS DRAWING
3. THE SCALES GIVEN ON THIS DRAWING REFER TO THE A1 SIZE ORIGINAL DRAWING
4. THE SUBGRADE SHALL BE COMPACTED TO 99% MAXIMUM DRY DENSITY BEFORE THE PLACEMENT OF HARDCORE
5. ALL PIPES ARE PVC DN110, PN6

DESIGN BY
DRAWN BY
CHECKED BY
APPROVED BY
SHEET NO:



SCALE
AS SHOWN
DATE
JANUARY-2022
DRAWING NO.
FSTP-106-05-2

PROJECT
CONSTRUCTION OF FAECAL SLUDGE TREATMENT PLANTS (FSTP) WORKS IN DAR ES SALAAM

TITLE
FECAL SLUDGE TREATMENT PLANT - SMALL SIZE (50m³) VIJIBWENI FSTP - PLANTED GRAVEL FILTER - SECTIONS GENERAL ARRANGEMENT DETAILS

REVISION
DATE
NATURE OF REV.
CHECKED BY
APPROVED BY

DAR ES SALAAM WATER SUPPLY & SANITATION AUTHORITY (DAWASA)
CONSULTANT
DOHWA Engineering CO., LTD IN ASSOCIATION WITH LUPTAN CONSULTS LTD AND WWS

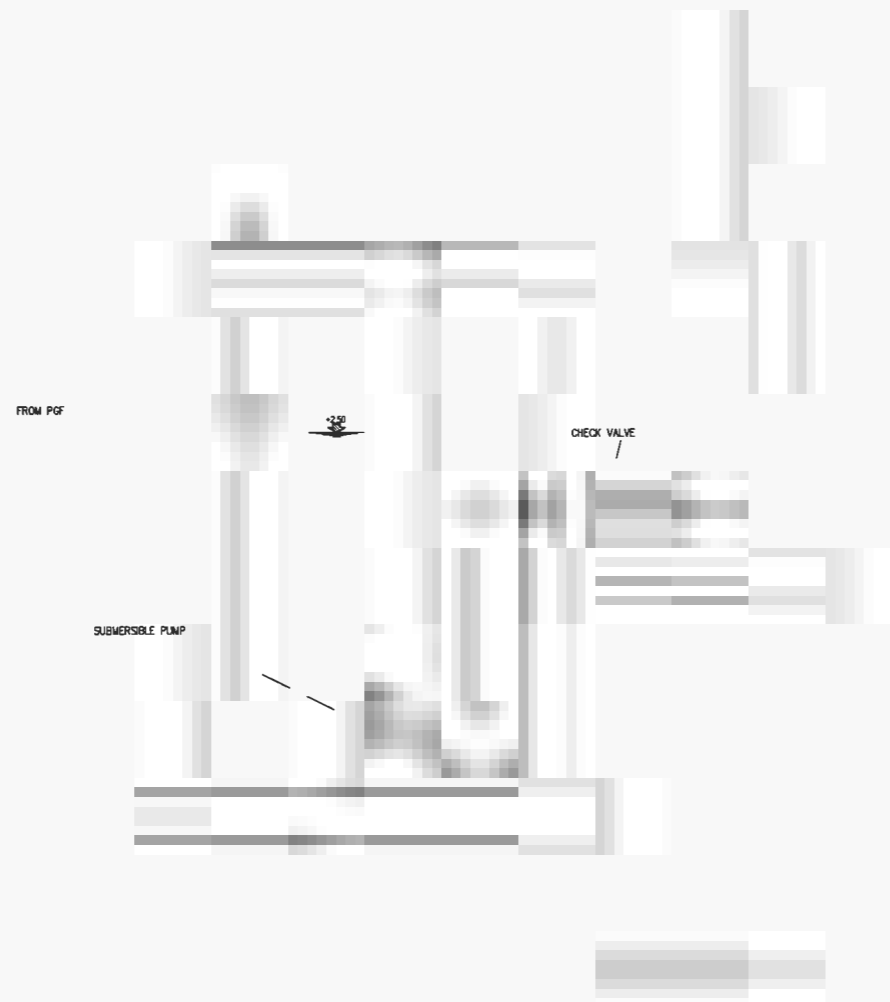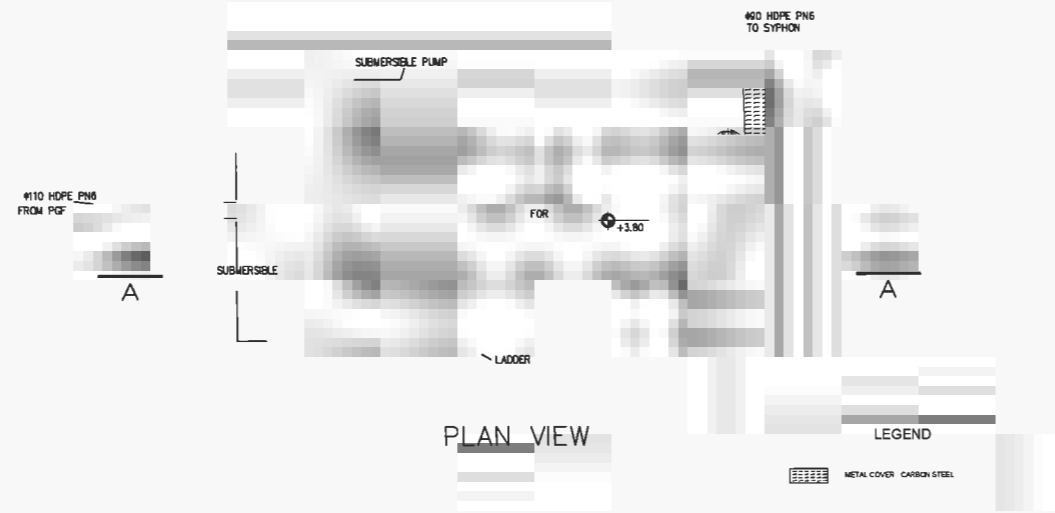

NOTES:

1. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE SHOWN
2. DO NOT SCALE FROM THIS DRAWING
3. THE SCALES GIVEN ON THIS DRAWING REFER TO THE A1 SIZE ORIGINAL DRAWING
4. THE SUBGRADE SHALL BE COMPACTED TO 99% MAXIMUM DRY DENSITY BEFORE THE PLACEMENT OF HARDCORE
5. CONCRETE SHALL BE CLASS C30/37 FOR STRUCTURAL MEMBERS AND CLASS C8/10 FOR BLINDING
6. THE MAXIMUM SIZE OF AGGREGATE SHALL BE 20mm UNLESS OTHERWISE SHOWN
7. REINFORCEMENT SHALL BE HIGH TENSILE DEFORMED TYPE WITH A CHARACTERISTIC YIELD STRESS OF AT LEAST 429N/mm²
8. COVER TO REINFORCEMENT SHALL BE:
 - FOUNDATIONS 50mm
 - SLABS 25mm
 - WALLS AND BEAMS 30mm
9. LAPS TO ALL REINFORCEMENT SHALL BE 50 * BAR DIAMETER UNLESS OTHERWISE SHOWN

DESIGN BY _____
 DRAWN BY _____
 CHECKED BY _____
 APPROVED BY _____
 SHEET NO: _____

SCALE 1:25

DATE JANUARY-2022

DRAWING NO. FSTP-106-06

PROJECT
 CONSTRUCTION OF FAECAL SLUDGE TREATMENT PLANTS (FSTP) WORKS IN DAR ES SALAAM

FECAL SLUDGE TREATMENT PLANT - SMALL SIZE (50m³) VIJIBWENI FSTP - PUMP STATION - PLAN & SECTION GENERAL ARRANGEMENT DETAILS

REVISION _____


DATE _____

NATURE OF REV. _____




CHECKED BY _____

APPROVED BY _____


DAR ES SALAAM WATER SUPPLY & SANITATION AUTHORITY (DAWASA)
 CONSULTANT
 DOHWA Engineering CO., LTD IN ASSOCIATION WITH LUPTAN CONSULTS LTD AND WWS

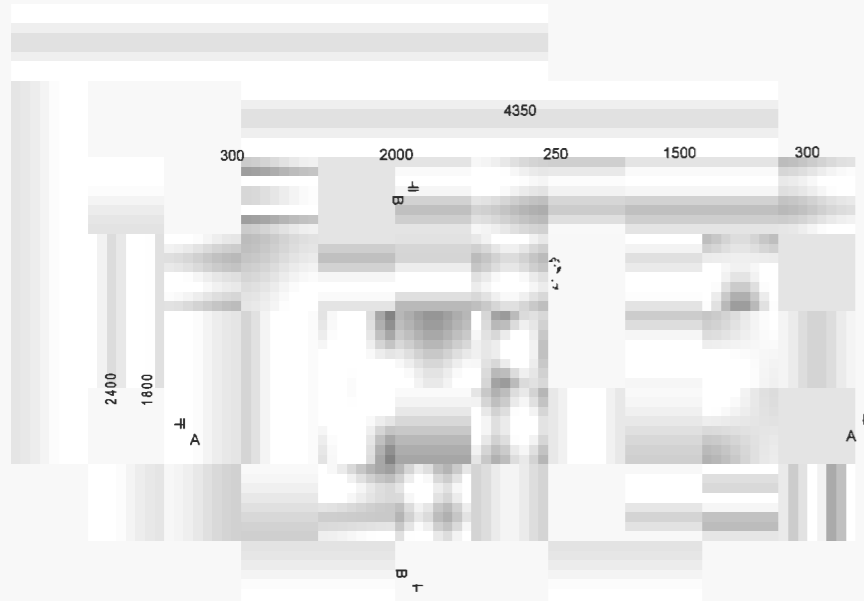

Plan

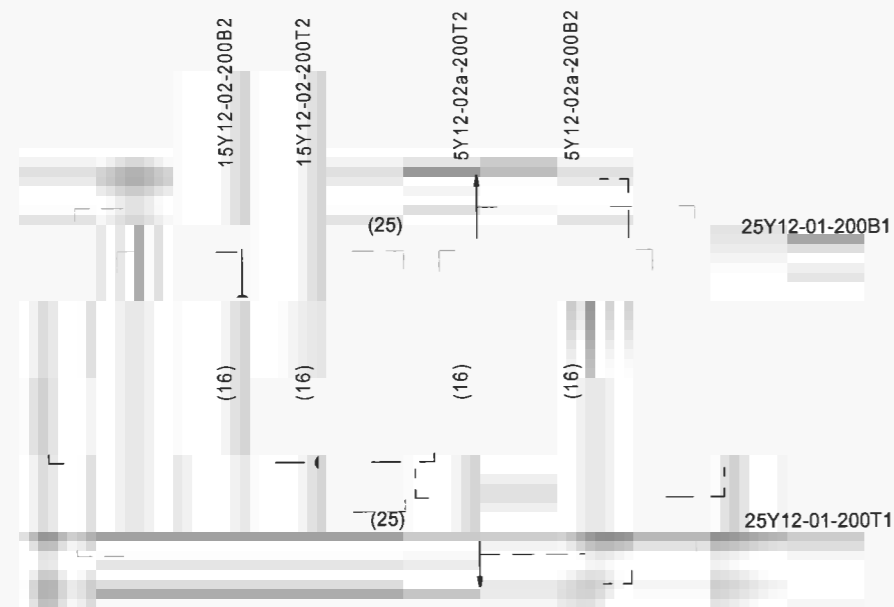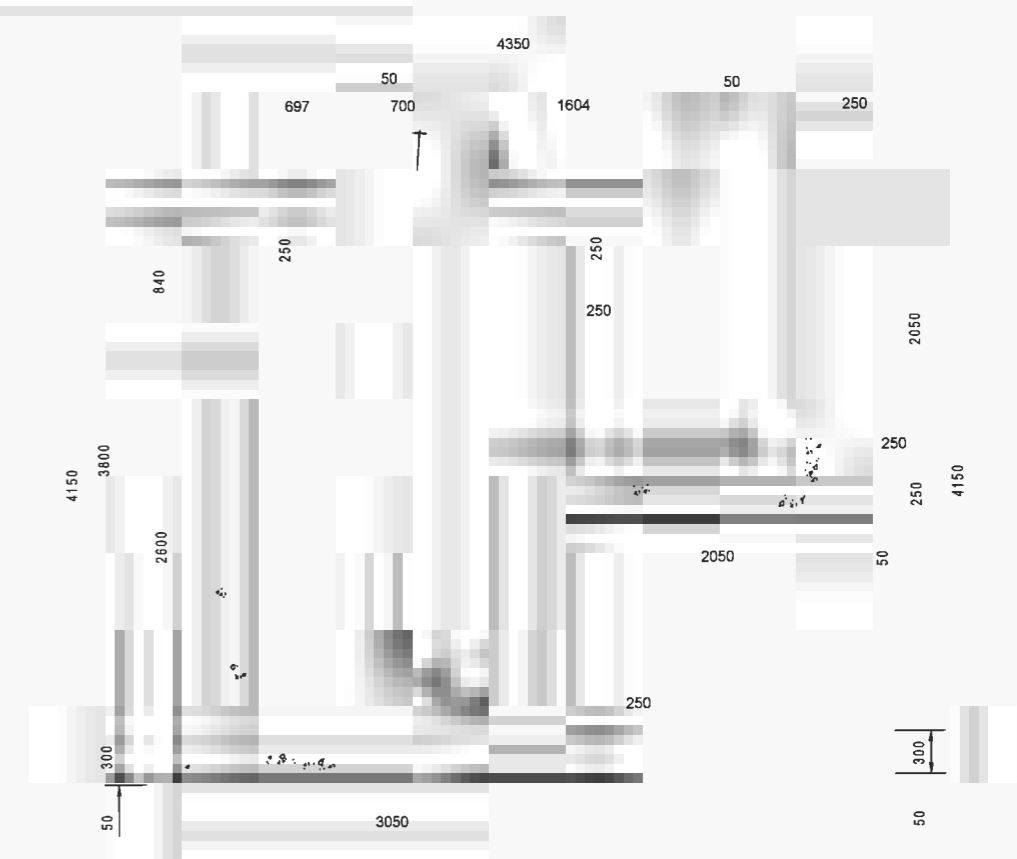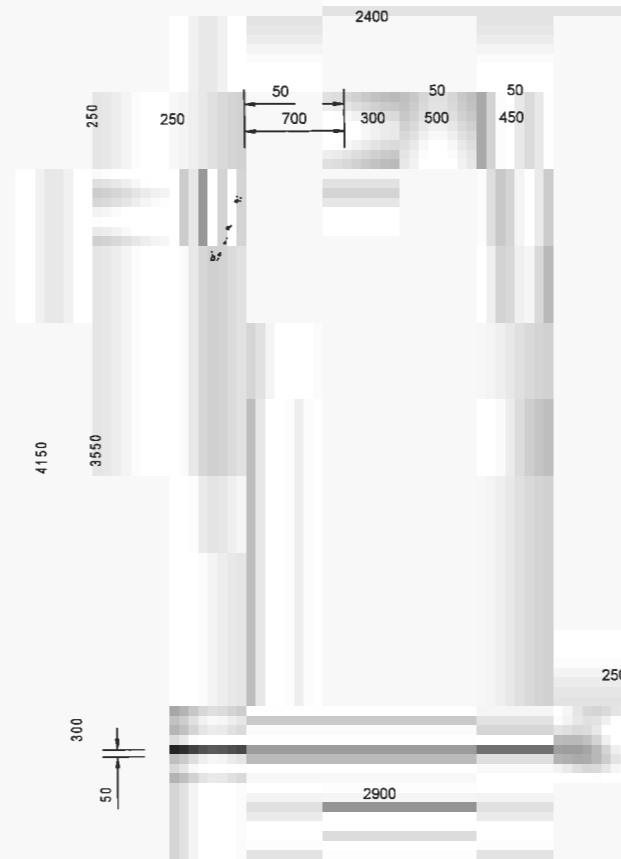

Foundation base rc details

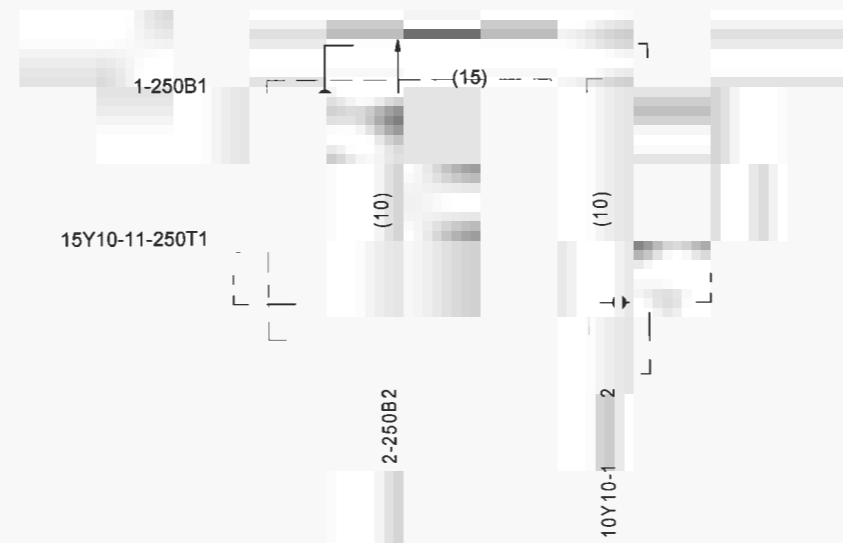

Top slab rc details

NOTES:

1. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE SHOWN
2. DO NOT SCALE FROM THIS DRAWING
3. THE SCALES GIVEN ON THIS DRAWING REFER TO THE A1 SIZE ORIGINAL DRAWING
4. THE SUBGRADE SHALL BE COMPACTED TO 99% MAXIMUM DRY DENSITY BEFORE THE PLACEMENT OF HARDCORE
5. CONCRETE SHALL BE CLASS C30/37 FOR STRUCTURAL MEMBERS AND CLASS C8/10 FOR BLINDING
6. THE MAXIMUM SIZE OF AGGREGATE SHALL BE 20mm UNLESS OTHERWISE SHOWN
7. REINFORCEMENT SHALL BE HIGH TENSILE DEFORMED TYPE WITH A CHARACTERISTIC YIELD STRESS OF AT LEAST 429N/mm²
8. COVER TO REINFORCEMENT SHALL BE:
 - FOUNDATIONS 50mm
 - SLABS 25mm
 - WALLS AND BEAMS 30mm
9. LAPS TO ALL REINFORCEMENT SHALL BE 50 * BAR DIAMETER UNLESS OTHERWISE SHOWN

DESIGN BY
 DRAWN BY
 CHECKED BY
 APPROVED BY
 SHEET NO:

SCALE 1:25

DATE JANUARY-2022

DRAWING NO. FSTP-106-06-1

PROJECT
 CONSTRUCTION OF FAECAL SLUDGE TREATMENT PLANTS (FSTP) WORKS IN DAR ES SALAAM

TITLE
 FECAL SLUDGE TREATMENT PLANT - SMALL SIZE (50m³) VIJIBWENI FSTP - PUMP STATION - STRUCTURAL DRAWINGS PLAN, SECTIONS GENERAL ARRANGEMENT AND REINFORCEMENTS DETAILS


REVISION
 DATE
 NATURE OF REV.
 CHECKED BY
 APPROVED BY

CLIENT
 DAR ES SALAAM WATER SUPPLY & SANITATION AUTHORITY (DAWASA)
 CONSULTANT
 DOHWA Engineering CO., LTD IN ASSOCIATION WITH LUPTAN CONSULTS LTD AND WWS




Section A-A, rc details

Mark	Diameter	Total Numbers	Length (mm)	Unit weight (kg/m)	Total weight (kg)	Bar bending shape
01	Y12	50	3100	0.888	138	[Bending Shape]
02	Y12	30	3000	0.888	80	[Bending Shape]
02a	Y12	30	2500	0.888	67	[Bending Shape]
05	Y12	82	4250	0.888	310	[Bending Shape]
06	Y10	100	2650	0.616	164	[Bending Shape]
07	Y12	50	2750	0.888	122	[Bending Shape]
08a	Y10	40	2300	0.616	57	[Bending Shape]
11	Y10	30	2550	0.616	48	[Bending Shape]
12	Y10	20	3600	0.616	44	[Bending Shape]
Total					1030	

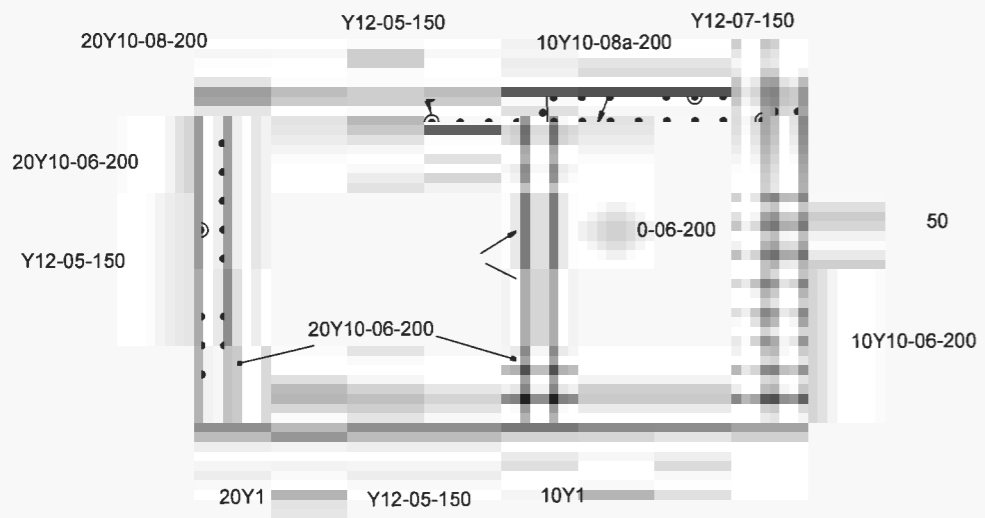

Plan-Reinforcements details

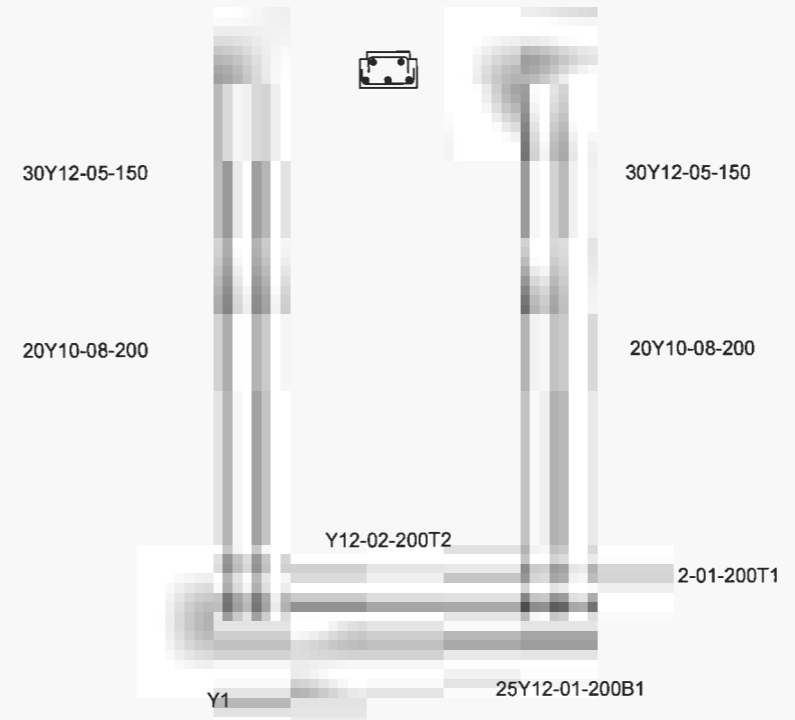

Section B-B, rc details

- NOTES:**
- ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE SHOWN
 - DO NOT SCALE FROM THIS DRAWING
 - THE SCALES GIVEN ON THIS DRAWING REFER TO THE A1 SIZE ORIGINAL DRAWING
 - THE SUBGRADE SHALL BE COMPACTED TO 99% MAXIMUM DRY DENSITY BEFORE THE PLACEMENT OF HARDCORE
 - CONCRETE SHALL BE CLASS C30/37 FOR STRUCTURAL MEMBERS AND CLASS C8/10 FOR BLINDING
 - THE MAXIMUM SIZE OF AGGREGATE SHALL BE 20mm UNLESS OTHERWISE SHOWN
 - REINFORCEMENT SHALL BE HIGH TENSILE DEFORMED TYPE YIELD STRESS OF AT LEAST 429N/mm²
 - COVER TO REINFORCEMENT SHALL BE:
 - FOUNDATIONS 50mm
 - SLABS 25mm
 - WALLS AND BEAMS 30mm
 - LAPS TO ALL REINFORCEMENT SHALL BE 50 * BAR DIAMETER UNLESS OTHERWISE SHOWN


DESIGN BY
DRAWN BY
CHECKED BY
APPROVED BY
SHEET NO:

SCALE 1:25
DATE JANUARY-2022
DRAWING NO. FSTP-106-06-2


PROJECT
CONSTRUCTION OF FAECAL SLUDGE TREATMENT PLANTS (FSTP) WORKS IN DAR ES SALAAM
TITLE
FECAL SLUDGE TREATMENT PLANT - SMALL SIZE (50m³) VIJIBWENI FSTP - PUMP STATION - STRUCTURAL DRAWINGS - REINFORCEMENTS DETAILS & BAR BENDING SCHEDULE

REVISION
DATE
NATURE OF REV.
CHECKED BY
APPROVED BY

DAR ES SALAAM WATER SUPPLY & SANITATION AUTHORITY (DAWASA)
CONSULTANT
DOHWA Engineering CO., LTD IN ASSOCIATION WITH LUPTAN CONSULTS LTD AND WWS

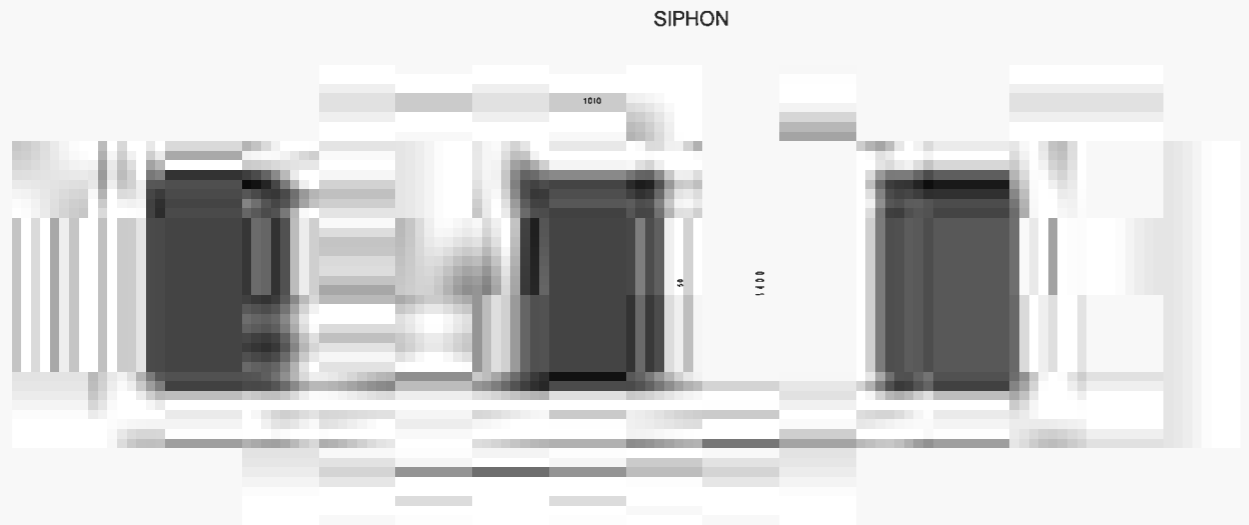


SIPHON

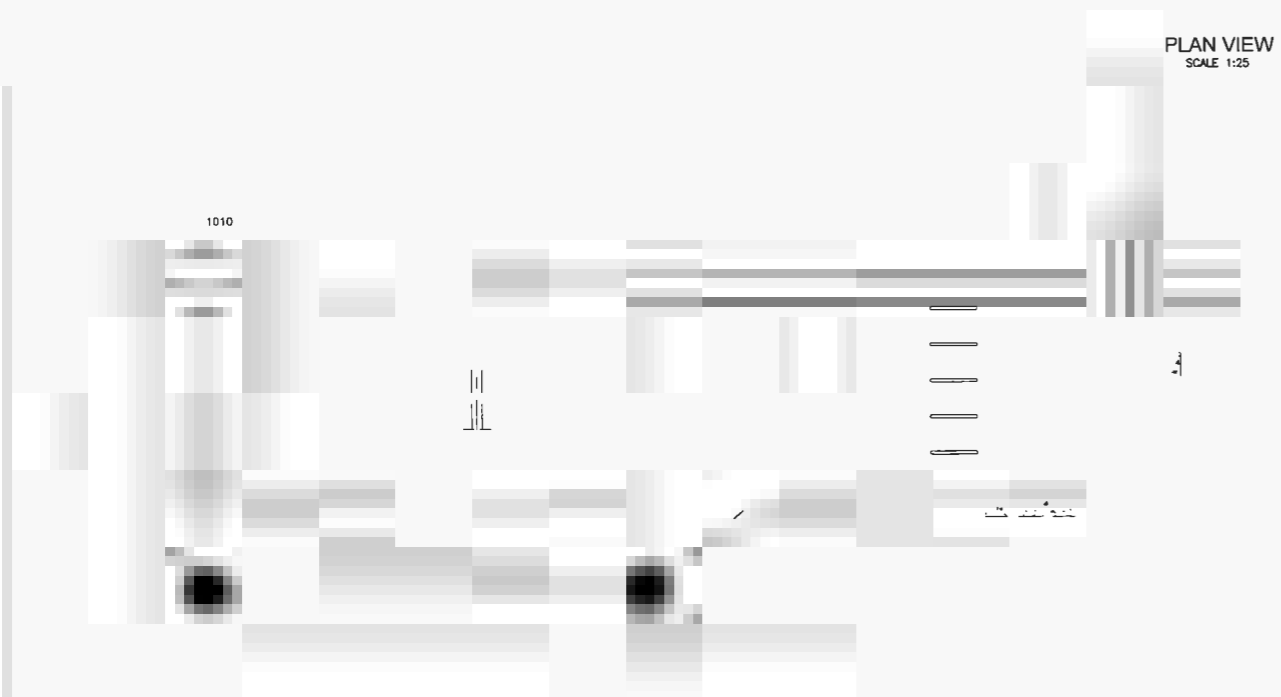


SIPHON

PLAN VIEW
SCALE 1:25

TYPICAL SECTION
SCALE 1:25

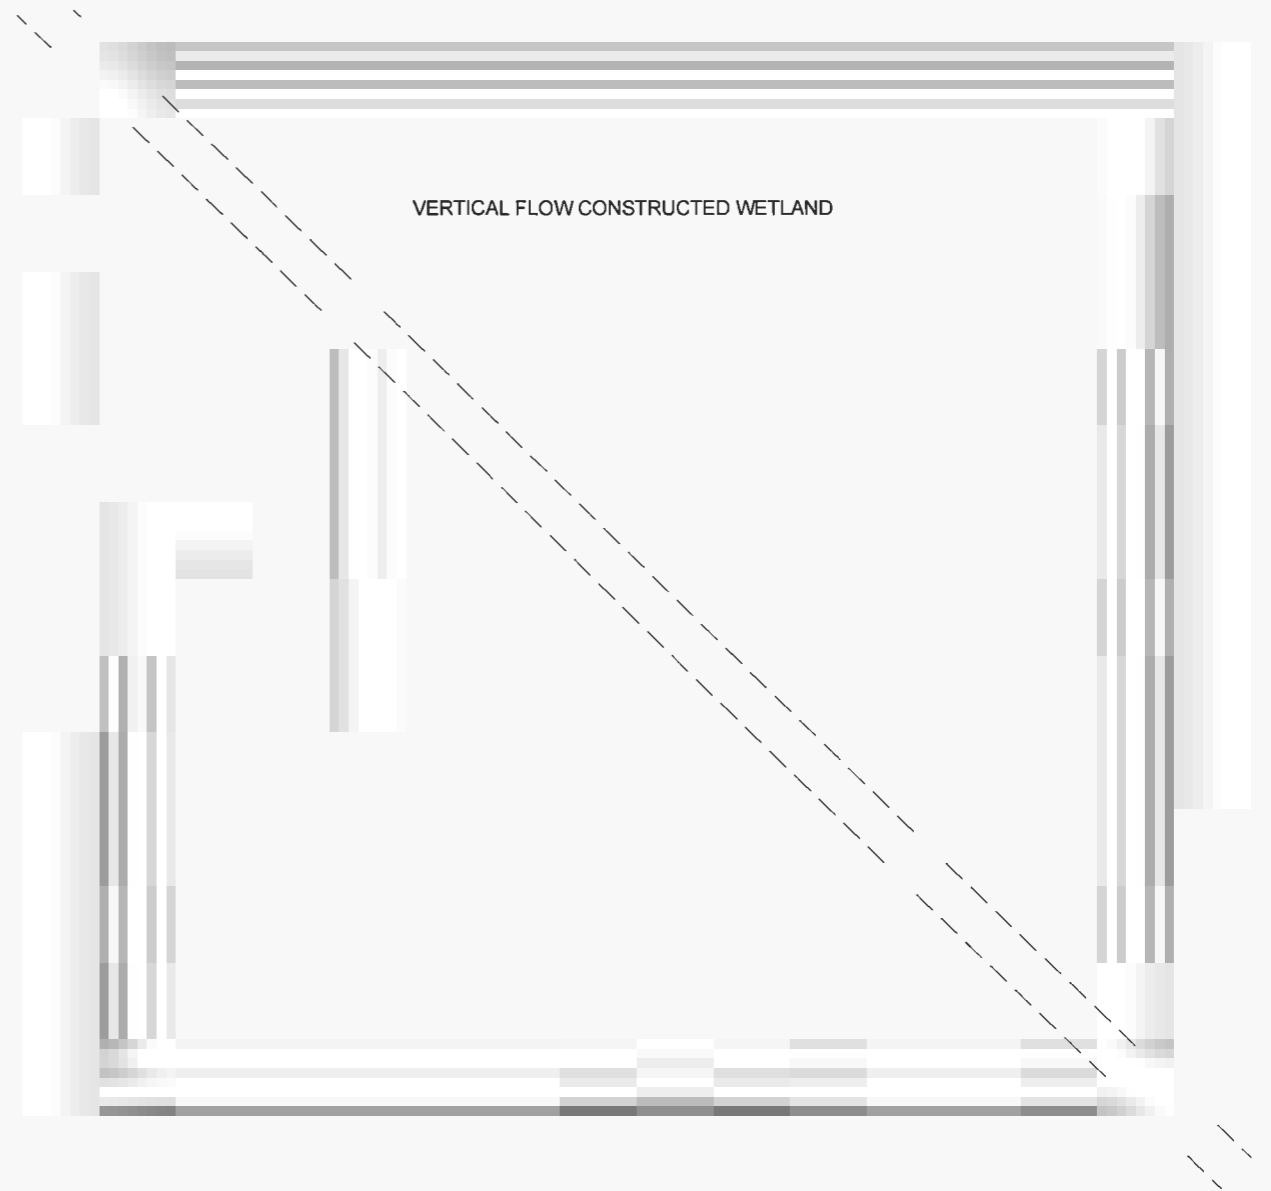

VERTICAL FLOW CONSTRUCTED WETLAND

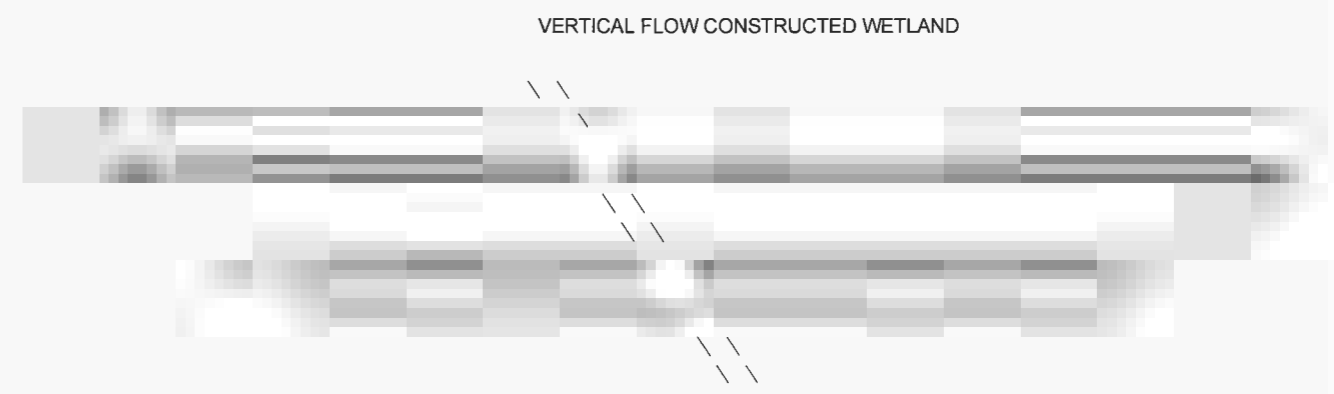

VERTICAL FLOW CONSTRUCTED WETLAND

DESIGN BY	
DRAWN BY	SCALE 1:25
CHECKED BY	
APPROVED BY	DATE JANUARY-2022
SHEET NO:	DRAWING NO. FSTP-106-07


PROJECT
CONSTRUCTION OF FAECAL SLUDGE TREATMENT PLANTS (FSTP) WORKS IN DAR ES SALAAM

TITLE
FECAL SLUDGE TREATMENT PLANT - SMALL SIZE (50m³) VIJIBWENI FSTP - HYDRO-MECHANICAL SIP
- PLAN & SECTION GENERAL ARRANGEMENT DETAILS


REVISION	DATE	NATURE OF REV.	CHECKED BY	APPROVED BY

DAR ES SALAAM WATER SUPPLY & SANITATION AUTHORITY (DAWASA)
CONSULTANT
DOHWA Engineering CO., LTD IN ASSOCIATION WITH LUPTAN CONSULTS LTD AND WWS




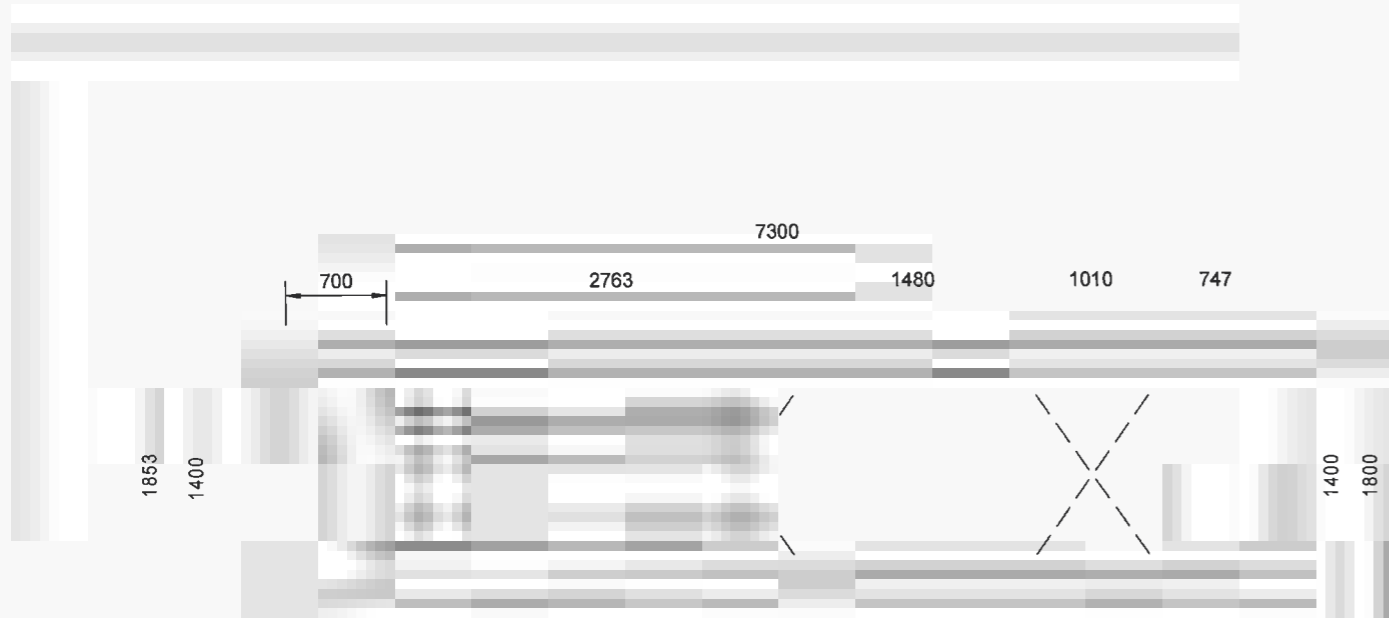


Plan

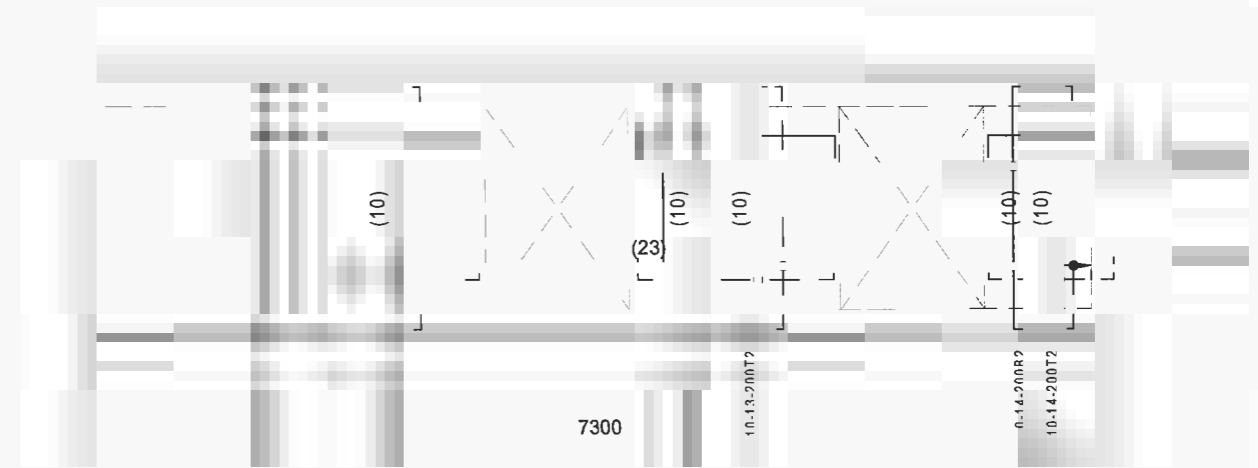

Top Slab Reinforcements

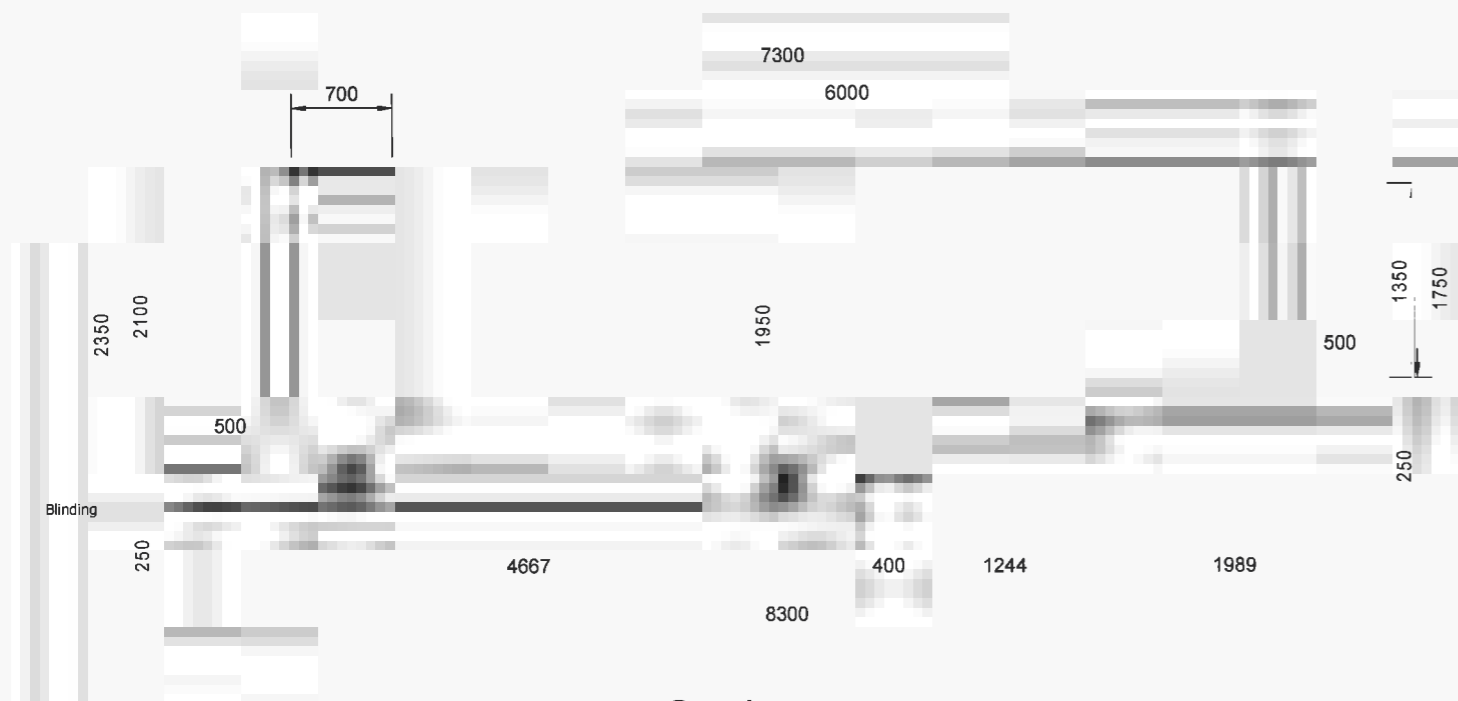

Section

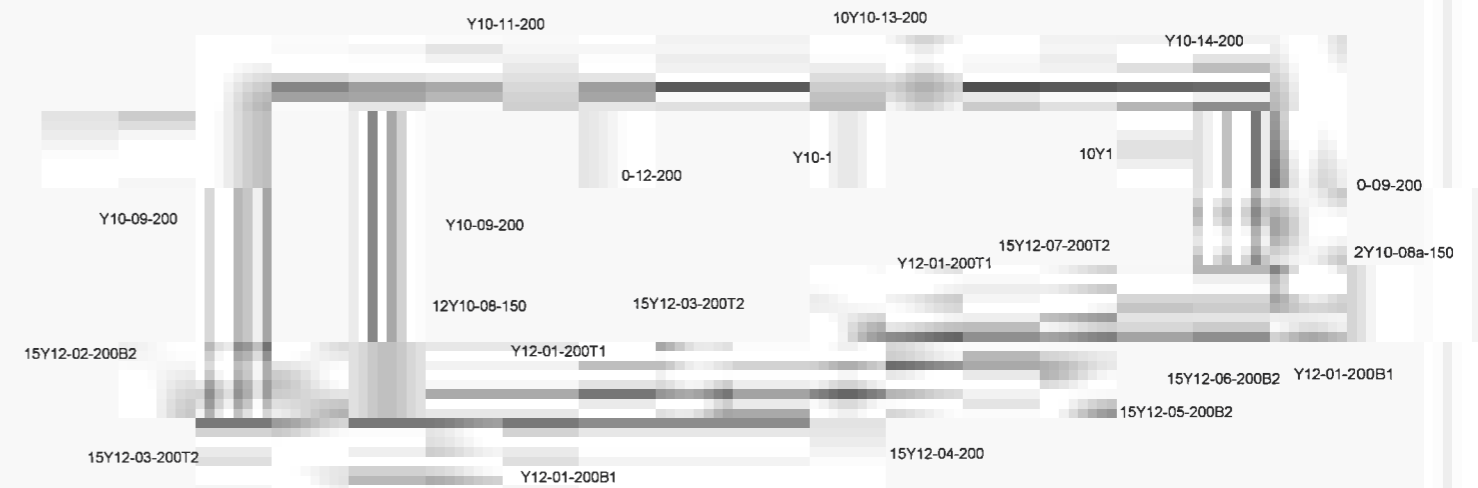

Walls & Section Reinforcements

NOTES:

1. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE SHOWN
2. DO NOT SCALE FROM THIS DRAWING
3. THE SCALES GIVEN ON THIS DRAWING REFER TO THE A1 SIZE ORIGINAL DRAWING
4. THE SUBGRADE SHALL BE COMPACTED TO 99% MAXIMUM DRY DENSITY BEFORE THE PLACEMENT OF HARDCORE
5. CONCRETE SHALL BE CLASS C30/37 FOR STRUCTURAL MEMBERS AND CLASS C8/10 FOR BLINDING
6. THE MAXIMUM SIZE OF AGGREGATE SHALL BE 20mm UNLESS OTHERWISE SHOWN
7. REINFORCEMENT SHALL BE HIGH TENSILE DEFORMED TYPE WITH A CHARACTERISTIC YIELD STRESS OF AT LEAST 429N/mm²
8. COVER TO REINFORCEMENT SHALL BE:
 - FOUNDATIONS 50mm
 - SLABS 25mm
 - WALLS AND BEAMS 30mm
9. LAPS TO ALL REINFORCEMENT SHALL BE 50 * BAR DIAMETER SHOWN


DESIGN BY
DRAWN BY
CHECKED BY
APPROVED BY
SHEET NO:

SCALE 1:25
DATE JANUARY-2022
DRAWING NO FSTP-106-07-1

PROJECT
CONSTRUCTION OF FAECAL SLUDGE TREATMENT PLANTS (FSTP) WORKS IN DAR ES SALAAM
FECAL SLUDGE TREATMENT PLANT - SMALL SIZE (50m³) VIJIBWENI FSTP - HYDRO-MECHANICAL SIPH
- STRUCTURAL PLAN, SECTIONS GENERAL ARRANGEMENT AND REINFORCEMENTS DETAILS

REVISION
DATE
NATURE OF REV
CHECKED BY
APPROVED BY

DAR ES SALAAM WATER SUPPLY & SANITATION AUTHORITY (DAWASA)
CONSULTANT
DOHWA Engineering CO., LTD IN ASSOCIATION WITH LUPTAN CONSULTS LTD AND WWS

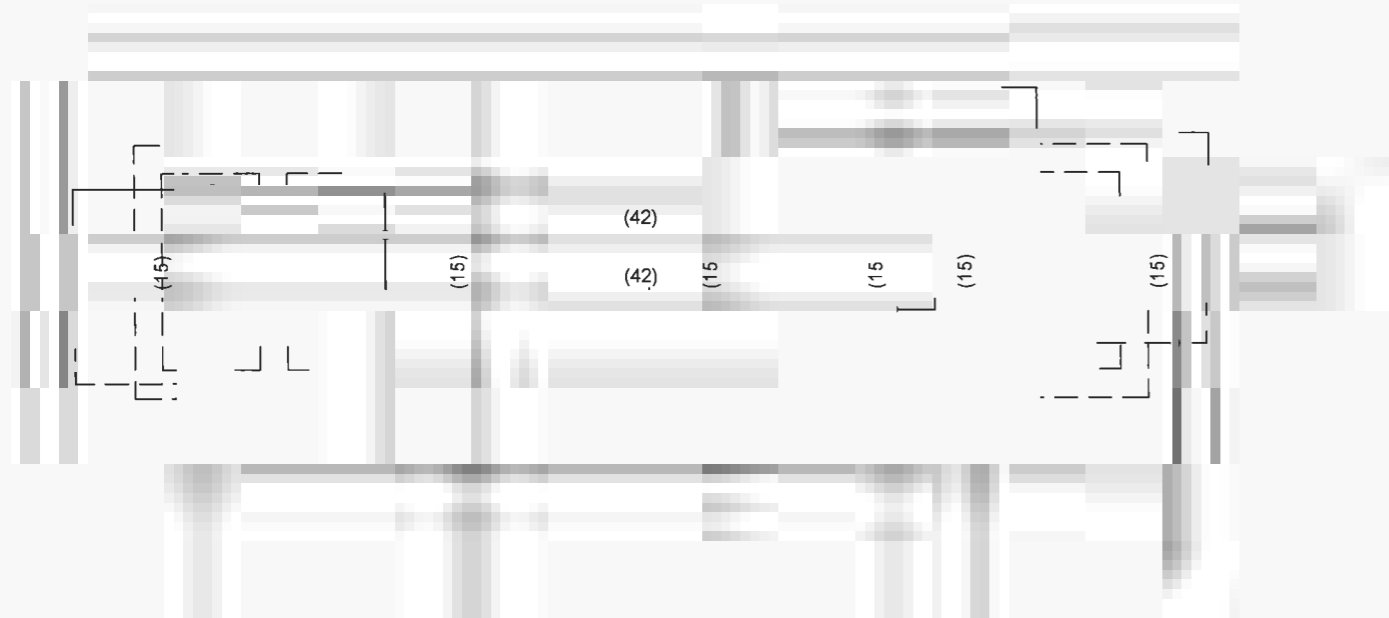

Bottom Slab Reinforcements

NOTES:

1. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE SHOWN
2. DO NOT SCALE FROM THIS DRAWING
3. THE SCALES GIVEN ON THIS DRAWING REFER TO THE A1 SIZE ORIGINAL DRAWING
4. THE SUBGRADE SHALL BE COMPACTED TO 99% MAXIMUM DRY DENSITY BEFORE THE PLACEMENT OF HARDCORE
5. CONCRETE SHALL BE CLASS C30/37 FOR STRUCTURAL MEMBERS AND CLASS C8/10 FOR BLINDING
6. THE MAXIMUM SIZE OF AGGREGATE SHALL BE 20mm UNLESS OTHERWISE SHOWN
7. REINFORCEMENT SHALL BE HIGH TENSILE DEFORMED TYPE WITH A CHARACTERISTIC YIELD STRESS OF AT LEAST 429N/mm²
8. COVER TO REINFORCEMENT SHALL BE:
 - FOUNDATIONS 50mm
 - SLABS 25mm
 - WALLS AND BEAMS 30mm
9. LAPS TO ALL REINFORCEMENT SHALL BE 50 * BAR DIAMETER UNLESS OTHERWISE SHOWN

Bar Bending schedule

Member	Mark	Diameter	Total Numbers/Area	Length (mm)	Unit weight (kg/m)	Total weight (kg)	Bar bending shape
Base	01	Y12	84	3100	0.888	232	
	02	Y12	15	4900	0.888	63	
	03	Y12	15	5300	0.888	71	
	04	Y12	15	2000	0.888	27	
	05	Y12	15	2100	0.888	28	
	06	Y12	15	3700	0.888	43	
	07	Y12	15	2850	0.888	38	
Walls	08	Y10	272	2700	0.616	453	
	09	Y10	54	2000	0.616	67	
	10	Y10	40	7500	0.616	185	
Top Slab	11	Y10	46	2000	0.616	57	
	12	Y10	20	2160	0.616	28	
	13	Y10	20	1700	0.616		
	14	Y10	20	1200	0.616		
						Total	1,329

DESIGN BY
 DRAWN BY
 CHECKED BY
 APPROVED BY
 SHEET NO:


SCALE 1:25
 DATE JANUARY-2022
 DRAWING NO. FSTP-106-07-2

PROJECT
 CONSTRUCTION OF FAECAL SLUDGE TREATMENT PLANTS (FSTP) WORKS IN DAR ES SALAAM


TITLE
 FECAL SLUDGE TREATMENT PLANT - SMALL SIZE (50m³) VIJIBWENI FSTP - HYDRO-MECHANICAL SIPHO
 - STRUCTURAL PLAN, REINFORCEMENTS DETAILS & BAR BENDING SCHEDULE

REVISION
 DATE
 NATURE OF REV.
 CHECKED BY
 APPROVED BY

DAR ES SALAAM WATER SUPPLY & SANITATION AUTHORITY (DAWASA)
 CONSULTANT
 DOHWA Engineering CO., LTD IN ASSOCIATION WITH LUPTAN CONSULTS LTD AND WWS

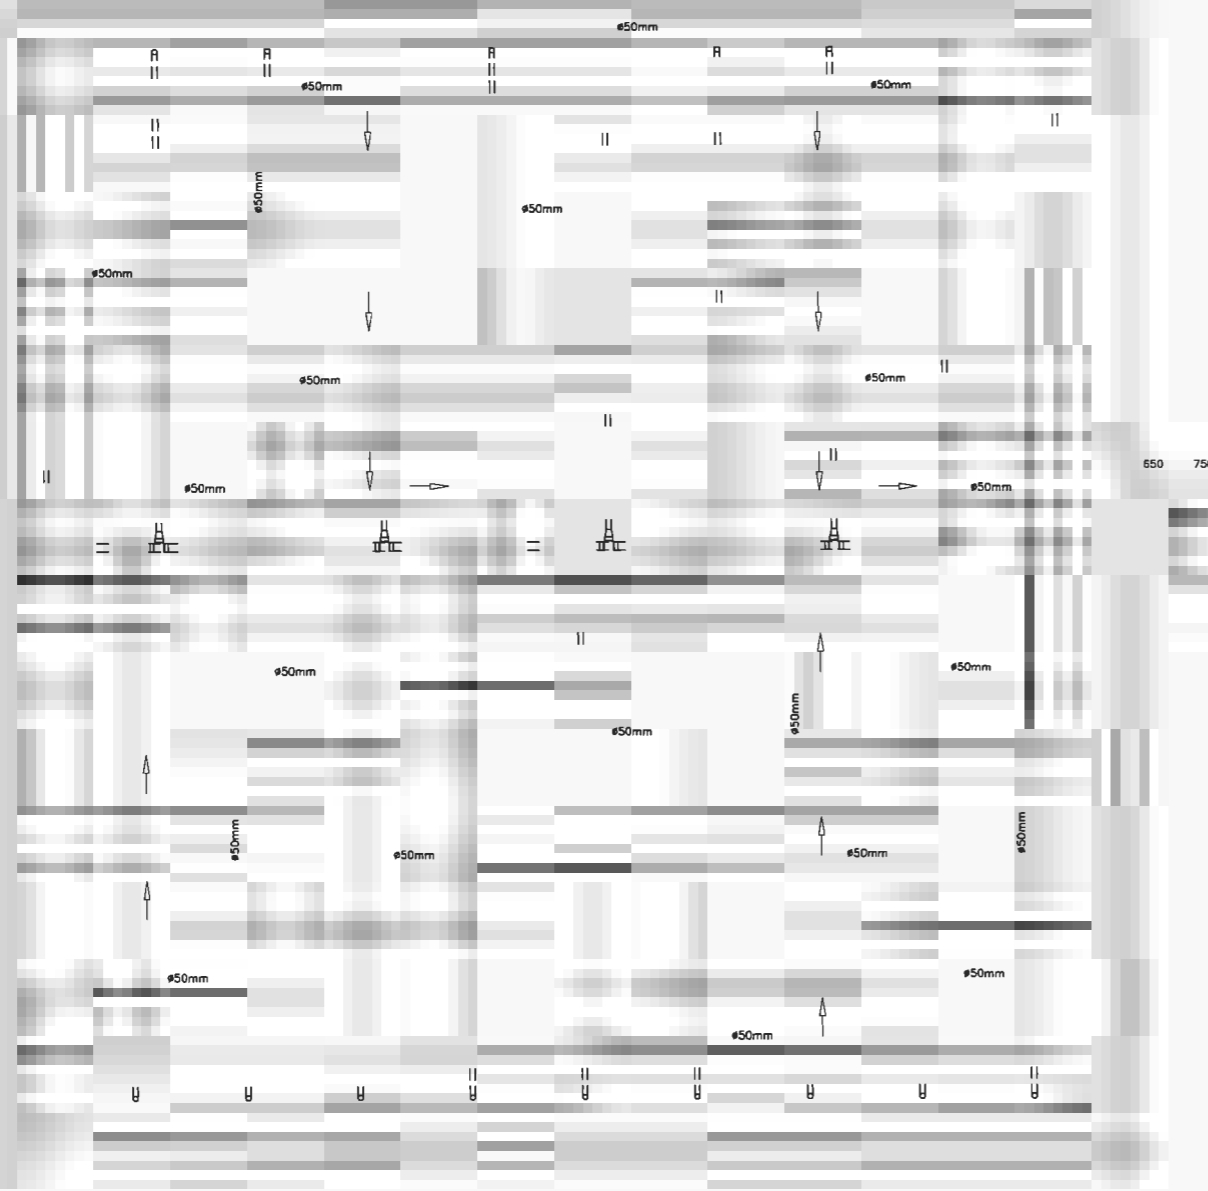


PLAN VIEW
SCALE 1:50

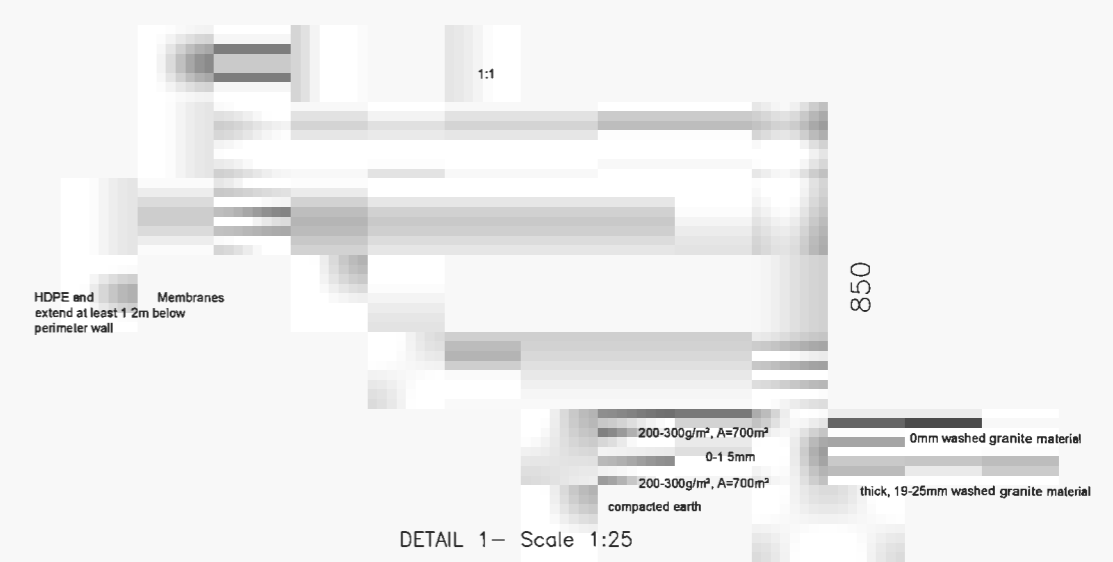

DETAIL 1- Scale 1:25

DETAIL 1

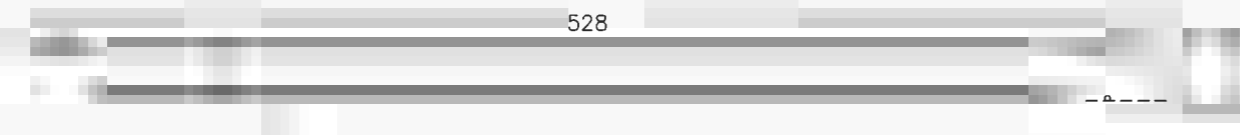

SECTION G-G
SCALE 1:50

Dam lining materials specifications
 200-300g/m², A=700m²
 s=1.0-1.5mm
 200-300g/m², A=700m²
 Well compacted earth

50mm thick, 5-10mm washed granite material
 thick, 1-4mm sieved river sand material
 thick, 19-25mm washed granite material

NOTES:

1. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE SHOWN
 2. DO NOT SCALE FROM THIS DRAWING
 3. THE SCALES GIVEN ON THIS DRAWING REFER TO THE A1 SIZE ORIGINAL DRAWING
 4. THE SUBGRADE SHALL BE COMPACTED TO 99% MAXIMUM DRY DENSITY BEFORE THE PLACEMENT OF HARDCORE
 5. CONCRETE SHALL BE CLASS C30/37 FOR STRUCTURAL MEMBERS AND CLASS C8/10 FOR BLINDING
 6. THE MAXIMUM SIZE OF AGGREGATE SHALL BE 20mm UNLESS OTHERWISE SHOWN
 7. REINFORCEMENT SHALL BE HIGH TENSILE DEFORMED TYPE WITH A CHARACTERISTIC YIELD STRESS OF AT LEAST 429N/mm²
 8. COVER TO REINFORCEMENT SHALL BE:
 - FOUNDATIONS 50mm
 - SLABS 25mm
 - WALLS AND BEAMS 30mm
- LAPS TO ALL REINFORCEMENT SHALL BE 50 * BAR DIAMETER UNLESS OTHERWISE SHOWN

DESIGN BY	SCALE	1:50
DRAWN BY	DATE	JANUARY-2022
CHECKED BY	DRAWING NO.	FSTP-106-08
APPROVED BY		
SHEET NO:		

PROJECT
 CONSTRUCTION OF FAECAL SLUDGE TREATMENT PLANTS (FSTP) WORKS IN DAR ES SALAAM


TITLE
 FECAL SLUDGE TREATMENT PLANT - SMALL SIZE (50m³) VIJIBWENI FSTP - VERTICAL FLOW CONSTRUCTED WETLAND - PLAN AND SECTION DETAILS

REVISION	DAR ES SALAAM WATER SUPPLY & SANITATION AUTHORITY (DAWASA) CONSULTANT
DATE	DOHWA Engineering CO., LTD IN ASSOCIATION WITH LUPTAN CONSULTS LTD AND WWS
NATURE OF REV	
CHECKED BY	
APPROVED BY	



NOTES:

1. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE SHOWN
2. DO NOT SCALE FROM THIS DRAWING
3. THE SCALES GIVEN ON THIS DRAWING REFER TO THE A1 SIZE ORIGINAL DRAWING
4. THE SUBGRADE SHALL BE COMPACTED TO 99% MAXIMUM DRY DENSITY BEFORE THE PLACEMENT OF HARDCORE
5. CONCRETE SHALL BE CLASS C30/37 FOR STRUCTURAL MEMBERS AND CLASS C8/10 FOR BLINDING
6. THE MAXIMUM SIZE OF AGGREGATE SHALL BE 20mm UNLESS OTHERWISE SHOWN
7. REINFORCEMENT SHALL BE HIGH TENSILE DEFORMED TYPE WITH A CHARACTERISTIC YIELD STRESS OF AT LEAST 429N/mm²
8. COVER TO REINFORCEMENT SHALL BE:
 - FOUNDATIONS 50mm
 - SLABS 25mm
 - WALLS AND BEAMS 30mm
9. LAPS TO ALL REINFORCEMENT SHALL BE 50 * BAR DIAMETER UNLESS OTHERWISE SHOWN

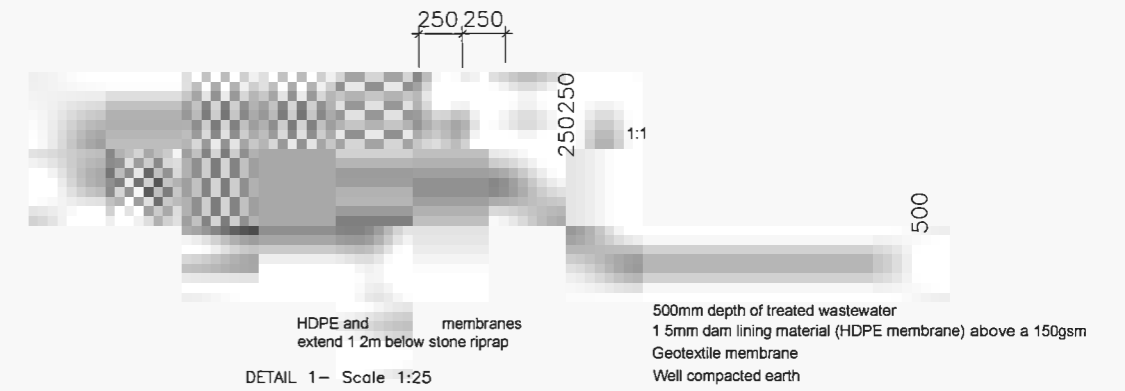


DETAIL 1

PLAN VIEW
SCALE 1:50

steps depending on pond depth
in relation to VF-constructed wetland outlet

Stone riprap for
water seepage

1.5mm dam lining
material(HDPE
membrane) above a
50gsm geotextile
membrane, above a
well compacted earth



SECTION H-H
SCALE 1:50

DESIGN BY	SCALE	1:50
DRAWN BY	DATE	JANUARY-2022
CHECKED BY	DRAWING NO.	FSTP-106-09
APPROVED BY		
SHEET NO:		

PROJECT	CONSTRUCTION OF FAECAL SLUDGE TREATMENT PLANTS (FSTP) WORKS IN DAR ES SALAAM
TITLE	FECAL SLUDGE TREATMENT PLANT - SMALL SIZE (50m ³) VIJIBWENI FSTP - POLISHING POND - PLAN AND SECTION DETAILS

REVISION	
DATE	
NATURE OF REV	
CHECKED BY	
APPROVED BY	

DAR ES SALAAM WATER SUPPLY & SANITATION AUTHORITY
(DAWASA)
CONSULTANT
DOHWA Engineering CO., LTD IN ASSOCIATION
WITH LUPTAN CONSULTS LTD AND WWS

Appendix IV: Minutes of Meetings with stakeholders



1. The first part of the document discusses the importance of maintaining accurate records of all transactions and activities. It emphasizes that this is crucial for ensuring transparency and accountability in the organization's operations.

2. The second part outlines the specific procedures and protocols that must be followed to ensure that all records are properly maintained and updated. This includes regular audits and reviews to identify any discrepancies or errors.

3. The third part details the responsibilities of various departments and individuals involved in the record-keeping process. It clearly defines the roles and expectations for each party to ensure a smooth and efficient workflow.

4. The fourth part provides a comprehensive overview of the reporting requirements and deadlines. It ensures that all necessary information is provided in a timely and accurate manner to the relevant stakeholders.

5. The fifth part discusses the importance of data security and confidentiality. It outlines the measures that must be taken to protect sensitive information from unauthorized access and disclosure.

6. The sixth part addresses the ongoing monitoring and evaluation of the record-keeping system. It highlights the need for continuous improvement and adaptation to changing organizational needs and regulations.

7. The seventh part concludes with a summary of the key points and a call to action, urging all employees to adhere strictly to the outlined procedures and protocols.

1. The first part of the document discusses the importance of maintaining accurate records of all transactions and activities. It emphasizes that this is crucial for ensuring transparency and accountability in the organization's operations.

2. The second part outlines the specific procedures and protocols that must be followed to ensure that all records are properly maintained and updated. This includes regular audits and reviews to identify any discrepancies or errors.



Appendix V: Screening Letter from NEMC







Appendix VI: Memorandum of Understanding between DAWASA and Dar es Salaam Municipal Councils



**GROUPS AND
BETWEEN**

**LIST OF WATER
AND**

**THE AREAS OF SERVICE AND
SEWERAGE AUTHORITY,**

GONGORA STREET SECTION AND

THE SERVICE OF CIPUNCILS

(Kondoni, Pala, Bekke, Ubogo, Paloni)

JANUARY 2019

ACRONYMS

BC	Beneficiary Community
CEO	Chief Executive Officer
CPM	Critical Path Method
CV	Curriculum Vitae
DAWASA	Dar es Salaam Water and Sewerage Authority
DDCA	Drilling and Dam Construction Agency
DEWATS	Decentralized Wastewater Treatment System
DSM	Dar es Salaam
EMP	Environmental Management Plan
ESA	Environmental and Social Assessment
ESIA	Environmental and Social Impact Assessment
ESMP	Environmental and Social Management Plan
EWURA	Energy and Water Utilities Regulatory Authority
FDR	Final Design Report
FSM	Feecal Sludge Management
GIS	Geographic Information System
GoT	Government of the United Republic of Tanzania
H&S	Health and Safety
ICB	International Competitive Bidding
IFRs	Interim Financial Report
LGAs	Local Government Authorities
m ³	Cubic meter = 1,000 litres
MD	Managing Director
MKUKUTA	National Strategy for Growth and Reduction of Poverty
MoEVT	Ministry of Education and Vocational Training
MoHCDEC	Ministry of Health, Community Development, Gender, Elderly and Children
MoU	Memorandum of Understanding
MoW	Ministry of Water
NCB	National Competitive Bidding
NEMC	National Environment Management Council

NGO	Non-Governmental Organization
NWSDS	National Water Sector Development Strategy
O&M	Operations and Maintenance
PAP	Projected Affected Person
PERT	Program Evaluation Review Technique
PIM	Project Implementation Manual
PIP	Program Implementation Plan
PO	Private Operators
PO-RALG	Presidents Office Regional Administration and Local Government
PPRA	Public Procurement Regulatory Authority
RAP	Resettlement Action Plan
RAS	Regional Administrative Secretary
RS	Regional Secretariat
RFP	Request for Proposals
SDG	Sustainable Development Goal
SPS	Small Piped Water Supply
TBS	Tanzania Bureau of Standards
ToR	Terms of Reference
UWSA	Urban Water and Sewerage Authority
WC	Water Committee
WSDP	Water Sector Development Program
WSS	Water Supply and Sanitation.
WSSP	Water Sector Development Program
WSSPII	Second Water Sector Support Project

**A MEMORANDUM OF UNDERSTANDING
FOR THE IMPLEMENTATION OF THE OFF- GRID WATER SUPPLY AND
SANITATION PROJECTS UNDER THE SECOND WATER SUPPLY AND
SANITATION PROJECT USING EARMARKED FINANCING**

Memorandum of Understanding (“MoU”) between the Ministry of Water on one part and the Dar es Salaam Water Supply and Sewerage Authority (“DAWASA”), the Dar es Salaam Regional Secretariat (RS), and the five municipalities of Dar es Salaam (collectively referred to as “the MUNICIPALITIES”) on the other part.

WHEREAS in recognition of the importance and contribution of the water sector to the social and economic development of the United Republic of Tanzania, the Government has developed a water sector support framework set out in the following documentation: (a) the National Strategy for Growth and Reduction of Poverty (“MKUKUTA, as amended”), (b) the National Water Sector Development Strategy (“NWSDS”) and (c) the Water Sector Development Program (“WSSP”).

WHEREAS after being satisfied with the objectives of the WSSP II, parties to this Memorandum have expressed their willingness to participate fully in its implementation;

WHEREAS The WSSPII project development objective is to strengthen the capacity for the integrated water resources planning and management in the United Republic of Tanzania and improve access to water supply and sanitation services in an operationally efficient manner in Dar es Salaam. The project has four components namely: Integrated Water Resources Management, Dar es Salaam Water Supply improvement, Dar es Salaam Sanitation Improvement, and Project Management and Implementation support.

WHEREAS the project is being financed by IDA Credit through Investment Project Financing, the recipient has declared its commitment to the objectives of the Project.

WHEREAS on the other part DAWASA has committed itself to the principle of harmonization and strive for the highest degree of alignment with the Government’s budgetary and accountability systems and local financial framework so as to enhance effective implementation, reduce the administrative burden on the Government, and minimize transaction costs; and

NOW THEREFORE, the parties hereby agree to cooperate in coordinating the implementation of the off-grid water supply and sanitation part of WSSP II in accordance with the principles and procedures set forth in this MoU; provided, however, that in case of any conflict between the provisions of this MoU AND THE PROJECT Financing Agreement, the provisions of the Financing Agreement shall prevail.

1 DEFINITIONS

Unless the context otherwise requires, several terms defined in the Preamble of this MoU have the respective meanings set forth therein, and the additional terms referred to below have the following meanings:

1. **Off Grid water supply** means the activities which will provide water supply services to people of Dar es Salaam, who are not connected to the formal network. The proposed solutions include decentralized Interventions, which may be an interim measure to be integrated to the grid network as it expands in the future. Schemes to be implemented include mostly independent water supply distribution systems supplied from point sources (e.g boreholes) or a bulk water supply from the DAWASA distribution system. In areas where the existing grid network is not available, independent stand-alone Small Piped Water Supply (SPS) systems will be implemented. These projects, typically involve a source of water (for example, borehole), a community-based distribution system and water points at a community and/or household level. The operations and maintenance will be supported from the tariff collected from the users.
2. **Off-Grid Sanitation** means activities which will provide sanitation services in Dar es Salaam to areas without access to sewers. This activity will support installation of improved toilets; safe emptying and transportation of the waste to a treatment facility; and treatment and safe disposal of treated waste into the environment. This will include piloting decentralized systems and other new technology.
3. **Environmental and Social Management Framework or ESMF**” means the framework dated September 2006, prepared by the Government and cleared by the International Development Association, setting forth an environmental and social screening process that will enable WSSP II Implementing Agencies to identify and assess potential adverse environmental and social impacts, and offset and reduce them to acceptable levels, or enhance positive impacts, and in accordance with which environmental and social management plans will be prepared by WSSP II Implementing Agencies.
4. **MKUKUTA II** Means the Government’s National Strategy for Growth and Reduction of Poverty dated July 2010, covering the period from 2011 – 12 to 2016 – 17 and subsequent versions that may be introduced by GOT.
5. **Resettlement Policy Framework** or RPF means the governing framework dated September 2006, prepared by the Government and approved by the International Development Association, for land acquisition, resettlement and compensation under the WSDP, and in accordance with which resettlement action plans will be prepared,

as necessary, as the same may be amended from time to time with the concurrence of the International Development Association;

6. **WSSP Implementation Manual** means the Project Implementation Manual (PIM) specifying implementation arrangements for the Second WSSP, including institutional arrangements; procedures for procurement, disbursement of funds, financial management, environmental and social management, and monitoring and evaluation; and progress reporting requirements, including annexes to the said manual.
7. **Project Management Team** means a team set up by DAWASA for day to day management of the off-grid water supply sub-project. Same for management of off-grid sanitation sub-project.
8. **Facilitation Team** A team appointed by the Municipal Director of the respective Municipal Council from Dar es Salaam region for the purpose of facilitating the implementation of the Off-Grid water supply projects and Off- Grid Sanitation projects. The scope of their responsibility are detailed in the PIM and summarized in this MoU.

2. UNDERLYING PRINCIPLES

2.1 The MoW, DAWASA, RS and Municipalities agree that the following are the underlying principles that govern this partnership:

- (a.) Commitment to the fulfilment of the aspirations of the National Development Vision 2025;
- (b.) Compliance with defined budgeting, procurement and public financial management rules and regulations;
- (c.) Good governance and accountability of the Government to its citizens, including an active fight against corruption;
- (d.) Coordinating the implementation of the off-grid water supply and sanitation sub-projects cost effectively; and
- (e.) Each party executing its respective roles in a timely manner

3. GENERAL PROVISIONS

3.1 Purpose

This MoU outlines the responsibilities of the **MoW, DAWASA, RS and Municipalities** with respect to the implementation of off-grid water supply and sanitation sub-projects and sets forth common institutional, environmental and social measures, monitoring and evaluation, audit and reporting arrangements. The WSSP II Implementation Manual complements procedures and arrangements set out in this MoU.

3.2 **Status of the MoU**

This MoU is not intended to create any legally binding obligations and the parties take due cognizance of the separate sector laws and regulations between the Government Institutions, and this MoU is adopted pursuant to and subject to any such regulations. In case of any conflict between the provisions of this MoU and the project Financing Agreement, the provisions of the Financing Agreement shall prevail.

4. **OFF GRID WATER SUPPLY**

4.1 **Commitment**

The DAWASA declares its commitment to the objectives of the **Second Water Sector Support Project** and will act with due diligence and efficiency to facilitate the successful implementation of the projects. To this end, DAWASA, as an Implementing Agency will effectively carry out its roles and responsibilities in the implementation of the off-grid water supply and sanitation sub-projects as defined in the WSSP II Project Implementation Manual. The Ministry of Water, as the Responsible Agency for WSSP II will have overall responsibility for the coordination and implementation of the off-grid water supply and sanitation sub-projects.

4.2 **Institutional Arrangements**

The institutional framework for overseeing the implementation of the WSSP II comprises the following key bodies, as set out in the Sections below, and in greater detail in the WSSP Implementation Manual:

1. Ministry of Water;
2. Prime Minister's Office Regional Administration and Local Government;
3. Ministry of Health, Community Development, Gender, Elderly and Children
4. Municipal Councils
5. Beneficiary Communities ("BC");

4.2.1 **Ministry of Water (MoW)**

The MoW will be responsible for provision of overall coordination and oversight. The Ministry will also provide technical and administrative support in the implementation of WSSP II, including without limitation the following activities:

1. Coordinating and consolidating the quarterly WSSP II IFRs (Interim Financial Report); semi-annual and annual progress reports; and ensuring that funds earmarked for implementation of WSSP II activities are duly considered in the annual work plans

and budgets of the implementing agencies; and that the WSSP II procurement plans are consistent with WSSP II work plans and budgets;

2. Ensuring quality and consistency of the documents referred to in subparagraph (a) above prior to consolidation as indicated in the Programme Implementation Manual and submission to the Off-Grid WSS SC for discussion;
3. Monitoring the implementation of the Annual Work Plans and Budgets by the WSSP II Implementing Agencies, at least on quarterly basis;
4. Providing oversight on financial management, controls, audit and reports; and
5. Ensuring that management decisions made by the Off-Grid WSS Steering Committee are communicated to the Implementing Agencies, implemented and monitored.

4.2.2 DAWASA

DAWASA will be responsible for overall coordination and implementation of off grid water supply activities. The off-grid water supply shall be implemented under the Directorate of Infrastructure Development (for construction arrangements) in collaboration with the Communication Unit (for coordination arrangements). The Communication Unit will be generally responsible for:-

1. Coordinating inputs as required from other units within DAWASA such as Procurement, Technical Services, and Finance, etc.
2. Supervising and monitoring contracts / agreements
3. Setting up Sub-project Agreements with beneficiary communities
4. Monitoring and reporting overall progress of the off-grid water supply sub-component.
5. Reviewing and evaluating the operation and management of the water supply sub-projects.
6. The financial aspects for off- grid water supply sub-projects will be managed as per Project Implementation Manual VOLUME II, and
7. Overall supervision of off-grid water supply activities.

4.2.3 Municipal Councils (or DLGAs)

The five Dar es Salaam Municipal Councils, through their respective Urban Planning Department, Legal Unit, Municipal Health and Water Department, will be responsible for the following tasks:

1. Creating awareness and mobilization of the communities.

2. Each DLGA will form a Municipal Facilitation Team comprising different specialists from Water, Health, Education, Community Development departments that will be tasked to assist consultants/contractors/PO on implementation and operation of Off Grid Water Supply facilities in their respective areas.
3. DLGAs through Legal unit, Health and Water department will coordinate the formation of Water Supply by-laws and regulations and thereafter enforcing for sustainability of Off Grid Water Supply facilities.
4. DLGAs will be responsible for identification and facilitation of Land acquisition for construction of Off- Grid Water Supply facilities

4.2.4 WSS Steering Committee

Given the multiplicity of institutions with varying roles, a WSS Steering Committee (SC) will be set up under the project to ensure coordination, synergy, and dovetailing. This SC will be newly set up or be adopted from some of the other projects (for example, Dar es Salaam Metropolitan Development Program [DMDP]) which may have similar steering mechanisms. This steering committee will be chaired by the Head of the Water Sector from RS and DAWASA will provide the secretary to WSS SC.

The RS will chair the Off Grid WSS Steering Committee, which will be comprised of representatives from the DAWASA, RS, WRBO, MOW, DLGAs i.e Temeke, Ilala, Kinondoni, Kigamboni and Ubungo. The Steering Committee will be responsible for providing general oversight of the selection and approval of sub-projects for implementation by the Off-Grid Water Supply and Sanitation. The key responsibilities of the Off Grid WSS Steering Committee include:

1. Reviewing overall Off Grid Sanitation implementation arrangements
2. Reviewing and approving Off Grid Sanitation sub-project operational guidelines
3. Reviewing and approving Off Grid Sanitation sub-project proposals
4. Reviewing overall Off Grid Sanitation progress and performance and providing guidance for improvements if needed
5. Conflict Resolution as per PIM.

4.2.5 Beneficiary Community

At the project level, Beneficiary Community will be involved in the project appraisal, that includes identification of sources, selection of appropriate sites, kiosk locations, and

protection of water source and infrastructures. DAWASA will be responsible for the efficient operation and management of the water supply systems.

4.2.6 Private Operator

The Private Operator (PO) may be engaged if the expansion of DAWASA grid network is beyond five years away. The PO would primarily have as its members the households from the community, with an operating body selected by the members from among themselves, with additional membership from DAWASA/DLGA. The regulation of these systems, including the tariff, would be undertaken by EWURA, as part of the overall regulation of the sector in Dar es Salaam.

Private Operator will operate, maintain, and manage the scheme under contract with DAWASA.

The Private Operator shall be responsible for keeping and maintaining appropriate records of its business activities. These shall include:

1. Customer details
2. Operation and maintenance records including volume of water produced and sold
3. Asset register, work as executed records, manuals of plant and equipment
4. Condition and expected life of assets
5. The details of network expansions as up to standards.
6. The Private Operator shall prepare monthly and quarterly operation and maintenance
7. Reports for the completed off -grid water supply subproject
8. Billing and payment records
9. Business accounts and financial statement

In general, the Operation and Maintenance Reports will address such issues as:

1. Number of registered customers in the service area
2. Number of people in the service area and number of people served
3. Business plan and budget
4. Level of service; proposed and actual
5. Revenue and expenses, progress against budget
6. Customer satisfaction
7. Maintenance activities, breakdowns, failures
8. Availability of ground /reliable water sources
9. Availability for land resources for project activities
10. Manage non-revenue water in the business area

4.3 SELECTION CRITERIA

DAWASA, in consultation with the five municipalities Ilala, Temeke, Kinondoni, Kigamboni and Ubungu will identify communities which are eligible for the Off-Grid Water Supply sub-project under the WSSP II. The identification will follow the criteria below;

1. High population density
2. Low-income areas
3. Prevalence/risk of waterborne diseases
4. No wholesome water services
5. Near-trunk infrastructure
6. Availability of sufficient land for the interventions
7. Unplanned settlements
8. Community willingness

Each of these criteria will be allocated a score, and the communities prioritized according to their total score. Keeping in mind the decisions of other interventions (for example, The Dar es salaam Metropolitan Development Program - DMDP), WSSP-II will invest in those communities which have the highest need.

5.0 OFF-GRID SANITATION

5.1 Definition.

The Off-Grid Sanitation components will provide much needed improvements to wastewater management services in areas of Dar es Salaam that are not served by DAWASA network. These improvements will be realised as a result of construction of Off-Grid sanitation stand-alone projects such as Decentralized Waste Water Treatment Systems (DEWATSs), faecal sludge treatment facilities, and condominial/simplified sewerage. The Off-Grid Sanitation Services will address the lack of sanitation services in unserved areas.

5.2 Institutional Arrangements

A strategy to address the poor sanitation in Dar es Salaam requires clarity and coordination among the various institutions involved in the sector. However, institutional responsibility is fragmented and unclear, being divided between National Ministries, City Utilities, Municipal Organizations, Regulatory Authorities, Community-Based Organizations, the Informal Private Sector and sanitation users themselves.

Currently sanitation service delivery is undertaken by a mixture of Utilities, Municipalities and Regulators. DAWASA will be responsible for overall coordination and supervision of Off-Grid sanitation activities. Other institution as detailed in PIM are summarised below:

1. MoHCDGEC,
2. MoW,
3. RS,
4. DLGAs,
5. NGOs,
6. PO

5.2.1 Ministry of Water

Ministry of Water will be responsible with setting Policy and guidelines specific to FSM and overall project coordination and implementation support .

5.2.2 DAWASA

DAWASA will provide a foundation and resources for the overall implementation of Off-Grid Sanitation.

Directorate of Infrastructure Development will be the department within DAWASA responsible for overseeing the implementation of the WSSP II including Off-Grid Sanitation Sub component. The head of this department will report directly to the DAWASA Chief Executive Officer and will generally be responsible for:

1. Coordination of the Off-Grid Sanitation Steering Committee as well as establishing a general agenda and timetable for Steering Committee meetings with consultation with Steering Committee Chairperson and providing secretariat services.
2. Coordinating inputs as required from other Directorates within DAWASA such as Procurement, Infrastructure Development, and Finance, etc.
3. Signing, supervising and monitoring contracts / agreements
4. Setting up Sub-project Agreements with successful communities.
5. Monitoring and reporting overall progress of the Off-Grid Sanitation
6. Reviewing and evaluating the operation and management of the community sanitation schemes.

In support of Sub Component 3.2: a Sanitation coordination team led by PO-RALG - Regional Secretariat will be established to coordinate implementation of the Off- Grid sanitation services. The technical department in the municipalities in coordination with DAWASA will be responsible for implementation of the off-grid sanitation component. DLGAs through Health, Legal unit and Water departments will coordinate the formation or improvement of existing Sanitation by laws and regulations and thereafter enforcing them for the sustainability of Off Grid Sanitation facilities. Areas where these facilities will be built people will be required to connect. DLGAs will be responsible for identification and facilitation of Land acquisition for construction of Off- Grid Sanitation facilities, and management of Public toilets.

5.2.3 MoHCDGEC/MoW:

Policy and guidelines specific to FSM.

5.2.4 DLGAS under Regional Secretariat:

Roles and responsibilities of the DLGAs will include:

1. Creating awareness and mobilization of the community
2. Formulation of Municipal Facilitation Team comprised of specialists from Water, Health, Education, Community Development departments that will be tasked to assist consultants/Contractors/PO on implementation and operation of Off Grid Sanitation facilities
3. Coordination of the formation of Sanitation by-laws and regulations and thereafter enforcing them for sustainability of Off Grid Sanitation facilities through Legal unit, Health and Water Department
4. Identification and facilitation of land acquisition for construction of Off- Grid Sanitation facilities
5. Establish and capacitate the grievance redress mechanism (GRM) team
6. Monitor and evaluate project implementation, trouble shooting and responding to grievances raised by Grievance Redress Mechanisms (GRM) teams
7. Prepare and submit to WSS SC a monthly project implementation progress report

5.2.5 WSS Steering Committee

Given the multiplicity of institutions with varying roles, a WSS Steering Committee (SC) will be set up under the project to ensure coordination, synergy, and dovetailing. This SC will be newly set up or be adopted from some of the other projects (for example, Dar es Salaam Metropolitan Development Program [DMDP]) which may have similar steering mechanisms. This steering committee will be chaired by the Head of the Water Sector from RS and DAWASA will provide the secretary to WSS SC.

The RS will chair the Off Grid WSS Steering Committee, which will be comprised of representatives from the DAWASA, RS, WRBO, MOW, DLGAs i.e Temeke, Ilala, Kinondoni, Kigamboni and Ubungo. The Steering Committee will be responsible for providing general oversight of the selection and approval of sub-projects for implementation by the Off-Grid Water Supply and Sanitation. The key responsibilities of the Off Grid WSS Steering Committee include:

1. Reviewing overall Off Grid Sanitation implementation arrangements
2. Reviewing and approving Off Grid Sanitation sub-project operational guidelines
3. Reviewing and approving Off Grid Sanitation sub-project proposals

- 4 Reviewing overall Off Grid Sanitation progress and performance and providing guidance for improvements if needed
- 5 Conflict Resolution as per PIM.

5.2.6 Private Operator (PO):

The domestic private sector will be a major institution which will require to be involved for sanitation in low-income settlements. Their involvement will include approaches to empty faecal sludge from latrine pits and septic tanks. This could be through vacuum trucks, or in areas where access is difficult, small 'gulper' technologies.

Private Operator will form the basic unit for planning and eventually operating and managing the community-based sanitation schemes implemented under the off-grid sanitation. Off-grid sanitation POs, will be responsible for:

1. Possession of necessary registration as per requirements.
2. Undertaking training and development in operations and maintenance, financial management, monitoring and reporting.
3. Operating and maintaining the off-grid sanitation Scheme in a sustainable manner and providing equitable access to the service for everyone in the community
4. Maintaining adequate records and reporting on technical and financial performance to DLGAs and DAWASA.

5.2.7 NGOs/ Consultant:

NGO will be responsible for Capacity building, mobilization of community; media campaigns

DAWASA will contract with a reputable NGO active in the DAWASA service area as implementing agents for the off- grid Sanitation. The key roles of the off-grid sanitation NGO include:

1. Mobilising community groups to identify all sanitation needs and raising awareness within community groups about sanitation issues.
2. Assisting community members to obtain legal status if required and to set up the necessary bank accounts, for the community to qualify for funding from micro finance institution for toilet improvements.
3. Undertaking a needs analysis and preparing a subproject proposal design, budget, impact assessment, operational and maintenance of the sanitation facility
4. Preparing subproject proposals in association with the community members for consideration by the off-grid sanitation Steering Committee.
5. Sensitization and training of POs to operate, maintain, and manage off-grid sanitation systems.

6. Assisting DAWASA to develop suitable O&M guidelines/manuals and financial management guidelines for use by the POs in operating and managing the completed schemes.

5.3 SELECTION CRITERIA

DAWASA, in consultation with the five municipalities Ilala, Temeke, Kinondoni, Kigamboni and Ubungo will identify communities which are eligible for Off-Grid Sanitation sub-project under the WSSP II, in the eligible project area using the criteria mentioned in the PIM. The criteria will include the availability of land resources for the project activities as additional criteria.

Each of these criteria will be allocated a score, and the communities prioritized according to their total score. Keeping in mind the decisions of other interventions (for example, DMDP), WSSP-II will invest in those communities, which have the highest need.

The five municipalities will be the focal point for planning, prioritizing, and implementing the off-grid sanitation in their areas. A comprehensive master sanitation plan, based on empirical data and evidence, will form the basis for this planning and implementation.

The results of the ongoing efforts to map the city on the said indicators, will form the basis for the planning efforts by the stakeholders.

Summary of Institutional Roles for Sanitation Provision

MoH/MoW/PO-RALG	Policy and guidelines specific to FSM
MoW	Overall project coordination and implementation support
EWURA	Regulate performance of DAWASA
DAWASA	Facilitating the establishment and operation of treatment facilities (FSM and the like and facilitating the development of options for transportation and treatment of this waste, establishment and management of public toilets; regulating the services of transporters
Municipalities	Facilitating the upgrading of unimproved household toilets to improved ones and regulation of waste disposal; facilitating the availability of land for decentralized systems; provide licenses to private transport operators
Private sector	Development of infrastructure for transportation and treatment, operation
NGOs	Capacity building, mobilization of community; media campaigns

TBS

Setting up of standards for effluent disposal

NEMC

Regulation of disposal of effluent

6.0 EFFECTIVENESS AND DURATION OF MoU

- 6.1. This MoU will become effective on the date of signature by all parties.
- 6.2. This MoU shall remain in force until end Closure of the Second WSSP, or as shall be mutually agreed by the parties hereto.

7.0 AMENDMENTS

This MoU may be amended at any time with the written agreement of the parties hereto.

8.0 CONFLICT RESOLUTION

In the event of any differences arising with respect to the provisions of this MoU, the parties will endeavour to find a solution through dialogue and consultation.

9.0 INFORMATION AND NOTICES

- 9.1. The parties to this MoU will furnish to each other all such information in relation to the WSSP II as will be reasonably requested in a timely manner.
- 9.2. Any notices or documents given, made or sent by the parties in relation to this MoU will be in writing and will be deemed to have been duly given, made or sent to the organization or person to which it is addressed at the time of its delivery by hand, mail, or courier at its respective address, as listed in this MoU.
- 9.3. Any party hereto may, by written notice to the other parties, change the address to which any notice or request for the Participant so giving such notice will be addressed.
- 9.4. All communications and documents submitted to any party and by any part will be in the English language.
- 9.5. The following addresses are specified for purposes of Section 16.2.

9.6 FOR THE PARTIES

Permanent Secretary
Ministry of Water
Address
Tel:
E-mail:

Chief Executive Officer
DAWASA
Address
Tel:
E-mail:

Region Administrative Secretary
Dar es Salaam Region
Address:
Tel:
E-mail:

Municipal Director
Temeke Municipal Council
Address:
Tel:
E-mail:

Municipal Director
Ilala Municipal Council
Address:
Tel:
E-mail:

Municipal Director
Kinondoni Municipal Council
Address:
Tel:
E-mail:

Municipal Director
Ubungo Municipal Council
Address:
Tel:
E-mail:

Municipal Director
Kigamboni Municipal Council
Address:
Tel:
E-mail:

Signed by the duly authorized representatives of the parties as hereunder:

Permanent Secretary
Ministry of Water

Date 18/1/2019

Regional Administrative Secretary
Dar es Salaam

Date 12/1/2019

CEO
DAWASA

Date 23.01.2019

Municipal Director
Temeke

Date

Municipal Director
Ilala

Date

Municipal Director

Ubungo

Date 02/2/2019

MD

Kinondoni

Municipal Director

Kigamboni

Date 02/2/2019

Appendix VII: Source of Construction Materials

COARSE AGGREGATE:

Coarse aggregate shall be clean, well-graded crushed granite stone or other equal and approved stone **from Msolwa or Lugoba quarry** and washed if required by the Structural Engineer. The pieces shall be angular or rounded in shape and shall have granular or crystalline or smooth (but not glassy) non-powdery surface. Flakey and laminated pieces, mica and shale shall only be present in such quantities as not to affect adversely the strength and durability of the concrete.

The four nominal aggregate sizes shall be 40mm (1½"); 20mm (¾"); 10mm (⅜"); 6mm (¼"); and the grading when analysed as described in BS. 812 shall be within the limits given in BS. 882. Structural Engineer will specify sizes of aggregates to be used in specific areas. For most work 20 mm maximum size aggregates will be used. The nominal maximum size of coarse aggregates should be not greater than ¼ of the minimum thickness of concrete section or element.

Results:

1. Relative and water absorption for aggregates

- a. Relative density on an oven dry basis – 2.95
- b. Relative density on saturated surface dry basis – 2.97
- c. Apparent relative density – 2.99
- d. Water absorption – 0.4

(As per CML TEST 2.2, Ref BS 812: Part 2: 1975 which is in the specified limit)

2. Aggregate Impact Value (AIV)

- a. AIV (mean value) - 14

(As per CML TEST 2.8, ref BS 812: Part 112:1990 which is in the specified limit)

3. Aggregate Crushing Value (ACV)

- a. ACV (Mean value) - 23

(As per CML TEST 2.8, ref BS 812: Part 112:1990 which is in the specified limit)

DAR ES SALAAM INSTITUTE OF TECHNOLOGY
DEPARTMENT OF CIVIL ENGINEERING
GEOTECHNICAL & HIGHWAY MATERIALS TESTING LABORATORY

RELATIVE DENSITY AND WATER ABSORPTION FOR AGGREGATES

HELPDESK ENGINEERING CO.LTD

SECOND WATER SECTOR SUPPORT PROJECT CONSTRUCTION OF
 PUBLIC TOILET IN DAR ES SALAAM

SOURCE OF MATERIAL:LUGOBA

METHOD	CML TEST	ref. BS 812: Part 2: 1975		
		A	B	Mean
Mass of saturated surface-dry aggregate in air	A	382.60	446.90	
Mass of vessel + aggregate filled with water	B	938.50	981.40	
Mass of vessel filled with water	C	703.70	668.20	
Mass of oven-dry aggregate in air	D	381.30	444.70	
Relative density on an oven-dry basis	$\frac{D}{A-(B-C)}$ t/m ³	2.58	3.33	2.95
Relative density on saturated surface-dry basis	$\rho_s = \frac{A}{A - (B - C)}$ t/m ³	2.59	3.34	2.97
Relative density	$\frac{D}{D}$ t/m ³	2.60	3.38	2.99
Water absorption	$\frac{A-D}{D}$ %	0.34	0.49	0.4

Sample Brought By

Tested by

JAMES

Certified by:

ENGINEERS REGISTRATION BOARD
 TANZANIA
 DAR-ES-SALAAM INSTITUTE OF TECHNOLOGY
 P.O.Box 2955 D -ES-SALAAM
 Material No. 1.

DATE 0 022

DAR ES SALAAM INSTITUTE OF TECHNOLOGY
DEPARTMENT OF CIVIL ENGINEERING
GEOTECHNICAL & HIGHWAY MATERIALS TESTING LABORATORY
RD CORE
AGGREGATE IMPACT VALUE (AIV)

HELPSDESK ENGINEERING CO.LTD

PROJECT: SECOND WATER SECTOR SUPPORT PROJECT CONSTRUCTION OF PUBLIC TOILET IN
DAR ES SALAAM

METHOD CML TEST 2.8, ref. BS 812: Part 112: 1990

CONDITION DRY

- 10 mm 2.36 mm

SOURCE OF MATERIAL: LUGOBA

METHOD CML TEST ref. BS 812: Part 2: 1975

reference		1	2
umber of blows	15 blows)	15	15
Mass of tray +	(g)	581.8	526.7
of alone	(g)	0	0
of original test specimen	(g)	M ₁ 581.8	526.7
of tray + material passing separating sieve (g)		78.2	78.5
of tray alone (g)		0	0
Mass of material passing separating sieve (g)	M ₂	78.2	78.5
of tray + material retained on separating sieve(g)		502.4	447.6
Mass of tray alone		0	0
of material retained on separating sieve (g)	M ₃	502.4	447.6
of passing and retained on separating sieve		580.6	526.1
Check versus M ₁	M ₂ + M ₃	580.6	526.1
Impact Value (in %) - DRY	(M ₂ /M ₁)*100	13.4	14.9
Impact Value (in %) - SOAKED			
= Mean value			14
= Median value			14

Sample Brought By

Tested by: JAMES

Certified by: Z.CHACHA

TRAYTOR BOARD
DAR-ES-SALAAM INSTITUTE OF TECHNOLOGY
P.O. BOX 40 PS-DAR SALAM
016 1

**DAR ES SALAAM INSTITUTE OF TECHNOLOGY
DEPARTMENT OF CIVIL ENGINEERING
GEOTECHNICAL & HIGHWAY MATERIALS TESTING LABORATORY**

AGG ACV)

HELPDESK ENGINEERING CO.LTD

R:

**SECOND WATER SECTOR SUPPORT PROJECT CONSTRUCTION OF TOILET IN
DAR ES SALAAM**

18.05.2022

METHOD CML TEST 2.8, ref. BS 812: Part 112: 1990

CONDITION DRY

Fraction tested Sepa sieve
14 - 10 mm 2.36 mm

SOURCE OF MATERIAL: LUGOBA

METHOD CML TEST 2.2, ref. BS 812: Part 2: 1975

n reference

1 2

LOADING LIMITS

ACV

Mass of +		2574.5	2575.1
of alone		0	0
Mass of original test specimen (g)	M₁	2574.5	2575.1
Mass of tray + material passing separating sieve (g)		584.9	585.1
of tray alone (g)		0	0
Mass of material passing separating sieve (g)	M₂	584.9	585.1
of tray + material retained on separating sieve(g)		1988.3	1989.1
Mass of alone		0	0
Mass of material retained on separating sieve (g)	M₃	1988.3	1989.1
Mass of passing and retained on separating sieve		2573.2	2574.2
Check versus M	M₂ + M₃		
Crushing Value (in %) - DRY	(M₂/M₁)100	22.7	22.7
Crushing Value (in %) - SOAKED			
= Mean value			23
= Median value			23

Sample Brought By

Tested by: C JAMES

Certified by: C ULIUS Z.CHACHA

R
T
OF
No 006
0 22

FINE AGGREGATES:-

The Contractor shall ensure that the grading of fine aggregate shall be such that not more than 10% by weight shall exceed 5mm in size and not more than 10% by weight shall pass a sieve BS. No. 100. Between these limits the grading shall conform to the grading for either zone 1, 2 or 3 (BS.882).

Results:

1. Grading Fine aggregates:

a. Grading Limits - 2.3

(As per Specific Limit 2.0 – 3.5, Hence it is passed)

**Dar es Salaam Institute of Technology.
& Building Engineering
Department. Materials Testing Laboratory.**


FORM NO. AGG-SAND-0001

**WATER SECTOR SUPPORT PROJECT
OF PUBLIC TOILET IN DAR ES SALAAM**

SOURCE: KISARAWA

FOR	N/SAND					
BY	MMUYA					
OF	10.05.2022		19.05.2022			
no.			2			
of Sample	320		320			Grading
		%				%
	Retained	Retained	Retained			
20.0						
14.0						
10.0	0	0.0	0.0	0.0	100.0	100
5	0	0.1	99.9	0.8	0.3	99.7
2.36	4	1.3	98.7	4.0	1.3	98.7
1.18	28	8.7	91.3	28.0		91.2
0.600	116			121.5	38.0	62.0
0.300	272	85.0	15.0	285.0	89.2	10.8
0.150	314	98.2	1.8	317.0	99.2	0.8
0.075	319	99.7	0.3	319.1	99.9	0.1
MODULUS	2.3					

sizes (mm)	wt (g)	Retain (g)	Pass (g)
A 28-20			
B 20-14			
C 14-10			
D 10-6.3			
			100
SPEC LIMIT			
sizes	wt.	Retain (g)	Pass
B 20-14			
D 10-6.3			
=			x 100
Total wt			

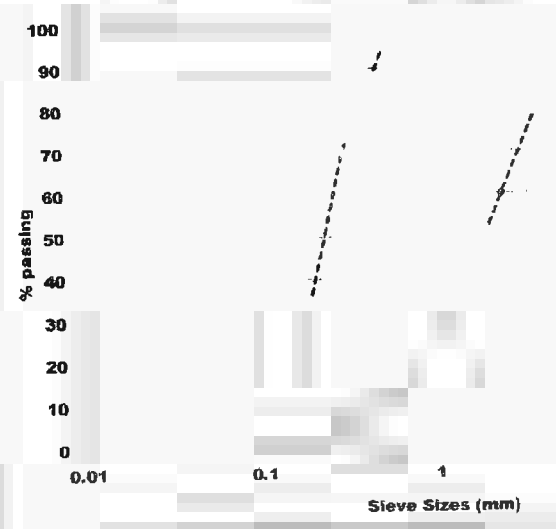

Sieve sizes (mm)	% Passing
10.0	100
16	15
2.3	0
SPEC LIMIT 2.0-3.5	

ENGINEERS REG BOARD
ANZANIA
INSTITUTE OF TECHNOLOGY
DAR ES SALAAM

6 2

Appendix VIII: Non-Technical Summary

THE UNITED REPUBLIC OF TANZANIA



MINISTRY OF WATER



Dar es Salaam Water Supply & Sanitation Authority
DAWASA Building, Dunga/Malaga Street, Mwananyamala Area
P. O. Box 1573, Dar es Salaam. TANZANIA.
Tel. +25522276006/15; Fax: +255222762480; E-mail:
dawasaceo@dawasa.co.tz

Provision of Consultancy Services for Preparation of Environmental and Social Impact Assessment (ESIA) and Resettlement Action Plan (RAP) Report for Construction of Off Grid Sanitation Projects

Ref No: TZ-DAWASA-91652-CS-QCBS

Comprehensive Project Brief for the Proposed Fecal Sludge Treatment Plant to be constructed at DAWASA Yard, Mkwajuni mtaa, Vijibweni ward, Dar es Salaam City Council, Dar es Salaam Region

NON-TECHNICAL SUMMARY
(English and Kiswahili Versions)

Submitted to:

National Environment Management Council,

Head Office, Kambarage Tower, 6th Floor, P. O. Box 2724, Dodoma.

Phone: +255 262960098, 0713608930,

Email Address: dg@nemc.or.tz

Website: www.nemc.or.tz

Lead Consultant:

Prof. Rubhera RAM Mato (PhD), CEng. (T), Reg. EIA Expert
Mobile: +255754898592; E-Mail: rubheramato@gmail.com

November 2024

NON-TECHNICAL SUMMARY

Comprehensive Project Brief for the Proposed Fecal Sludge Treatment Plant to be constructed at DAWASA Yard, Mkwajuni mtaa, Vijibweni ward, Dar es Salaam City Council, Dar es Salaam Region

Proponent: DAWASA

Proponent's Contact: DAWASA House, Dunga/Malanga

Street/Mwananyamala

P.O Box 1573 DSM

Tel: +255222760006/15

Fax: +255222762480

Email Address: info@dawasa.go.tz

EIA Expert: Prof. Rubhera RAM Mato

(PhD), CEng. (T), Reg. EIA Expert

Mobile: +255754898592

E-Mail: rubheramato@gmail.com

INTRODUCTION

The Government of the United Republic of Tanzania (GoT) through the Dar es Salaam Water and Sewerage Authority (DAWASA) under the Ministry of Water intends to implement an Off-Grid Sanitation Project (OGSP) in Dar es Salaam City to serve peri-urban areas not connected to the central sewerage system. DAWASA has received financing from the International Development Association (IDA) in the form of a credit to implement the project. Prior to implementing the project, the law in Tanzania requires an Environmental Impact Assessment to be conducted and approved by relevant authority. In order to comply with the law in Tanzania, the DAWASA intends to apply a portion of the proceeds of the credit to eligible payments for consulting services for Preparation of Environmental and Social Impact Assessment (ESIA) and Resettlement Action Plan (RAP) Report for construction of off grid sanitation projects.

Dar es Salaam is the largest and most important commercial and industrial centre in Tanzania. According to the Tanzania National Census of August 2022,

the City of Dar es Salaam has a population of 5,383,728 (sense.nbs.go.tz, accessed December 24, 2022). About 10% of the population is served by sewers and the rest almost depend on on-site sanitation systems. The sewer coverage is only limited to the area within city centre with a total length of 67.8km and the system is based on a separate system and discharge their effluent into oxidation ponds, and into the sea through sea outfall of about 1.03km long. The onsite sanitation systems result into Faecal sludge of which handling and management throughout the sanitation chain (from domestic containment, transportation as well as disposal and treatment) is currently hygienically inadequate thus posing environmental and public health risks. The Off-Grid project is intended to address these challenges. The Off-Grid project is divided into several subprojects which will be implemented in the five municipalities of Dar es Salaam City. One of these is the Construction of Faecal sludge treatment plant at DAWASA Yard, Mkwajuni Mtaa in Vijibweni ward, Kigamboni Municipality.

The ESIA study was conducted in accordance with the Environmental Management (Environmental Impact Assessment and Audit) (Amendment) Regulations, 2018 along with the Environmental Impact Assessment and Audit Regulations of 2005. These Regulations provide legal procedures for implementing the requirements of the Environmental Management Act Cap.191 of 2004. The Regulations give mandate to NEMC to oversee the EIA process, which culminates with an award of the EIA Certificate by the Ministry responsible for Environment.

In accordance with the EIA Regulations, NEMC is mandated to screen projects and make decisions of level of EIA required as well as evaluating the adequacy of respective environmental statements. Considering the nature and size of the proposed “Faecal Sludge Project in Kigamboni Municipality”, the project falls under Category “B2” (Non-Mandatory) in accordance with Reg.4 (1)(c) and First Schedule of the amended 2018 Regulations. The regulations require developers to prepare and submit to the National Management Council (NEMC)

filled EIA registration forms and “Project Briefs” for all B2 projects. The preparation and content of the “Project Briefs” is provided under Regulation 6(1) of Environmental Impact Assessment and Audit Regulations, 2005. The same has been followed in preparing this “Project Brief”. The project brief was conducted in July-August 2020.

This project brief for the Proposed Construction of Faecal Sludge Treatment Plant in Kigamboni Municipality is being submitted to NEMC together with EIA Registration Forms for EIA Certificate decision.

PROJECT DESCRIPTION

The project site is located at Vijibweni ward, Kigamboni Municipal within Dar es Salaam Region. The project site is geographically located at 37S UTM zone. The site is 23 Kilometers from Dar Es Salaam city center and 16 Kilometers from the Nyerere Bridge.

The project area is accessible through Kigamboni-Kongowe/Somangira road, about 15 km from Kigamboni Ferry and approximately 1.35 km from the road. It is in the right-left side location for Kigamboni to Somangira direction.

The proposed project site is characterized by both natural and artificial vegetation. There are tall grasses, shrubs with climbers, and some artificial trees (Palm trees) around the site area (Figure 3). The project site is located adjacent to the marches within which a river drains to the Indian Ocean. Generally, the project site is rich in nutrients because some farming activities were observed to be conducted.

POLICIES, LEGISLATION AND INSTITUTIONAL ARRANGEMENTS

Sector policies that were reviewed when executing the proposed development are;

- National Environment Policy 2021
 - National Land Policy of 1997
-

- Construction Industry Policy (2003)
- National Health Policy (2003)
- National Gender Policy of 2000
- National Human Settlements Development Policy (2000)

Principal Acts, regulations and guidance that support and provide guidelines to implement the intended project are;

- Environmental Management Act (2004)
- The Environmental Management (Fees and Charges) Regulations, 2021
- The Environmental Management (Control of hazardous Waste) regulations, 2021
- The Environmental Management (Control of Noise and vibration) regulations, 2015
- The Environmental Management (Prohibition of Plastic Carrier bags) regulations, 2019
- The Environmental Management (Solid Waste Management) regulations, 2007
- The Environmental Management (Water Quality) regulations, 2009
- The Environmental Management (Air Quality) regulations, 2009
- The Environmental Management (Soil Quality) regulations, 2009
- Occupational Health and Safety Act 2003
- The Water Supply and Sanitation Act No. 12 of 2009
- Engineers Registration Act and its Amendments 1997 and 2007
- The Contractors Registration (Amendment) Act, 2008
- The Architects and Quantity Surveyors Act (1997)
- The World World Bank guidelines for Environmental Management and Planning Act (2007)
- Public Health Act (2009)

STAKEHOLDERS ISSUES AND CONCERNS

Different stakeholders were consulted. Among of the issues that arise during consultation at the Kigamboni Municipal Council and community at DAWASA Yard, Mkwajuni mtaa are:

Facilities to be developed

- Proper awareness to people on best ways to dispose pads and other waste in order to avoid system blockage
- The proposed facilities should be well protected

Awareness to the community

- Awareness to the people on the system operation, since it is a new technology
- Awareness to the community to avoid riots in the future
- Educate the community to avoid the use of detrimental disinfectants to the system so as to avoid system failure and contaminated manures.

PROJECT REQUIREMENTS AND WASTE GENERATION

Project requirements

The main materials for Faecal Sludge Treatment Plant include cement, aggregates (stones), water, steel, sand, timbers, blocks, uPVC pipes, IPS Pipes and gravels. All materials are available in the local sources in Tanzania. The estimated quantities of the materials to be included in the BoQ.

The proposed project development will employ various standard construction equipment and machinery. Equipment expected to be used during the construction works are Excavators, Tippers, Concrete Mixers, poker vibrators, Wheel barrow, Compactor, etc. All equipment and machineries for construction works needed by the proposed project will be determined when the bill of quantities (BoQ) and selection of Contractor is finalized. These equipment shall be temporary and shall be demobilized once project is completed.

Wastes generation

The major wastes generation associated with the project are spoil soils resulting from earthworks during the foundation excavations, solid wastes and liquid waste. The spoil soil shall be stock piled around the public toilet for further use in landscaping the site at the end of the project.

A total of 120m³ per day of liquid waste is estimated to be received at the receiving chamber of the proposed facility during the maximum operation phase. On the other hand, about 0.5-1 tons per month of domestic refuse and other solid wastes is estimated to be generated and trapped at the garbage screen during the project construction and operation phase respectively. A well-established solid waste collection system will be instituted. The system will involve among other things wastes segregation at source, recycling or reuse of some wastes and final disposal to the approved dumpsite / landfill.

POTENTIAL IMPACTS

The following impacts were identified to be likely to occur during mobilization phase:

- Employment opportunities
- Improved urban agriculture
- Increased socio-cultural interaction

The following impacts were identified to be likely to occur during the construction phase;

- Increased HIV/AIDS and other sexual related diseases
- Loss of biodiversity
- Land degradation and increased pollution
- Noise pollution
- Air pollution from dust emission
- High risk of Health associated with construction work
- Waste generation during construction

The following impacts were identified to be likely to occur during the operational phase;

- Improved social-economic livelihood and dignity within the beneficiary society
- Increased Revenue to the nation through taxes, both direct and indirect
- Cost reduction for sewage management
- Biogas production potential
- Minimized forest harvesting
- Sewer leakage/overflow
- Improved urban agriculture

MITIGATION MEASURES AND ENVIRONMENTAL AND SOCIAL MANAGEMENT PLAN (ESMP)

The options to minimize or prevent the identified adverse social and environmental impacts as well as a monitoring plan have been suggested in this report and are contained in the ESMP. Many of them are based on good engineering practices and the timely responsiveness of the responsible institution. The ESMP describes the implementation schedule of the proposed mitigation measures as well as planning for long-term monitoring activities. It defines the roles and responsibilities of different actors of the plan. The Approach environmental and social costs amount to Tshs 38,000,000.00. The estimated annual costs for carrying out the proposed environmental and social motoring program amounts to TSH 28,000,000.00.

DECOMMISSIONING PLAN

The decommissioning is not anticipated in the foreseeable future. However, if this will happen, may entail change of use (functional changes) or demolition triggered by change of land use. In view of this, specific mitigation measures pertaining to environmental impacts of decommissioning works cannot be proposed at the moment with a reasonable degree of certainty.

CONCLUSION

The proposed project is of greater profit to the community and the country at large as it promotes and improve sanitation in the streets. When there is good and improved sanitation, then the outbreak of diseases like diarrhoea and associated stomach and waterborne diseases are also reduced and prevented hence improved public health.

The impacts identified are preventable and of less negativity to the community, therefore the developer can be provided with the environmental clearance certificate in order to commence the implementation of the project.

It is, therefore, concluded that implementation of the proposed construction of the Faecal sludge treatment plant at DAWASA Yard, Mkwajuni mtaa will entail no detrimental impacts provided that the recommended mitigation measures are adequately and timely put in place. The identified adverse impacts shall be managed through the proposed mitigation measures and implementation regime laid down in this EIS. DAWASA is committed to implementing all the recommendations given in the EIS and further carrying out the environmental auditing and monitoring schedules.

MUHTASARI WA WATENDAJI WASIO WA KIUFUNDI

Muhtasari wa Mradi mtambo wa kuchakata majitaka utakaojengwa katika eneo la DAWASA Yard, mtaa wa Mkwajuni, Kata ya Vijibweni, Halmashauri ya wilaya ya Kigamboni, Mkoa wa Dar es Salaam.

Mmiliki: Mamlaka ya Majisafi na Usafi wa Mazingira Dar es Salaam (DAWASA)

Mawasiliano ya Mmiliki: DAWASA,

DAWASA Building, Dunga/Malaga Street,
Mwananyamala Area

S.L.P 1573, Dar es Salaam. TANZANIA.

Simu :. +25522276006/15; Fax: +255222762480;

Barua Pepe: dawasaceo@dawasa.co.tz

Mshauri Muelekezi: Prof. Rubhera RAM Mato (PhD), CEng. (T), Reg. EIA Expert

S.L.P 35478, Dar es Salaam, Tanzania

Simu: +255754898592

Barua Pepe: rubheramato@gmail.com

UTANGULIZI

SERIKALI ya Jamhuri ya Muungano wa Tanzania (GoT) kupitia Mamlaka ya Majisafi na Majitaka Dar es Salaam (DAWASA) chini ya Wizara ya Maji inatarajia kutekeleza Mradi wa Usafi wa Mazingira Nje ya Mtandao (OGSP) katika Jiji la Dar es Salaam ili kuhudumia maeneo ya pembezoni mwa miji. maeneo ambayo hayajaunganishwa na mfumo mkuu wa maji taka. DAWASA imepata ufadhili kutoka kwa Jumuiya ya Maendeleo ya Kimataifa (IDA) ikiwa ni mkopo wa kutekeleza mradi huo. Kabla ya kutekeleza mradi huo, sheria nchini Tanzania inataka Tathmini ya Athari kwa Mazingira ifanywe na kuidhinishwa na mamlaka husika. Ili kuzingatia sheria nchini Tanzania, DAWASA inatarajia kutumia sehemu ya mapato ya mikopo kwa malipo stahiki kwa ajili ya huduma za ushauri kwa ajili ya Maandalizi ya Tathmini ya Athari kwa Mazingira na

Kijamii (ESIA) na Ripoti ya Mpango Kazi wa Makazi Mapya (RAP) kwa ajili ya ujenzi. wa miradi ya usafi wa mazingira nje ya gridi ya taifa.

Dar es Salaam ni kituo kikubwa na muhimu zaidi cha biashara na viwanda nchini Tanzania. Kwa mujibu wa Sensa ya Kitaifa ya Tanzania ya Agosti 2022, Jiji la Dar es Salaam lina wakazi 5,383,728 (Sensa ya Kitaifa 2022). Takriban 10% ya watu wanahudumiwa na mifereji ya maji machafu na wengine karibu hutegemea mifumo ya usafi wa mazingira kwenye eneo. Mtaru wa maji taka ni mdogo tu kwa eneo la katikati mwa jiji lenye urefu wa jumla ya 67.8km na mfumo unategemea mfumo tofauti na kumwaga maji machafu yao kwenye madimbwi ya vioksidishaji, na baharini kupitia maji ya bahari ya urefu wa 1.03km. Mifumo ya usafi wa mazingira kwenye eneo husababisha uchafu wa kinyesi ambao utunzaji na usimamizi wake katika mnyororo mzima wa usafi wa mazingira (kutoka kwa vyombo vya nyumbani, usafirishaji na utupaji na matibabu) kwa sasa hautoshelezi kiafya na hivyo kuhatarisha mazingira na afya ya umma. Mradi wa Off-Grid unakusudiwa kutatua changamoto hizi. Mradi wa Off-Grid umegawanywa katika miradi midogo kadhaa ambayo itatekelezwa katika manispaa tano za Jiji la Dar es Salaam. Mojawapo ni Ujenzi wa mtambo wa kusafisha kinyesi kilichopo DAWASA Yard, Mtaa wa Mkwajuni Kata ya Vijibweni Manispaa ya Kigamboni.

Utafiti wa ESIA ulifanyika kwa mujibu wa Kanuni za Usimamizi wa Mazingira (Tathmini na Ukaguzi wa Athari kwa Mazingira) (Marekebisho), 2018 pamoja na Tathmini ya Athari za Mazingira na Kanuni za Ukaguzi za mwaka 2005. Kanuni hizi zinatoa taratibu za kisheria za kutekeleza matakwa ya Sheria ya Usimamizi wa Mazingira. Sura ya 191 ya 2004. Kanuni zinatoa mamlaka kwa NEMC kusimamia mchakato wa EIA, ambao unaishia kwa kutunukiwa Cheti cha EIA na Wizara inayohusika na Mazingira.

Kwa mujibu wa Kanuni za EIA, NEMC ina mamlaka ya kuchunguza miradi na kufanya maamuzi ya kiwango cha EIA kinachohitajika pamoja na kutathmini utoshelevu wa taarifa za mazingira husika. Kwa kuzingatia asili na ukubwa wa

mradi unaopendekezwa wa “Mradi wa Kinyesi katika Manispaa ya Kigamboni”, mradi uko chini ya Kitengo “B2” (Si cha Lazima) kwa mujibu wa Kanuni ya 4 (1)(c) na Jedwali la Kwanza la Kanuni zilizorekebishwa za 2018. . Kanuni hizo zinawataka wasanidi programu kuandaa na kuwasilisha kwa Baraza la Kitaifa la Usimamizi (NEMC) lililojaza fomu za usajili wa EIA na "Muhtasari wa Miradi" kwa miradi yote ya B2. Maandalizi na maudhui ya “Maelezo ya Mradi” yametolewa chini ya Kanuni ya 6(1) ya Tathmini ya Athari kwa Mazingira na Kanuni za Ukaguzi, 2005. Vile vile vimefuatwa katika kuandaa “Muhtasari wa Mradi” huu. Muhtasari wa mradi ulifanyika Julai-Agosti 2020.

Muhtasari huu wa mradi wa Mapendekezo ya Ujenzi wa Kiwanda cha Kusafisha Kinyesi katika Manispaa ya Kigamboni unawasilishwa NEMC pamoja na Fomu za Usajili wa EIA kwa uamuzi wa Cheti cha EIA.

MAELEZO YA MRADI

Eneo la mradi lipo kata ya Vijibweni, Manispaa ya Kigamboni ndani ya Mkoa wa Dar es Salaam. Eneo ni Kilomita 23 kutoka katikati ya jiji la Dar Es Salaam, na Kilomita 16 kutoka daraja la Nyerere. Eneo la mradi iliyopendekezwa haiko ndani ya mfumo nyeti wa ikolojia au eneo lililohifadhiwa na mbali na huduma za umma.

Eneo lilopendekezwa ya mradi ina sifa ya uoto wa asili na bandia. Kuna nyasi fupi na ndefu na baadhi ya miti bandia (Mitende) na Miembe karibu na eneo la eneo. Eneo la mradi liko karibu na maandamano ambayo mto unatiririsha maji hadi Bahari ya Hindi. Kwa ujumla, eneo la mradi lina virutubisho vingi kwa sababu baadhi ya shughuli za kilimo zilizingatiwa kufanywa.

SERA, MFUMO WA SHERIA NA TAASISI

Tanzania imejitolea kufikia malengo ya maendeleo endelevu. Msukumo huu unazingatiwa katika Sera ya Taifa ya Mazingira na sera nyingine za kisekta zikiwemo;

- Sera ya Kitaifa ya Mazingira, 2021

- Sera ya Taifa ya Ardhi ya mwaka 1997
- Sera ya Sekta ya Ujenzi (2003)
- Sera ya Taifa ya Afya (2003)
- Sera ya Taifa ya Jinsia ya 2000
- Sera ya Taifa ya Maendeleo ya Makazi (2000)

Sheria na kanuni muhimu ambazo zina umuhimu kwa maendeleo ya barabara kuhusiana na usimamizi wa mazingira ni pamoja na;

- Sheria ya Usimamizi wa Mazingira (2004)
- Kanuni za Usimamizi wa Mazingira (Ada na Ada) za 2021
- Kanuni za Usimamizi wa Mazingira (Udhibiti wa Taka hatarishi), 2021
- Kanuni za Usimamizi wa Mazingira (Udhibiti wa Kelele na Mtetemo), 2015
- Kanuni za Usimamizi wa Mazingira (Marufuku ya Mifuko ya Kubeba Plastiki), za 2019
- Kanuni za Usimamizi wa Mazingira (Udhibiti wa Taka Ngumu), 2007
- Kanuni za Usimamizi wa Mazingira (Ubora wa Maji), 2009
- Kanuni za Usimamizi wa Mazingira (Ubora wa Hewa), 2009
- Kanuni za Usimamizi wa Mazingira (Ubora wa Udongo), 2009
- Sheria ya Afya na Usalama Kazini ya 2003
- Sheria ya Ugavi wa Maji na Usafi wa Mazingira Na. 12 ya 2009
- Sheria ya Usajili wa Wahandisi na Marekebisho yake ya 1997 na 2007
- Sheria ya Usajili wa Makandarasi (Marekebisho) ya mwaka 2008
- Sheria ya Wabunifu na Wakadiriaji Majenzi (1997)
- Sheria ya Mipango Miji (2007)
- Sheria ya Afya ya Umma (2009)
- Miongozo ya Benki ya Dunia ya Usimamizi wa Mazingira

MASUALA NA MAMBO YA WADAU

Wadau mbalimbali walishauriwa. Miongoni mwa mambo yanayojitokeza wakati wa mashauriano katika Halmashauri ya Manispaa ya Kigamboni na jamii katika eneo la DAWASA Yard, Mtaa wa Mkwajuni ni pamoja na:

Vifaa vya kuendelezwa

- Uelewa sahihi kwa watu juu ya njia bora za kutupa pedi na taka zingine ili kuzuia kuziba kwa mfumo
 - Vifaa vinavyopendekezwa vinapaswa kulindwa vyema
- Ufahamu kwa jamii
- Ufahamu kwa watu juu ya uendeshaji wa mfumo, kwa kuwa ni teknolojia mpya
 - Uhamasishaji kwa jamii kuepuka machafuko siku zijazo
 - Kuelimisha jamii kuepuka matumizi ya dawa hatarishi kwenye mfumo ili kuepusha kushindwa kwa mfumo na mbolea iliyochafuliwa.

MAHITAJI YA MRADI NA UZALISHAJI WA TAKA

Mahitaji ya mradi

Nyenzo kuu za Kiwanda cha Kusafisha Matope ya Kinyesi ni pamoja na saruji, mikusanyiko (mawe), maji, chuma, mchanga, mbao, vitalu, mabomba ya uPVC, Mabomba ya IPS na changarawe. Nyenzo zote zinapatikana katika vyanzo vya ndani nchini Tanzania. Kiasi kinachokadiriwa cha nyenzo zitakazojumuishwa kwenye BoQ.

Uendelezaji wa mradi unaopendekezwa utaajiri vifaa na mashine mbalimbali za kawaida za ujenzi. Vifaa vinavyotarajiwa kutumika wakati wa kazi za ujenzi ni Excavators, Tippers, Concrete Mixers, poker vibrators, Wheel barrow, Compactor, n.k. Vifaa na mashine zote za kazi za ujenzi zinazohitajika na mradi unaopendekezwa zitajulikana wakati bili ya kiasi (BoQ) na uteuzi wa Mkandarasi umekamilika. Vifaa hivi vitakuwa vya muda na vitatolewa mara tu mradi utakapokamilika.

Uzalishaji wa taka

Uzalishaji mkubwa wa taka unaohusishwa na mradi ni udongo nyara unaotokana na udongo wakati wa uchimbaji wa msingi, taka ngumu na taka za kioevu. Udongo ulioharibika utarundikwa kuzunguka choo cha umma kwa matumizi zaidi katika kuweka mazingira ya eneo mwishoni mwa mradi.

Jumla ya 120m³ kwa siku ya taka ya kioevu inakadiriwa kupokelewa kwenye chumba cha kupokea cha kituo kilichopendekezwa wakati wa awamu ya juu ya operesheni. Kwa upande mwingine, takriban tani 0.5-1 kwa mwezi za taka za

nyumbani na taka zingine ngumu inakadiriwa kuzalishwa na kunaswa kwenye skrini ya taka wakati wa awamu ya ujenzi na operesheni ya mradi mtawaliwa. Mfumo mzuri wa kukusanya taka ngumu utanzishwa. Mfumo huo utahusisha miongoni mwa mambo mengine kutenganisha taka kwenye chanzo, kuchakata tena au kutumia tena baadhi ya taka na utupaji wa mwisho kwa dampo/jaa lililoidhinishwa.

ATHARI ZINAZOWEZA

Athari zifuatazo zilitambuliwa kuwa zinaweza kutokea wakati wa awamu ya uhamasishaji:

- Fursa za ajira
- Kuboresha kilimo mijini
- Kuongezeka kwa mwingiliano wa kijamii na kitamaduni

Athari zifuatazo zilitambuliwa kuwa zinaweza kutokea wakati wa awamu ya ujenzi;

- Kuongezeka kwa VVU/UKIMWI na magonjwa mengine yanayohusiana na ngono
- Kupotea kwa viumbe hai
- Uharibifu wa ardhi na kuongezeka kwa uchafuzi wa mazingira
- Uchafuzi wa kelele
- Uchafuzi wa hewa kutokana na uchafuzi wa vumbi
- Hatari kubwa ya Afya inayohusishwa na kazi ya ujenzi
- Uzalishaji taka katika ujenzi wa durig

Athari zifuatazo zilitambuliwa kuwa zinaweza kutokea wakati wa awamu ya uendeshaji;

- Kuboresha maisha ya kijamii na kiuchumi na heshima ndani ya jamii inayofaidika
 - Ongezeko la Mapato kwa taifa kupitia kodi, za moja kwa moja na zisizo za moja kwa moja
-

- Kupunguza gharama za usimamizi wa maji taka
- Uwezo wa uzalishaji wa gesi asilia
- Uvunaji mdogo wa misitu
- Kuvuja kwa maji taka/kufurika
- Kuboresha kilimo mijini

HATUA ZA KUPUNGUZA NA MPANGO WA USIMAMIZI WA MAZINGIRA NA KIJAMII (ESMP)

Chaguzi za kupunguza au kuzuia athari mbaya za kijamii na kimazingira zilizotambuliwa pamoja na mpango wa ufuatiliaji zimependekezwa katika ripoti hii na zimo katika ESMP. Wengi wao ni msingi wa mazoea mazuri ya uhandisi na mwitikio wa wakati wa taasisi inayowajibika. ESMP inaelezea ratiba ya utekelezaji wa mapendekezo ya hatua za kupunguza na pia kupanga shughuli za ufuatiliaji wa muda mrefu. Inafafanua majukumu na wajibu wa watendaji mbalimbali wa mpango. Gharama za Mbinu za kimazingira na kijamii zinafikia Tshs 38,000,000.00. Makadirio ya gharama za kila mwaka za kutekeleza mpango unaopendekezwa wa magari ya kimazingira na kijamii ni TSH 28,000,000.00.

MPANGO WA KUFUNGA MRADI

Mradi hautarajiwi kufungwa katika siku zijazo zinazoonekana. Hata hivyo, kama hii itatokea, inaweza kuhusisha mabadiliko ya matumizi (mabadiliko ya kiutendaji) au uharibifu unaosababishwa na mabadiliko ya matumizi ya ardhi. Kwa kuzingatia hili, hatua mahususi za kupunguza zinazohusu athari za kimazingira za kazi za uondoaji kazi haziwezi kupendekezwa kwa sasa kwa kiwango cha uhakika.

HITIMISHO

Mradi unaopendekezwa una faida kubwa kwa jamii na nchi kwa ujumla kwani unakuza na kuboresha usafi wa mazingira mitaani. Kunapokuwa na usafi wa mazingira bora na ulioboreshwa, basi mlipuko wa magonjwa kama vile kuhara na magonjwa yanayohusiana na tumbo na yale yatokanayo na maji pia hupungua na kuzuiwa hivyo kuboreshwa kwa afya ya umma.

Athari zilizoainishwa zinaweza kuzuilika na hazina hasi kidogo kwa jamii, kwa hivyo msanidi anaweza kupewa cheti cha kibali cha mazingira ili kuanza kuhusisha mradi.

Hivyo basi, inahitimishwa kuwa utekelezaji wa mapendekezo ya ujenzi wa mtambo wa kutibu kinyesi katika eneo la DAWASA, mtaa wa Mkwajuni hautaleta madhara yoyote mradi tu kwamba hatua zilizopendekezwa za kukabiliana nazo zimewekwa vya kutosha na kwa wakati. Athari mbaya zilizotambuliwa zitadhibitiwa kupitia hatua zilizopendekezwa za kupunguza na mfumo wa utekelezaji uliowekwa katika ripoti ya Tathmini ya Athari kwa Mazingira, TAM. DAWASA imejitolea kutekeleza mapendekezo yote yaliyotolewa katika ripoti na kutekeleza zaidi ratiba za ukaguzi na ufuatiliaji wa mazingira.

Annex I: Generic Environmental Management for Construction Activities

ENVIRONMENTAL MANAGEMENT OF CONSTRUCTION ACTIVITIES

Proper environmental management of construction projects can be achieved only with adequate site selection and project design. As such, the Environmental and Social Assessment (ESA) for subprojects involving any new construction, or any rehabilitation or reconstruction for existing projects, should provide information as to screening criteria for site selection and design including the following:

1.1 SITE SELECTION

Sites should be chosen based on community needs for additional projects, with specific lots chosen based on geographic and topographic characteristics. The site selection process involves site visits and studies to analyze: (i) the site's urban, suburban, or rural characteristics; (ii) national, state, or municipal regulations affecting the proposed lot; (iii) accessibility and distance from inhabited areas; (iv) land ownership, including verification of the absence of squatters and/or other potential legal problems with the land acquisition; (v) determination of site vulnerability to natural hazards, (i.e. intensity and frequency of floods, earthquakes, landslides, hurricanes, volcanic eruptions); (vi) suitability of soils and subsoils for construction; (vii) site contamination by lead or other pollutants; (viii) flora and fauna characteristics; (ix) presence or absence of natural habitats and/or ecologically important habitats on-site or in the vicinity (e.g. forests, wetlands, coral reefs, rare or endangered species); and (ix) historic and community characteristics.

1.2 PROJECT DESIGN

Project design criteria include, but are not limited to, the consideration of aspects such as heating, ventilation, natural and artificial light energy efficiency, floor space (ft²) per bed/ward, requirements for x-ray rooms, adequacy of corridors for wheelchair/bed access, adequate water supply and sanitation systems, historical and cultural considerations, security and handicapped access.

1.3 CONSTRUCTION ACTIVITIES AND ENVIRONMENTAL RULES FOR CONTRACTORS

The following information is intended solely as broad guidance to be used in conjunction with local and national regulations. Based on this information, environmental rules for contractors should be developed for each project, taking into account the project size, site characteristics, and location (rural vs. urban).

After choosing an appropriate site and design, construction activities can proceed. As these construction activities could cause significant impacts on and nuisances to surrounding areas, careful planning of construction activities is critical. Therefore the following rules (including specific prohibitions and construction management measures) should be incorporated into all relevant bidding documents, contracts, and work orders.

1.3.1 Prohibitions

The following activities are prohibited on or near the project site:

- Cutting of trees for any reason outside the approved construction area;
- Hunting, fishing, wildlife capture, or plant collection;
- Use of unapproved toxic materials, including lead-based paints, asbestos, etc.
- Disturbance to anything with architectural or historical value;
- Building of fires;
- Use of firearms (except authorized security guards);
- Use of alcohol by workers.

1.3.2 Construction Management Measures

Waste Management and Erosion:

Solid, sanitation, and, hazardous wastes must be properly controlled, through the implementation of the following measures:

Waste Management:

- Minimize the production of waste that must be treated or eliminated.
- Identify and classify the type of waste generated. If hazardous wastes (including health care wastes) are generated, proper procedures must be taken regarding their storage, collection, transportation, and disposal.
- Identify and demarcate disposal areas indicating the specific materials that can be deposited in each.
- Control placement of all construction waste (including earth cuts) to approved disposal sites (>300 m from rivers, streams, lakes, or wetlands). Disposal of in authorized areas all of garbage, metals, used oils, and excess material generated during construction, incorporating recycling systems and the separation of materials.

Maintenance:

- Identify and demarcate equipment maintenance areas (>15m from rivers, streams, lakes, or wetlands).
- Ensure that all equipment maintenance activities, including oil changes, are conducted within demarcated maintenance areas; never dispose of spent oils on the ground, in watercourses, drainage canals, or in sewer systems.
- Identify, demarcate and enforce the use of within-site access routes to limit the impact to site vegetation.
- Install and maintain an adequate drainage system to prevent erosion on the site during and after construction.

Erosion Control

- Erect erosion control barriers around the perimeter of cuts, disposal pits, and roadways.
- Spray water on dirt roads, cuts, fill material and stockpiled soil to reduce wind-induced erosion, as needed.
- Maintain vehicle speeds at or below 10mph within the work area at all times.

Stockpiles and Borrow Pits

- Identify and demarcate locations for stockpiles and borrow pits, ensuring that they are 15 meters away from critical areas such as steep slopes, erosion-prone soils, and areas that drain directly into sensitive water bodies.
- Limit extraction of material to approved and demarcated borrow pits.

Site Cleanup

- Establish and enforce daily site clean-up procedures, including maintenance of adequate disposal facilities for construction debris.

1.3.3 Safety During Construction

The Contractor's responsibilities include the protection of every person and nearby property from construction accidents. The Contractor shall be responsible for complying with all national and local safety requirements and any other measures necessary to avoid accidents, including the following:

- Carefully and mark pedestrian-safe access routes. ○ If school children are in the vicinity, include traffic safety personnel to direct traffic during school hours.

- Maintain a supply of supplies for traffic signs (including paint, easel, sign material, etc.), road marking, and guard rails to maintain pedestrian safety during construction.
- Conduct safety training for construction workers before beginning work.
- Provide personal protective equipment and clothing (goggles, gloves, respirators, dust masks, hard hats, steel-toed and –shanked boots, etc.) for construction workers and enforce their use.
- Post Material Safety Data Sheets for each chemical present on the worksite.
- Require that all workers read, or are read, all Material Safety Data Sheets. Clearly explain the risks to them and their partners, especially when pregnant or planning to start a family. Encourage workers to share the information with their physicians, when relevant.
- Ensure that the removal of asbestos-containing materials or other toxic substances is performed and disposed of by specially trained workers.
- During heavy rains or emergencies of any kind, suspend all work.
- Brace electrical and mechanical equipment to withstand seismic events during the construction.

1.3.4 Nuisance and dust control

To control nuisance and dust the Contractor should:

- Maintain all construction-related traffic at or below 15 mph on streets within 200 m of the site.
- Maintain all on-site vehicle speeds at or below 10 mph.
- To the extent possible, maintain noise levels associated with all machinery and equipment at or below 90 dB.
- In sensitive areas (including residential neighborhoods, hospitals, rest homes, etc.) more strict measures may need to be implemented to prevent undesirable noise levels.
- Minimize production of dust and particulate materials at all times, to avoid impacts on surrounding families and businesses, and especially to vulnerable people (children, elders).
- Phase removal of vegetation to prevent large areas from becoming exposed to wind.
- Place dust screens around construction areas, paying particular attention to areas close to housing, commercial areas, and recreational areas.

- Spray water as needed on dirt roads, cut areas, and soil stockpiles or fill material.
- Apply proper measures to minimize disruptions from vibration or noise coming from construction activities.

1.3.5 Community Relations

To enhance adequate community relations the Contractor should:

- Following the country and EA requirements, inform the population about construction and work schedules, interruption of services, traffic detour routes, and provisional bus routes, as appropriate.
- Limit construction activities at night. When necessary ensure that night work is carefully scheduled and the community is properly informed so they can take necessary measures.
- At least five days in advance of any service interruption (including water, electricity, telephone, bus routes) the community must be advised through postings at the project site, at bus stops, and in affected homes/businesses.

3.1.6 Chance Find Procedures for Culturally Significant Artifacts

The Contractor is responsible for familiarizing themselves with the following “Chance Finds Procedures”, in case culturally valuable materials are uncovered during excavation, including:

- Stop work immediately following the discovery of any materials with possible archeological, historical, paleontological, or other cultural value, announce findings to project manager, and notify relevant authorities;
- Protect artifacts as well as possible using plastic covers, and implement measures to stabilize the area, if necessary, to properly protect artifacts
- Prevent and penalize any unauthorized access to the artifacts
- Restart construction works only upon the authorization of the relevant authorities.

1.4 ENVIRONMENTAL SUPERVISION DURING CONSTRUCTION

The bidding documents should indicate how compliance with environmental rules and design specifications would be supervised, along with the penalties for non-compliance by contractors or workers. Construction supervision requires oversight of compliance with the manual and environmental specifications by the contractor or his designated environmental supervisor. Contractors are also required

to comply with national and municipal regulations governing the environment, public health, and safety.